A.

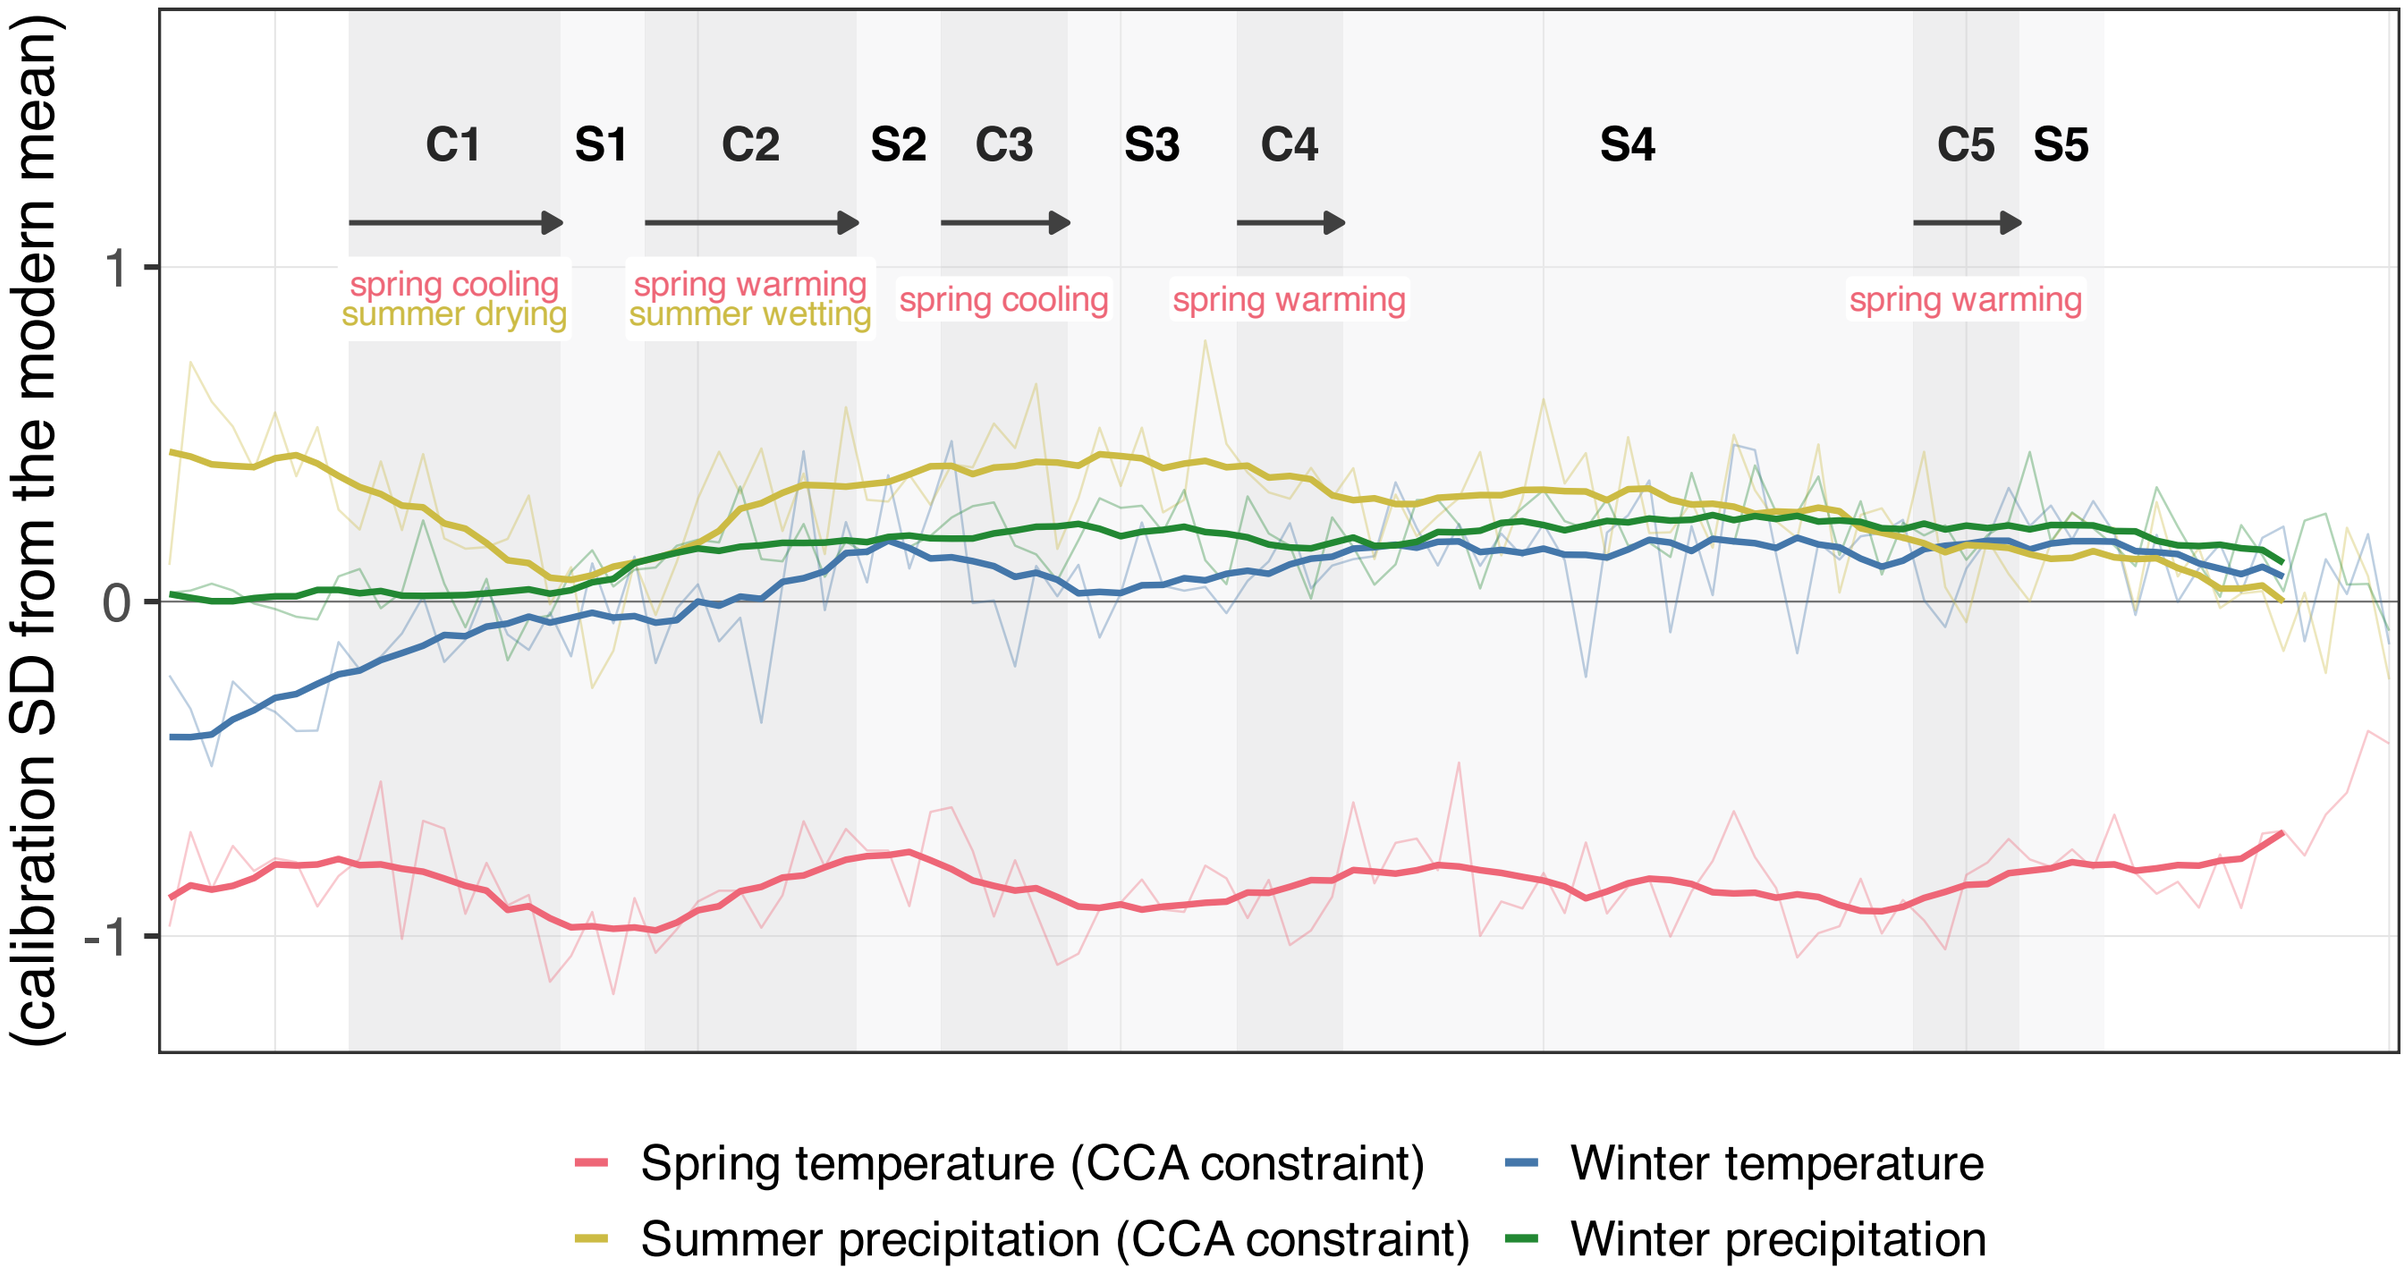
Standardized climate level
(calibration SD from the modern mean)
C1
S1
C2
S2
C3
S3
C4
S4
C5
S5
spring cooling
summer drying
spring warming
summer wetting
spring cooling
spring warming
spring warming
1
0
-1
Spring temperature (CCA constraint)
Summer precipitation (CCA constraint)
Winter temperature
Winter precipitation

B.

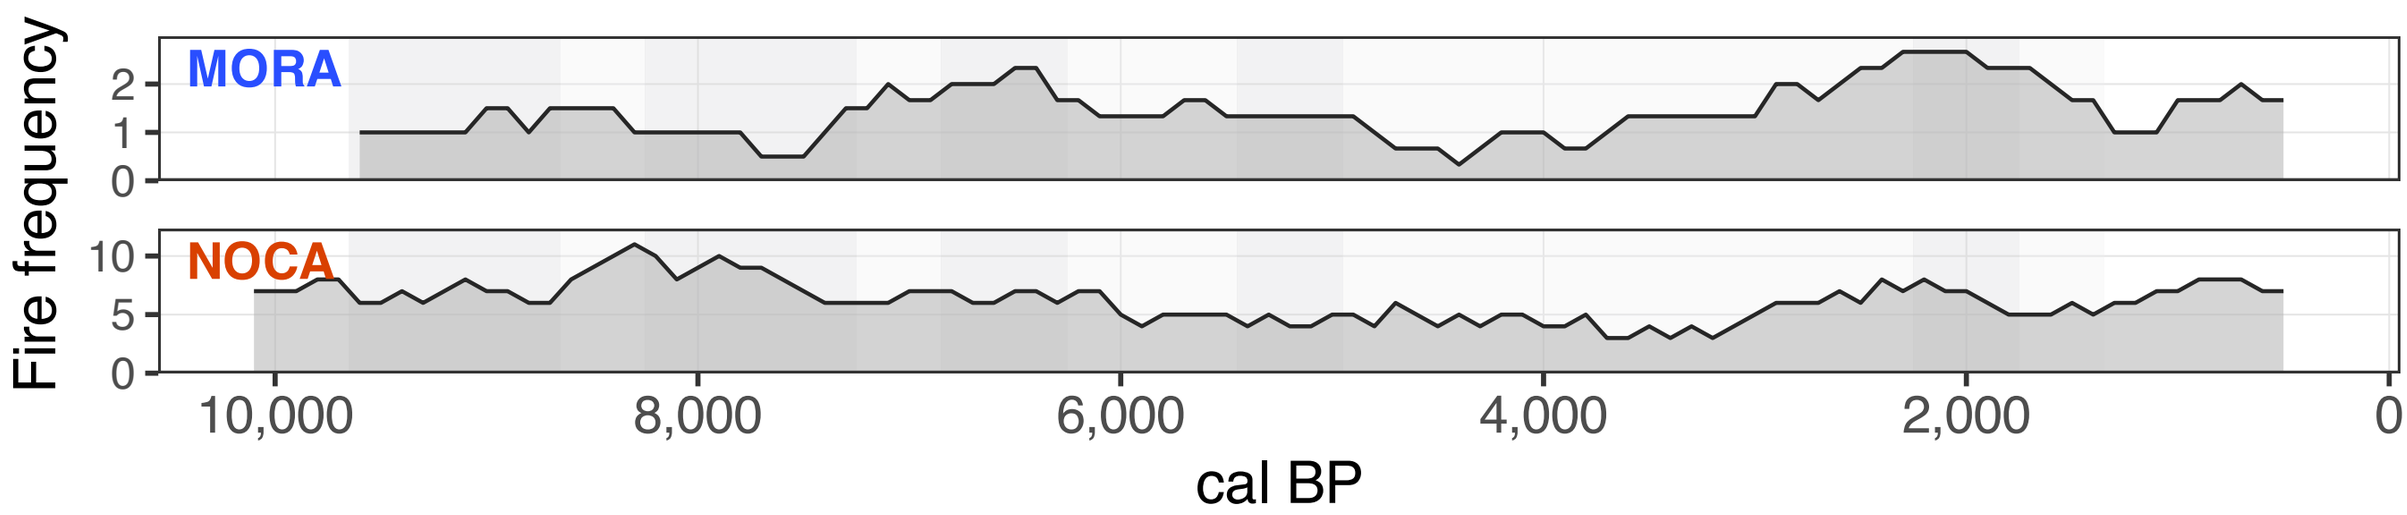
Fire frequency
MORA
NOCA
2
1
0
10
5
0
10,000
8,000
6,000
4,000
2,000
0
cal BP