
2026 Intl. Near East Conference on Electrical & Energy Systems
21–23 October 2026, Dubai, UAE

A Trustworthy Agentic Digital Twin for Adaptive Solar Energy Management

Binyam Mamo Sharew, Dina Endris Belay, Samuel Dereje Tadesse
Advisor: Dr. Nour Aburaed

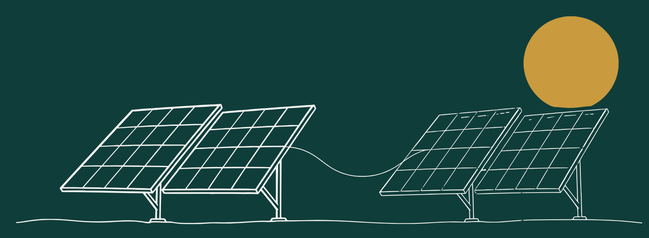

Abstract

Forecasting models trained at one solar plant often lose accuracy at a new site. Our accepted NEECON 2026 paper measured both outcomes: successful transfer within a region and negative transfer across regions. **SolarTwin AI** is a software digital twin that checks transfer risk, compares forecast models, plans battery and flexible-load actions within hard limits, and records why each action was taken.

Problem Statement & Objectives

New plants have little generation history. A model borrowed from another plant can drift without warning, and an energy schedule built on that forecast inherits the error.

1. **Detect** when a transferred forecast should not be trusted.
2. **Decide** a safe battery and flexible-load schedule within operating limits.
3. **Explain** each decision with the evidence that produced it.

Related Literature

Solar forecasting usually depends on site-specific history. Domain adaptation (DANN, CDAN) aligns source and target features so a model can transfer without target labels; our ISGT Middle East 2025 study reached $R^2 = 0.75$ in blind cross-plant transfer [2]. Digital twins let operators test plant and storage decisions in simulation before acting on them.

Design & Validation

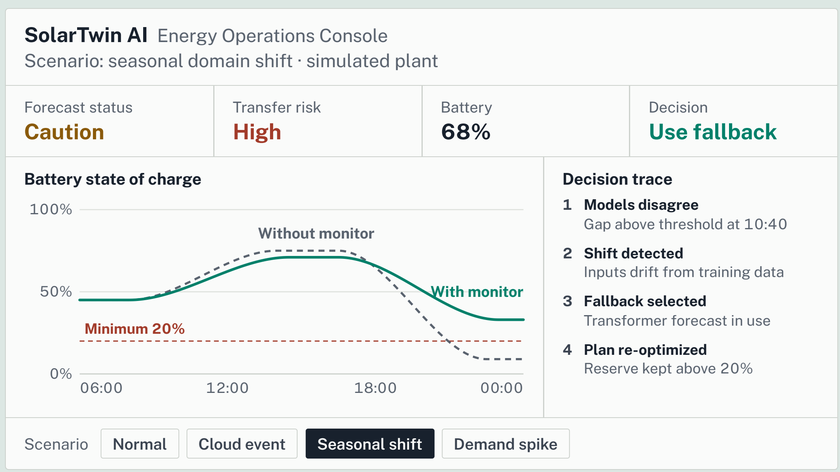


Fig. 2. Energy Operations Console. Judges pick a scenario and watch the forecast, risk signal and battery plan respond. Simulated plant and data.

Methodology

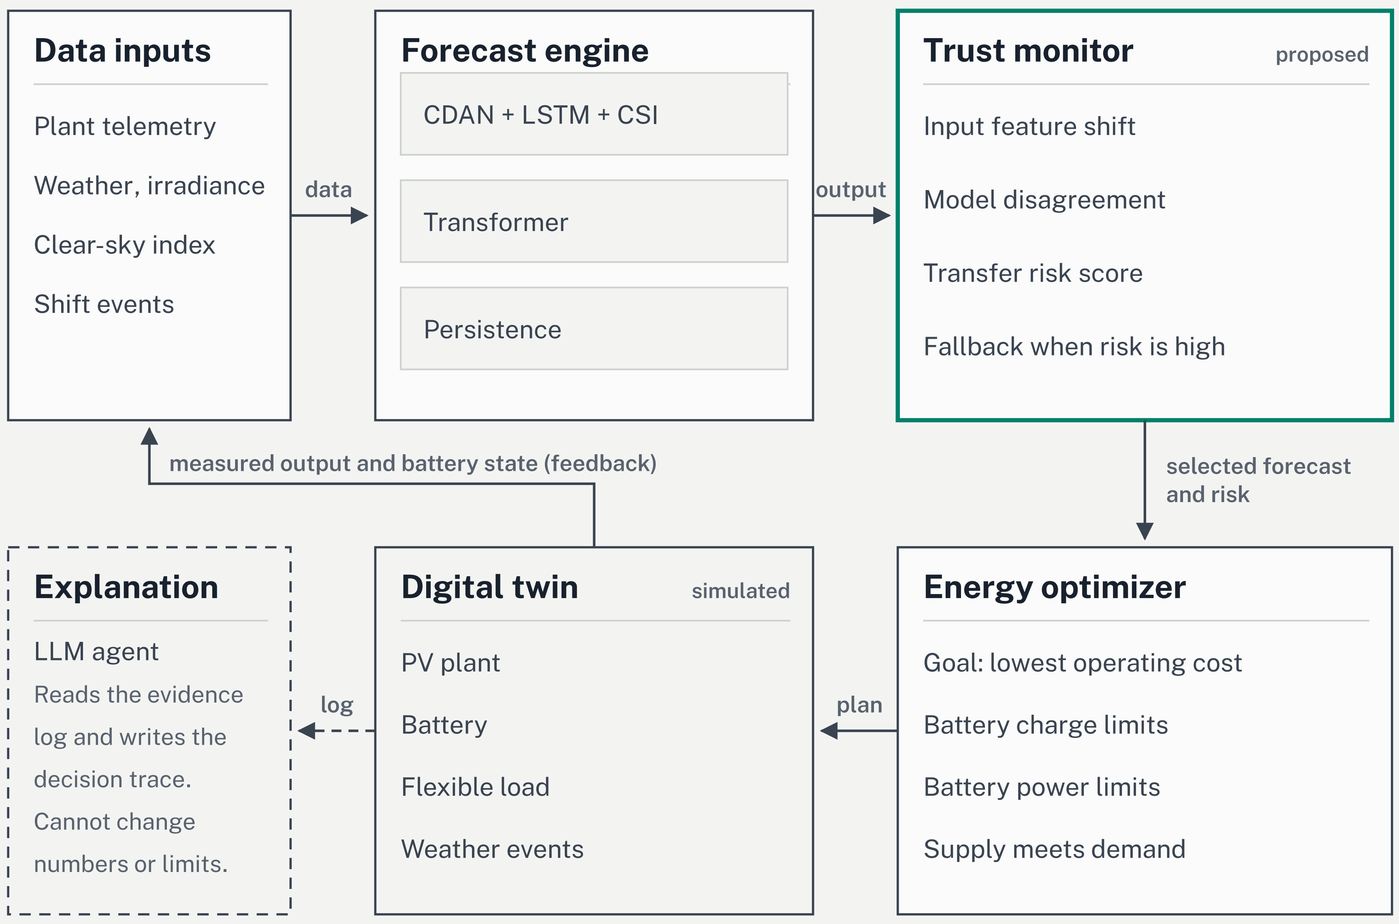


Fig. 1. System architecture. Solid arrows are numerical signals computed in code; the dashed arrow is the evidence log the LLM agent reads to explain decisions.

Results & Analysis

Transfer case [1]	Model	Result
Plant 1 to Plant 2 Same region, capacity mismatch	CDAN + LSTM + CSI	**$R^2 = 0.8325$**
India to Australia Cross-regional	CDAN + LSTM + CSI	**Negative transfer**
India to Australia Cross-regional	Transformer No adaptation	**Positive skill**

Adaptation helps when sites are similar and can hurt when they differ, so transfer risk must be measured before a forecast drives a decision. Fig. 3 shows how the monitor responds in a simulated shift.

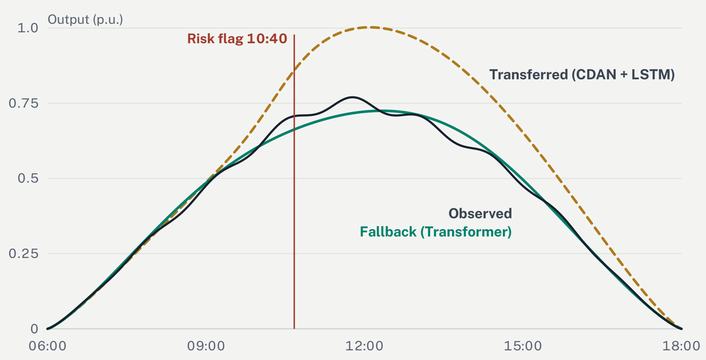


Fig. 3. Forecast candidates against observed output in a simulated seasonal shift. After the risk flag, the fallback forecast is used.

Evaluation Protocol



A Normal operation | **B** Sudden cloud | **C** Transfer risk | **D** Demand spike

Forecast	Risk monitor	Energy plan
MAE	Precision	Operating cost
RMSE	Recall	Renewable use
R^2	False alarms	Unmet demand

Conclusion

Takeaway
Forecast trust can be measured and acted on before it affects operations.

Contribution to theory
Links capacity-aware transfer learning with risk monitoring and constrained control.

Contribution to practice
A low-cost, offline tool to test new sites, weather events and demand changes.

Future work
Report detector precision, recall and false alarms; compare cost and unmet demand with baselines.

References & Contact

[1] Belay et al., “Learning When to Transfer: Robust Solar Power Forecasting Under Capacity Mismatch,” accepted at NEECON 2026.
[2] D. E. Belay et al., “Domain Adaptation for Cross-Plant Solar Power Forecasting Using Time Series Deep Learning Models,” IEEE PES ISGT Middle East 2025.