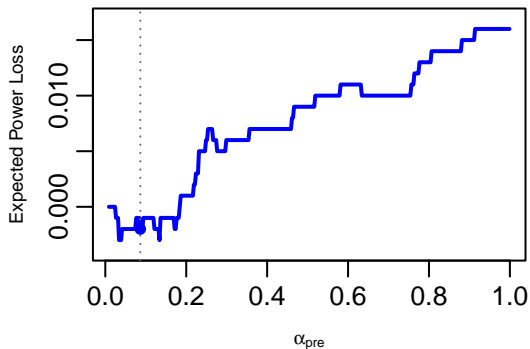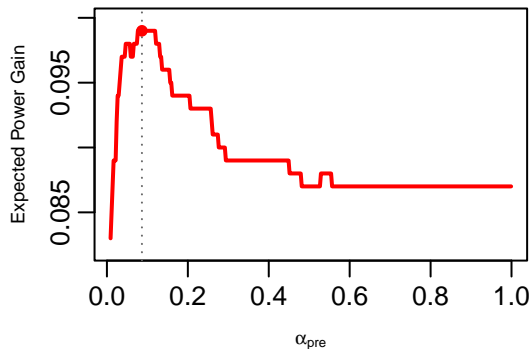# Power and Type I error trade−off for pre−testing for normality

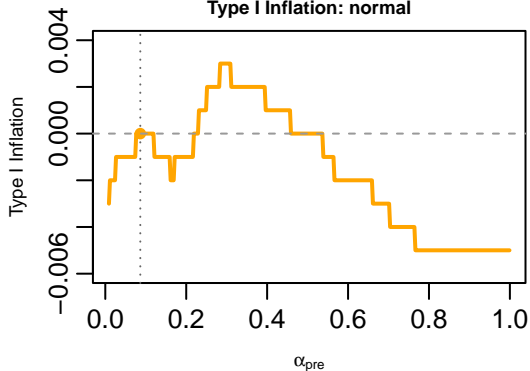Selected alpha = 0.08650 | Gain = 0.09900 | Loss = −0.00200 | Inflation (Normal, Non−normal) = (0.00000, 0.00000) | tol = 0.01