Power and Type I error trade−off for pre−testing for normality
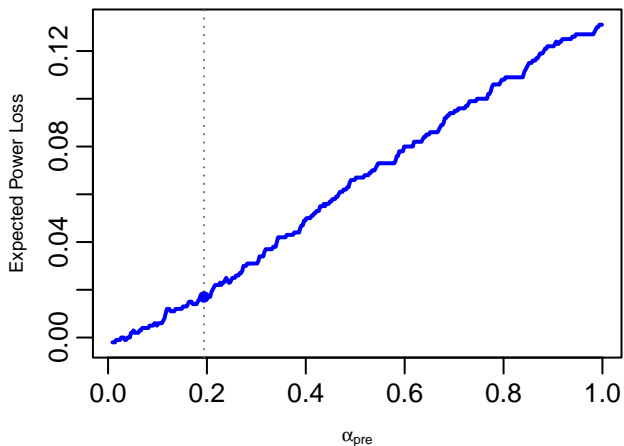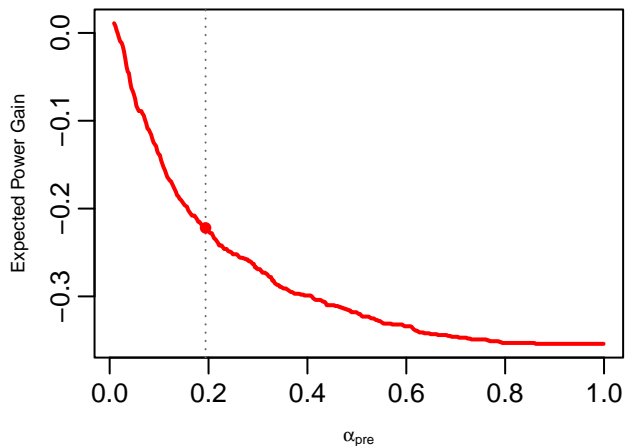
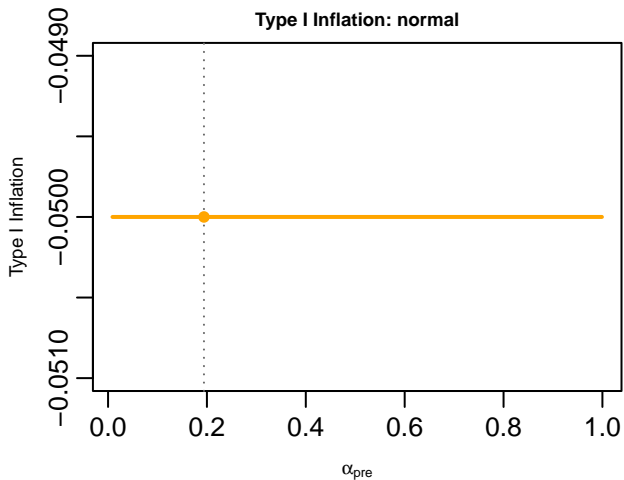Selected alpha = 0.19400 | Gain = −0.22200 | Loss = 0.01700 | Inflation (Normal, Non−normal) = (−0.05000, 0.00000) | tol = 0.01