


Floor FC-1

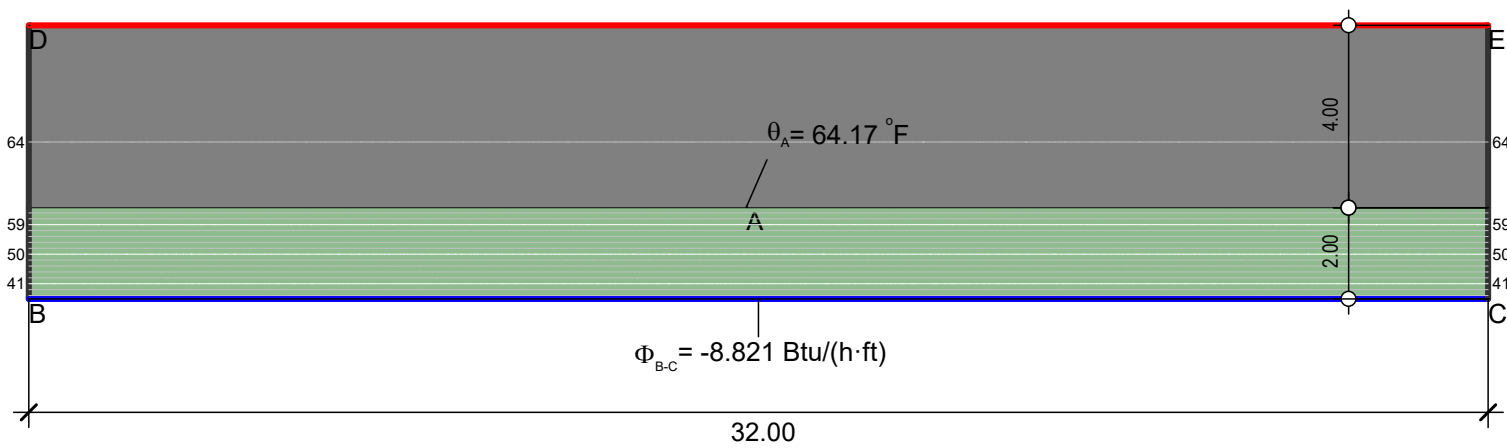

$$U_{eq\ B-C} = \frac{8.821}{32.4 \cdot 2.667} = 0.102\text{ Btu}/(\text{h}\cdot\text{ft}^2\cdot\text{F}) = R-9.80392$$

Boundary Condition			Material			
	$\theta[^{\circ}\text{F}]$	$h[\text{Btu}/(\text{h}\cdot\text{ft}^2\cdot\text{F})]$		$\lambda[\text{Btu}/(\text{h}\cdot\text{ft}\cdot\text{F})]$	ε	
Exterior, Westerly 90d Avg	35.600	4.403	Concrete (Heavily Reinforced) [R-0.05/in]	1.733	0.900	
Interior, heat flux, downwards	68.000	1.036	Roxul Comforboard 80 [R-4.2/in]	0.020	0.900	
Symmetry/Model section						