


Ground Floor

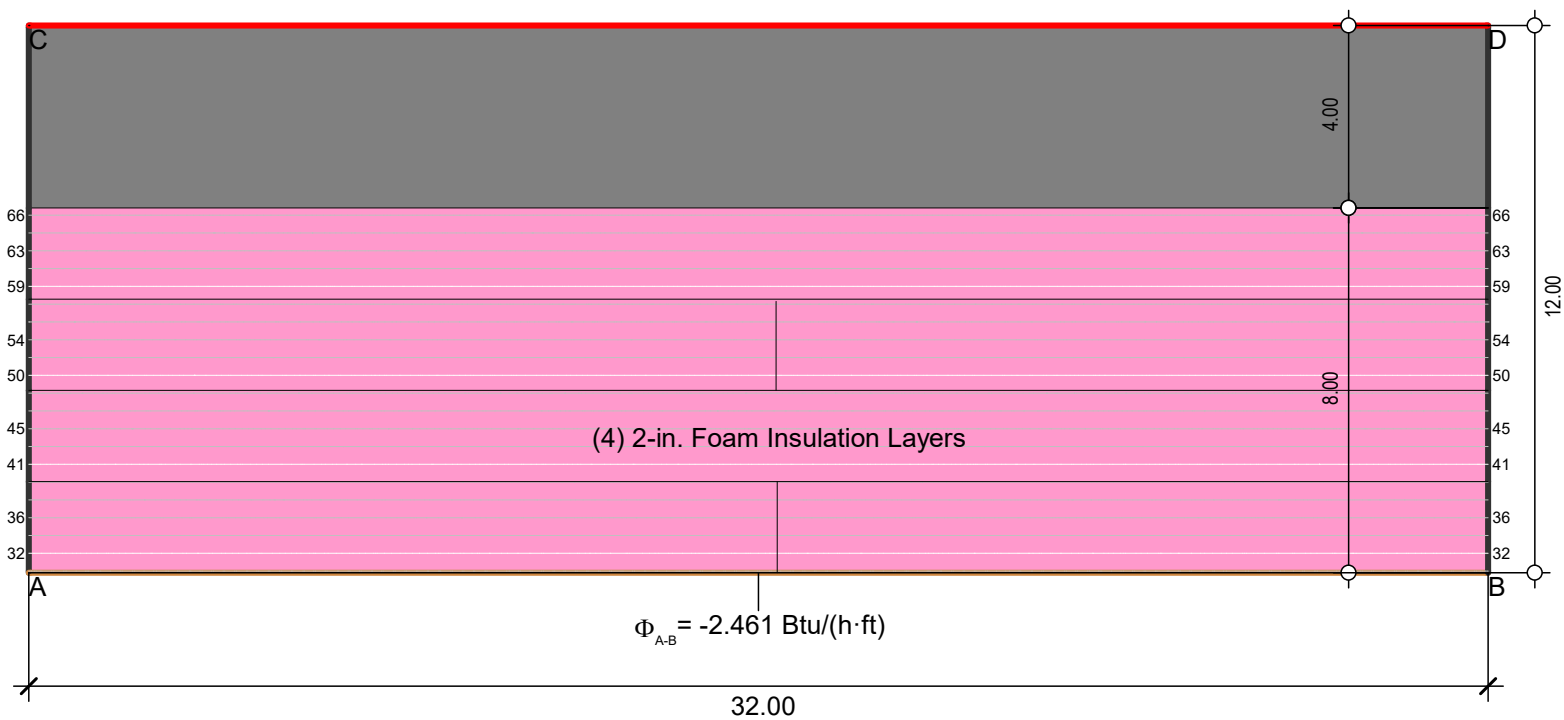

$$U_{eq\ A-B} = \frac{2.461}{37.97 \cdot 2.667} = 0.0243\ \text{Btu}/(\text{h} \cdot \text{ft}^2 \cdot \text{F}) = R-41.3223$$

Boundary Condition			Material			
	$\theta [^{\circ}\text{F}]$	$h [\text{Btu}/(\text{h} \cdot \text{ft}^2 \cdot \text{F})]$		$\lambda [\text{Btu}/(\text{h} \cdot \text{ft} \cdot \text{F})]$	ε	
Ground, Santa Fe 90d Avg	30.030		Concrete (Heavily Reinforced) [R-0.05/in]	1.733	0.900	
Interior, heat flux, downwards	68.000	1.036	XPS, [R-5.0/in]	0.017	0.900	
Symmetry/Model section						