


Metal Roof

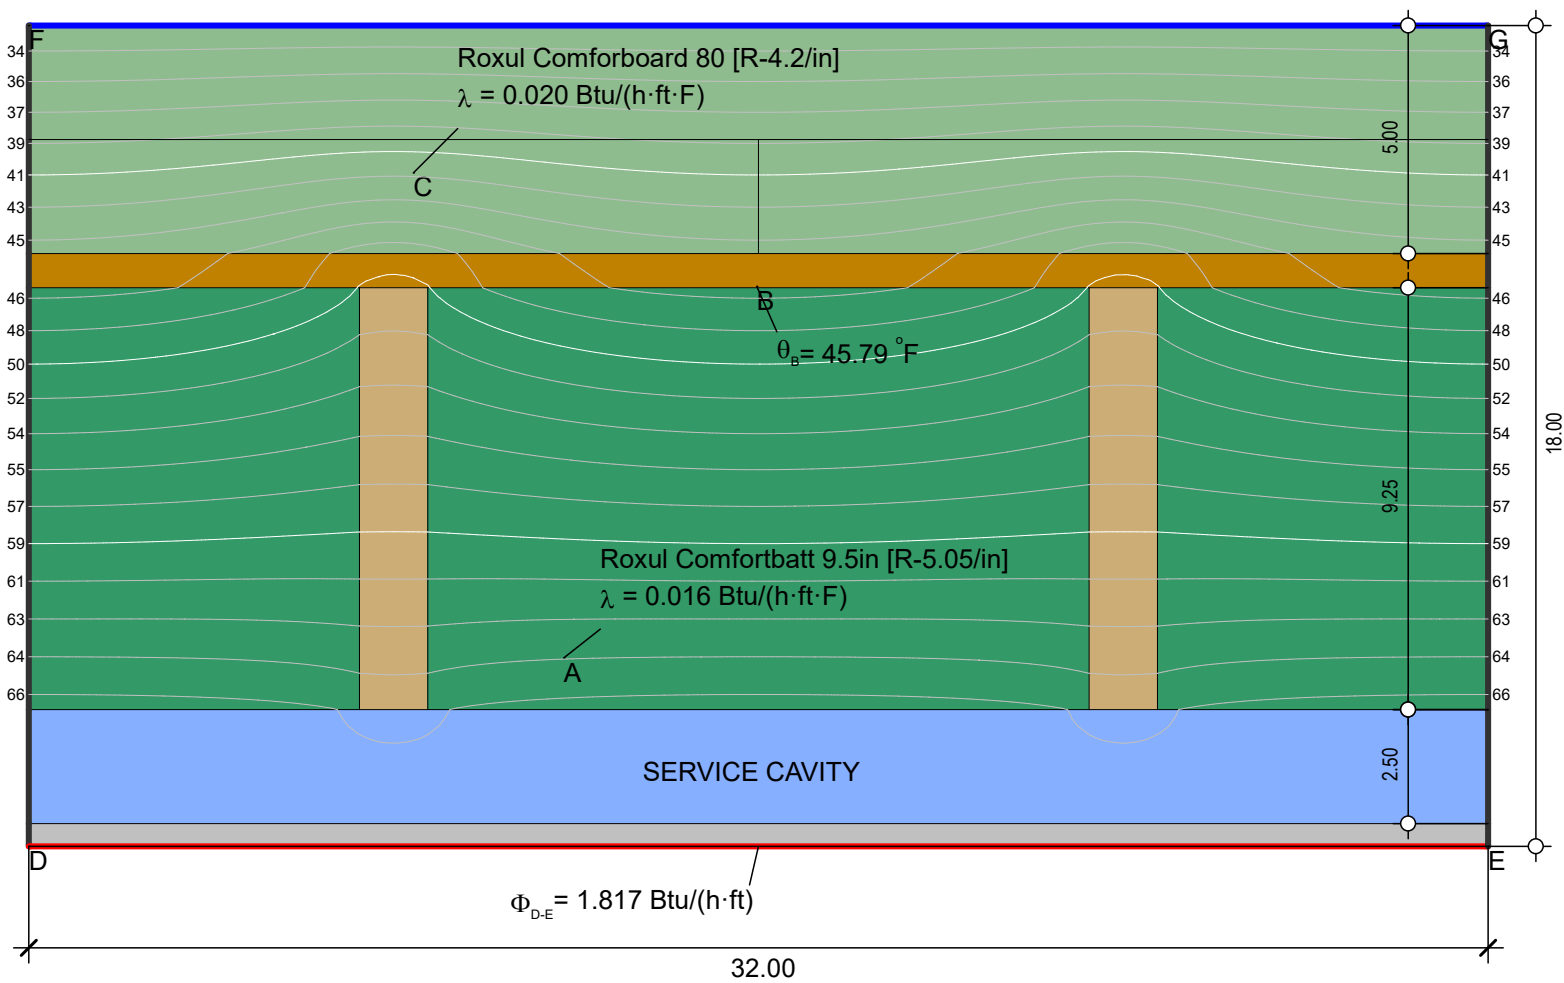

$$U_{eq\ D-E} = \frac{1.817}{36.18 \cdot 2.667} = 0.0188\ Btu/(h \cdot ft^2 \cdot F) = R-50.5051$$

Boundary Condition				Material	λ[Btu/(h·ft·F)]
q[Btu/(h·ft ²)]	θ[°F]	h[Btu/(h·ft ² ·F)]	ε		
Exterior, Greenwich 90d Avg	31.820	1.355		Air layer, unventilated, upwards, thickness: 65 mm	0.235
Interior, normal, horizontal	68.000	1.355		GWB (Typ) [R-0.85/in]	0.098
Symmetry/Model section	0.000			Plywood (Typ) [R-1.2/in]	0.069
				Roxul Comforboard 80 [R-4.2/in]	0.020
				Roxul Comfortbatt 9.5in [R-5.05/in]	0.016
				Wood, Coniferous [550 kg/m3], grain vertical	0.071, 0.161