


Extension Wall

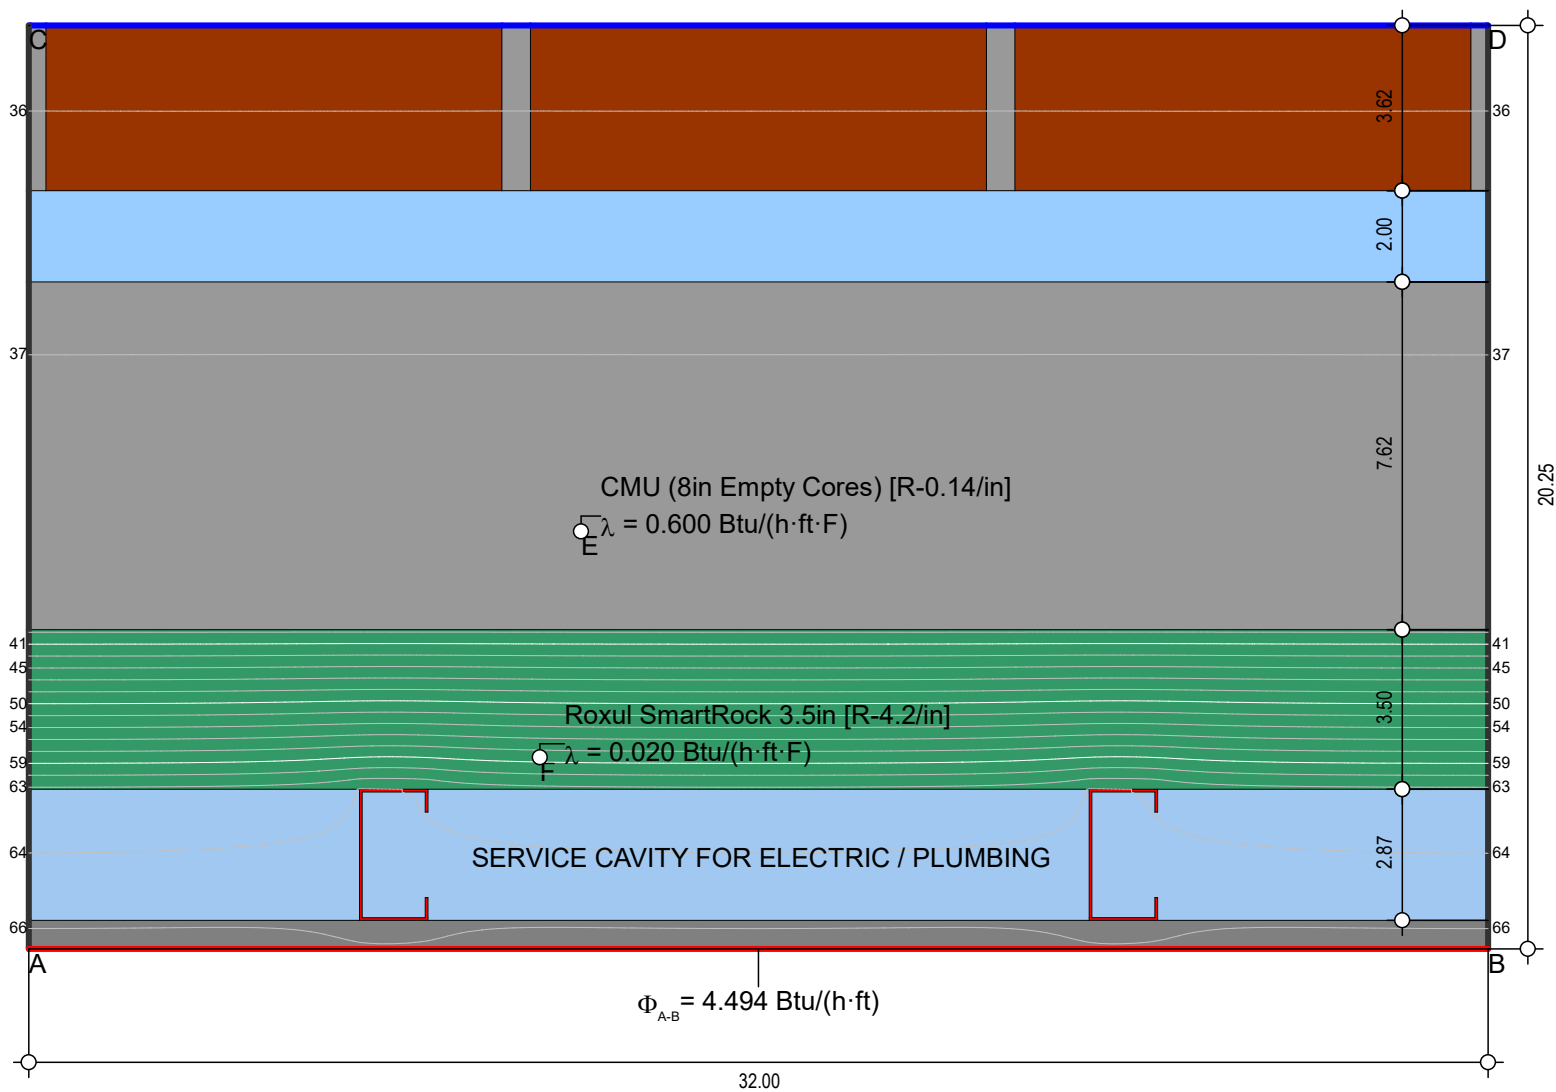

$$U_{eq \text{ A-B}} = \frac{4.494}{33.408 \cdot 2.667} = 0.0504 \text{ Btu}/(\text{h}\cdot\text{ft}^2\cdot\text{F}) = R-19.8$$

Boundary Condition				Material	$\lambda[\text{Btu}/(\text{h}\cdot\text{ft}\cdot\text{F})]$
q[Btu]/(h·ft²)	θ[F]	h[Btu]/(h·ft²·F)	ε		
Exterior, NYC 90d Avg	34.592	4.403		Air layer, unventilated, horizontal, thickness: 40 mm	0.128
Interior, normal, horizontal	68.000	1.355		Brick (Common) [R-0.2/in]	0.416
Symmetry/Model section	0.000			CMU (8in Empty Cores) [R-0.14/in]	0.600
				GWB (Typ) [R-0.85/in] (1)	0.098
				Mortar - Portland Cement-Lime (PHI)	0.520
				Roxul SmartRock 3.5in [R-4.2/in]	0.020
				Steel (Rolled, Ground) [R-0.0029/in]	28.889
				Slightly ventilated air cavity *	
				* Simplified approach	