


Roof

ROOFING / PAVERS, TYP.

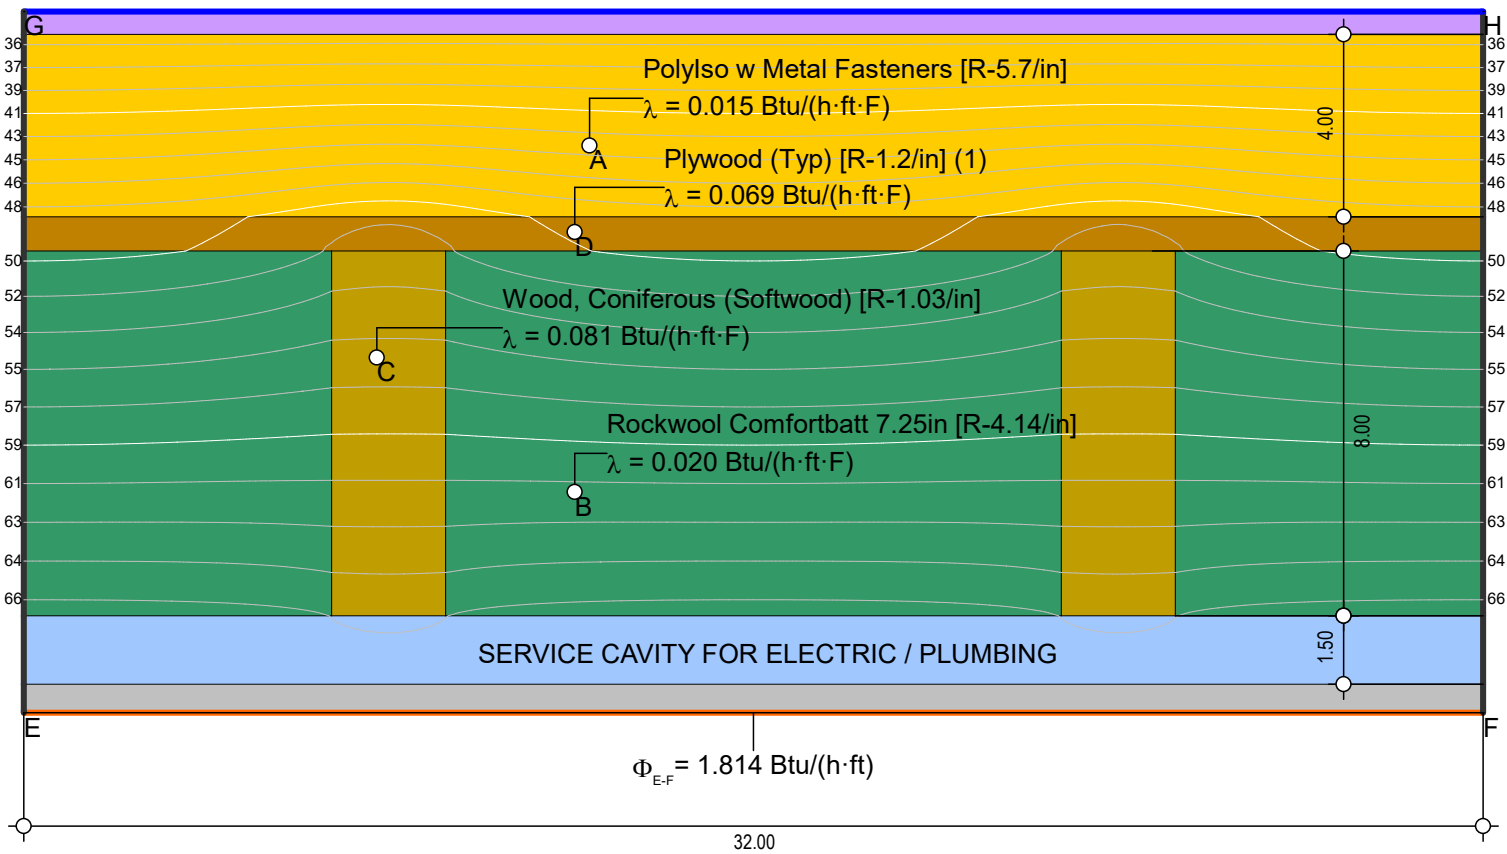

$$U_{eq \text{ E-F}} = \frac{1.814}{33.408 \cdot 2.667} = 0.0204 \text{ Btu}/(\text{h}\cdot\text{ft}^2\cdot\text{F}) = R-49.0$$

Boundary Condition					Material		$\lambda[\text{Btu}/(\text{h}\cdot\text{ft}\cdot\text{F})]$
	$q[\text{Btu}/(\text{h}\cdot\text{ft}^2)]$	$\theta[^\circ\text{F}]$	$h[\text{Btu}/(\text{h}\cdot\text{ft}^2\cdot\text{F})]$	ε			
Exterior, NYC 90d Avg		34.592	4.403		Air layer, unventilated, upwards, thickness: 40 mm		0.144
Interior, heat flux, upwards		68.000	1.761		GWB (Typ) [R-0.85/in]		0.098
Symmetry/Model section	0.000				GWB (USG Securock) [R-1/in]		0.578
					Plywood (Typ) [R-1.2/in] (1)		0.069
					Polyiso w Metal Fasteners [R-5.7/in]		0.015
					Rockwool Comfortbatt 7.25in [R-4.14/in]		0.020
					Wood, Coniferous (Softwood) [R-1.03/in]		0.081