


Exterior Wall

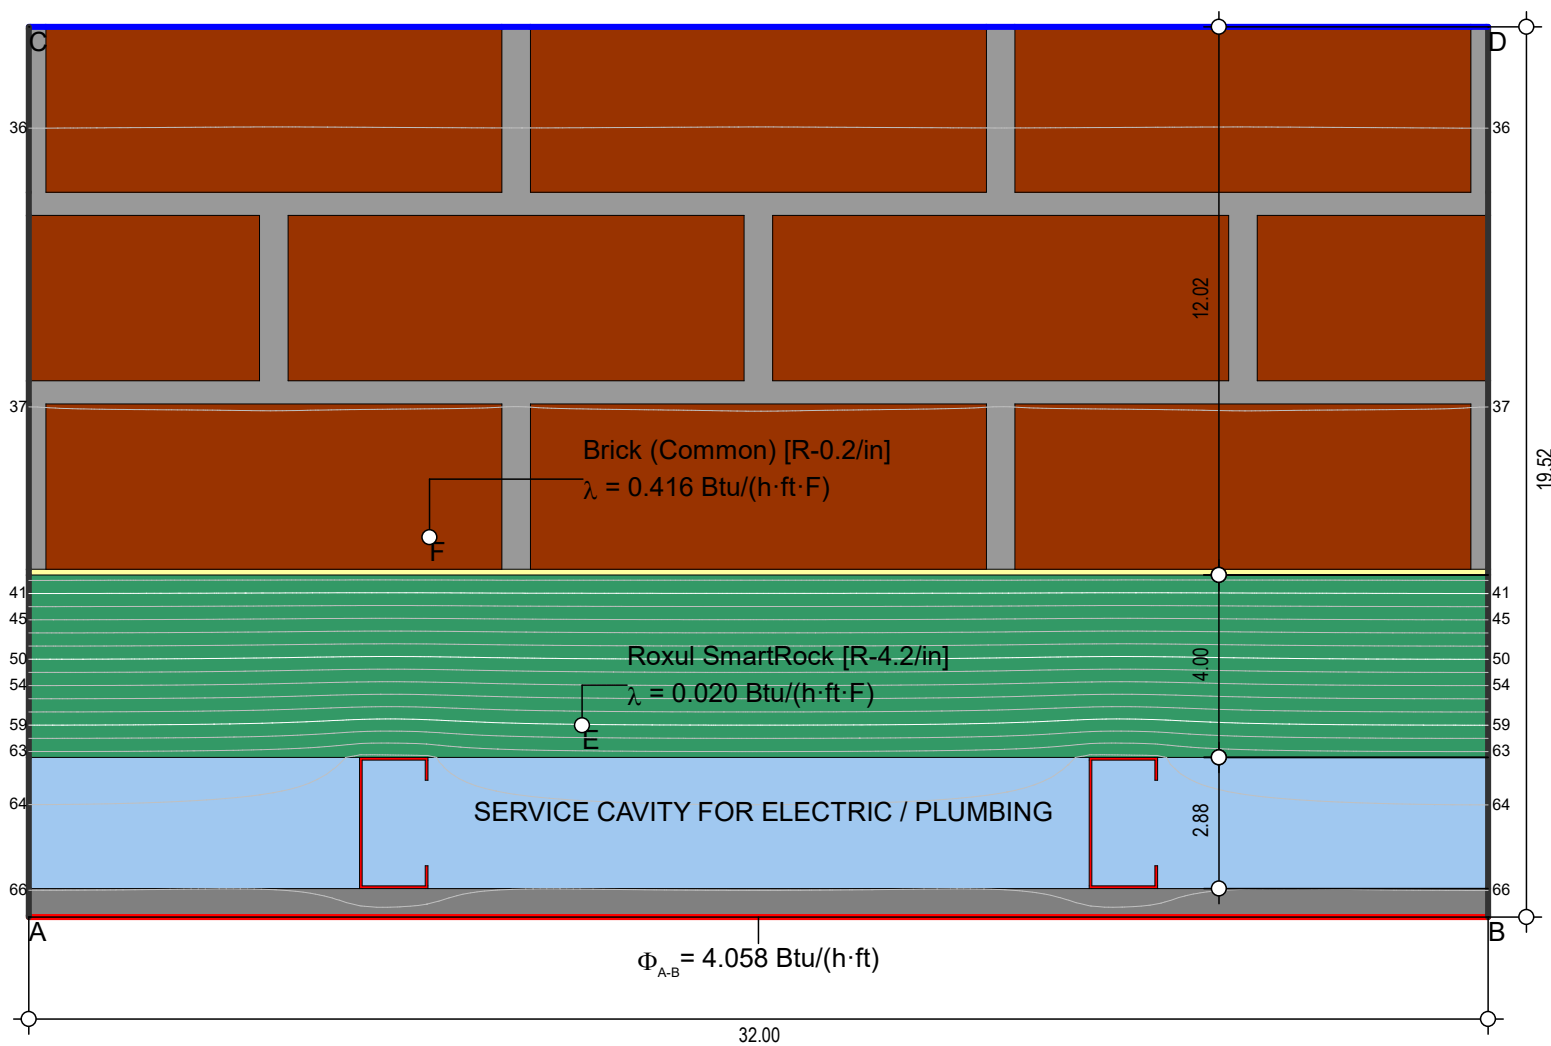

$$U_{eq\ A-B} = \frac{4.058}{33.408 \cdot 2.667} = 0.0455 \text{ Btu}/(\text{h}\cdot\text{ft}^2\cdot\text{F}) = R-22.0$$

Boundary Condition	q[Btu/(h·ft ²)]	θ[F]	h[Btu/(h·ft ² ·F)]	ε
Exterior, NYC 90d Avg	34.592	34.592	4.403	
Interior, normal, horizontal	68.000	68.000	1.355	
Symmetry/Model section	0.000	0.000		

Material	λ[Btu/(h·ft·F)]
Air layer, unventilated, horizontal, thickness: 40 mm	0.128
Brick (Common) [R-0.2/in]	0.416
GWB (Typ) [R-0.85/in] (1)	0.098
Mortar - Portland Cement-Lime (PHI)	0.520
Roxul SmartRock [R-4.2/in]	0.020
Steel (Rolled, Ground) [R-0.0029/in]	28.889
Stucco [R-0.2/in]	0.417