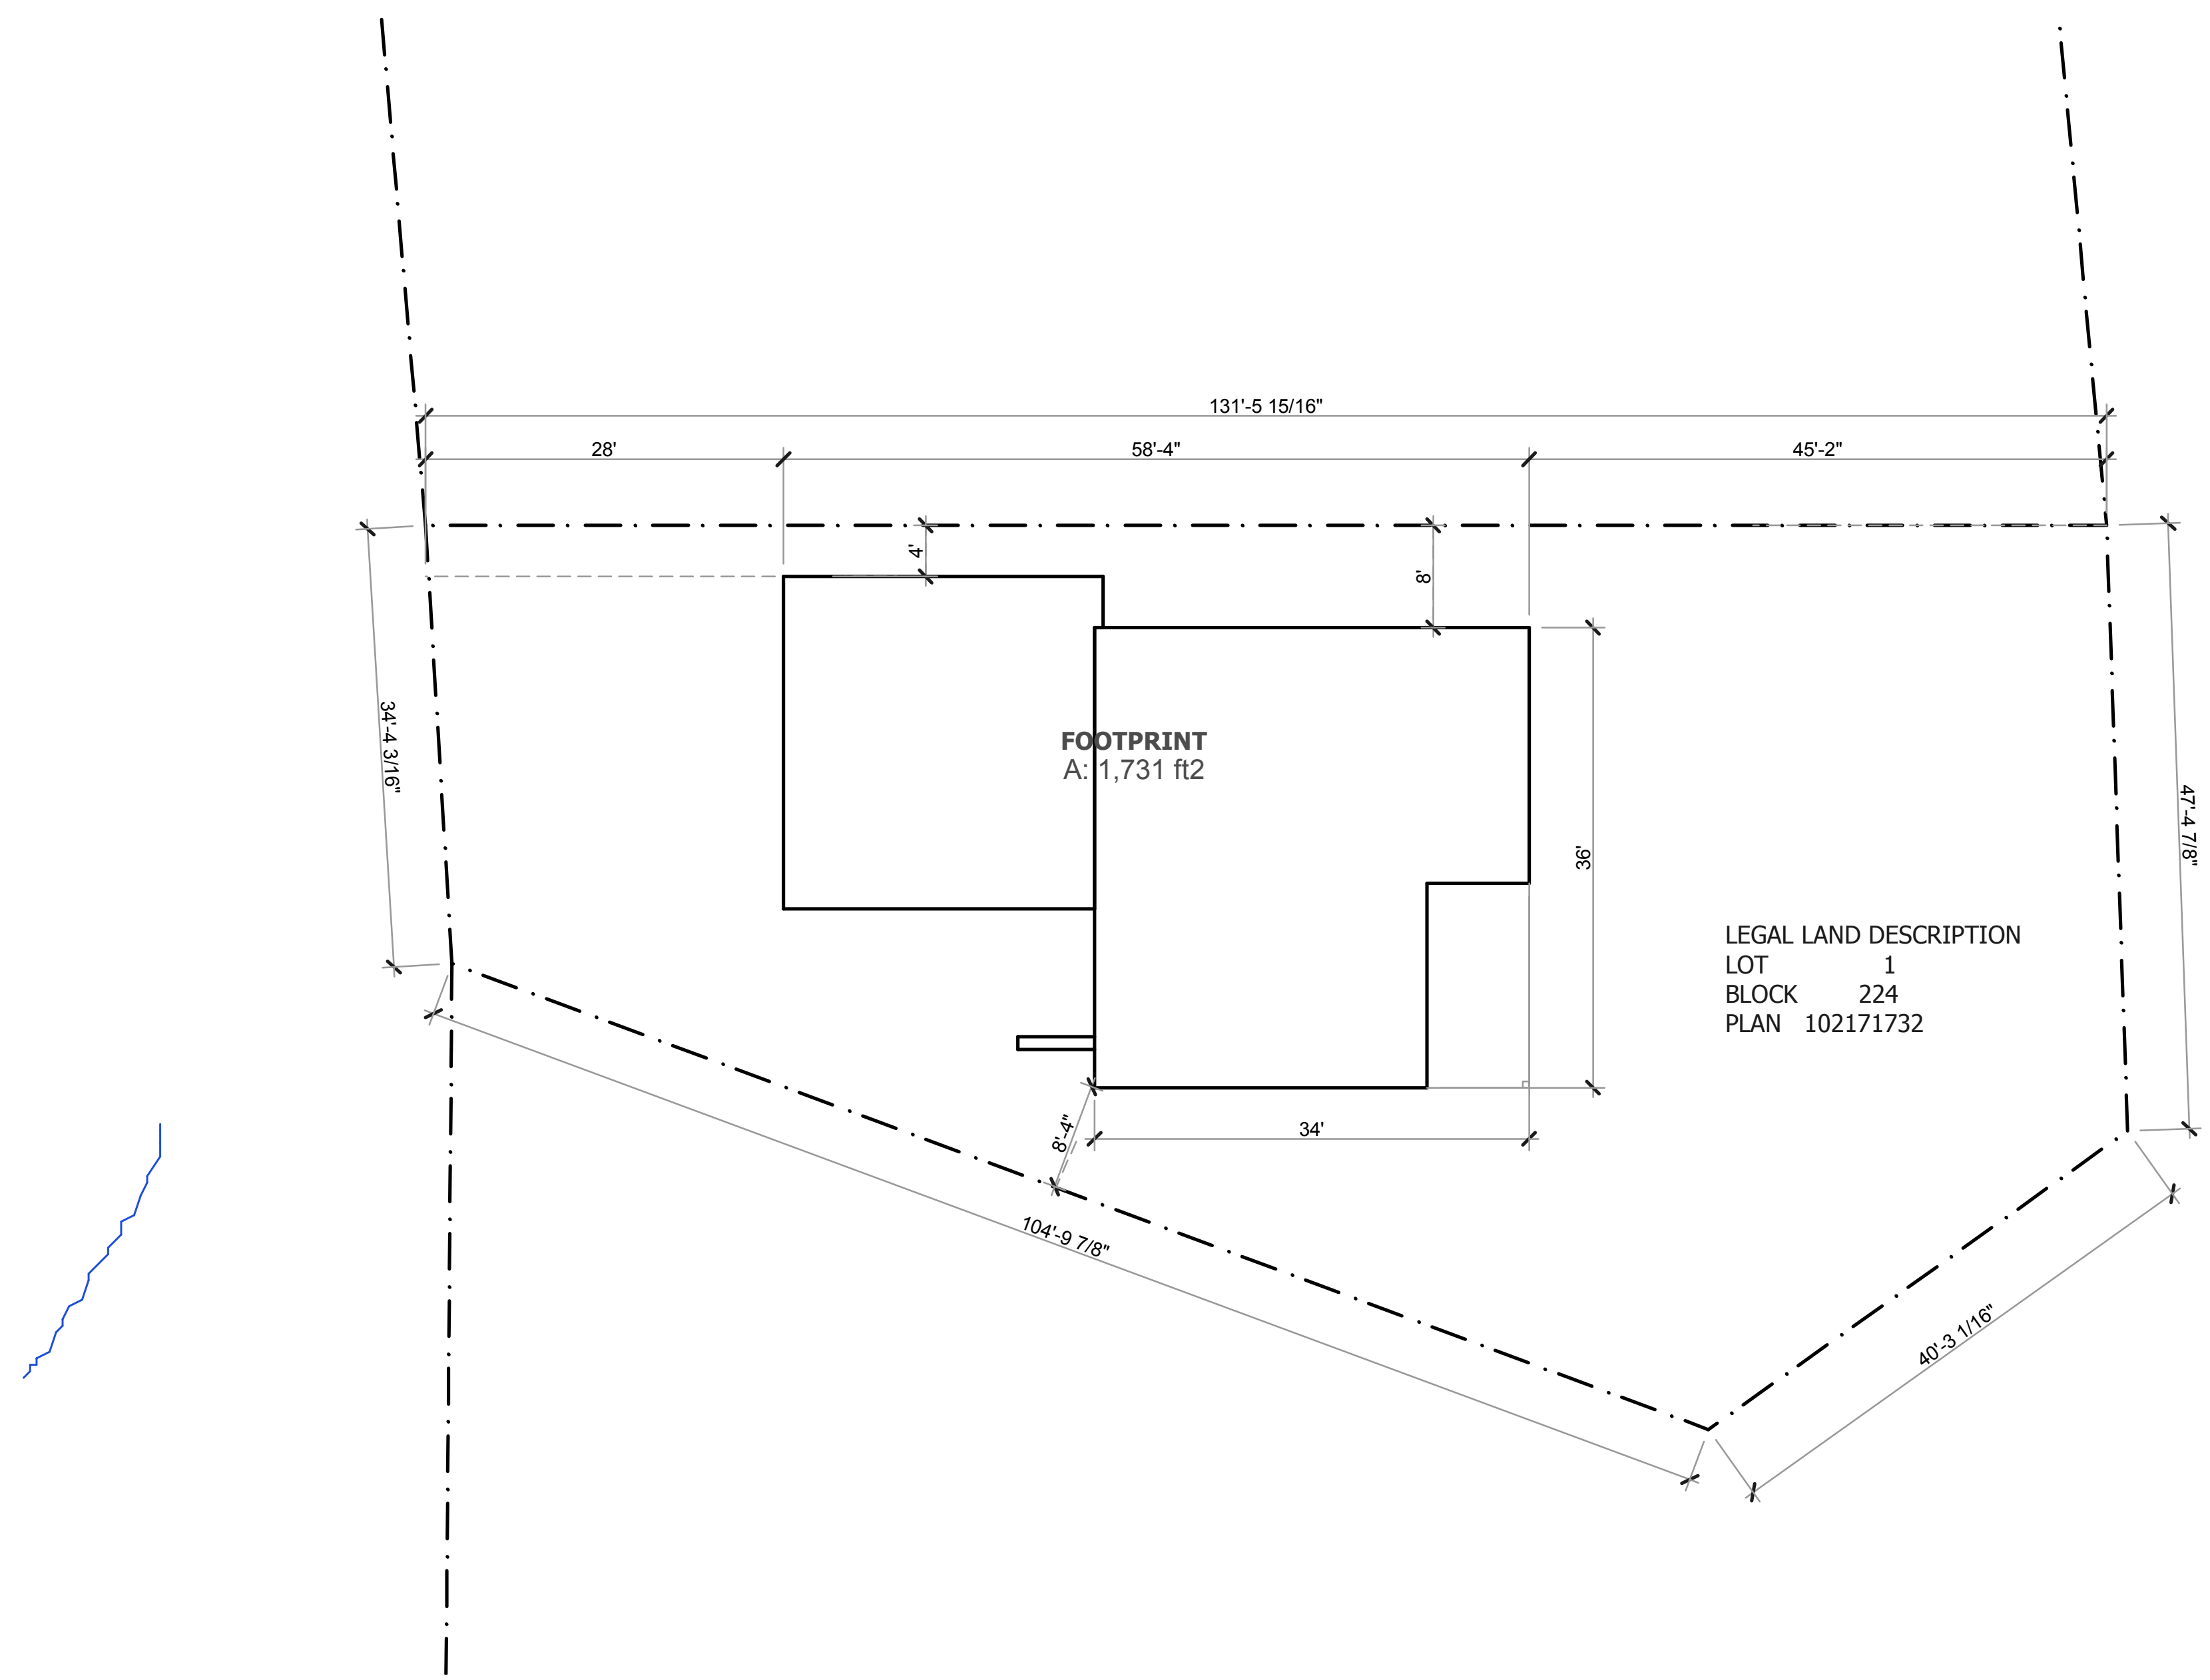

1 SITE PLAN

SCALE 1" = 20'-0"

N

SITE

NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK

BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

1

702 KENSINGTON.lbk

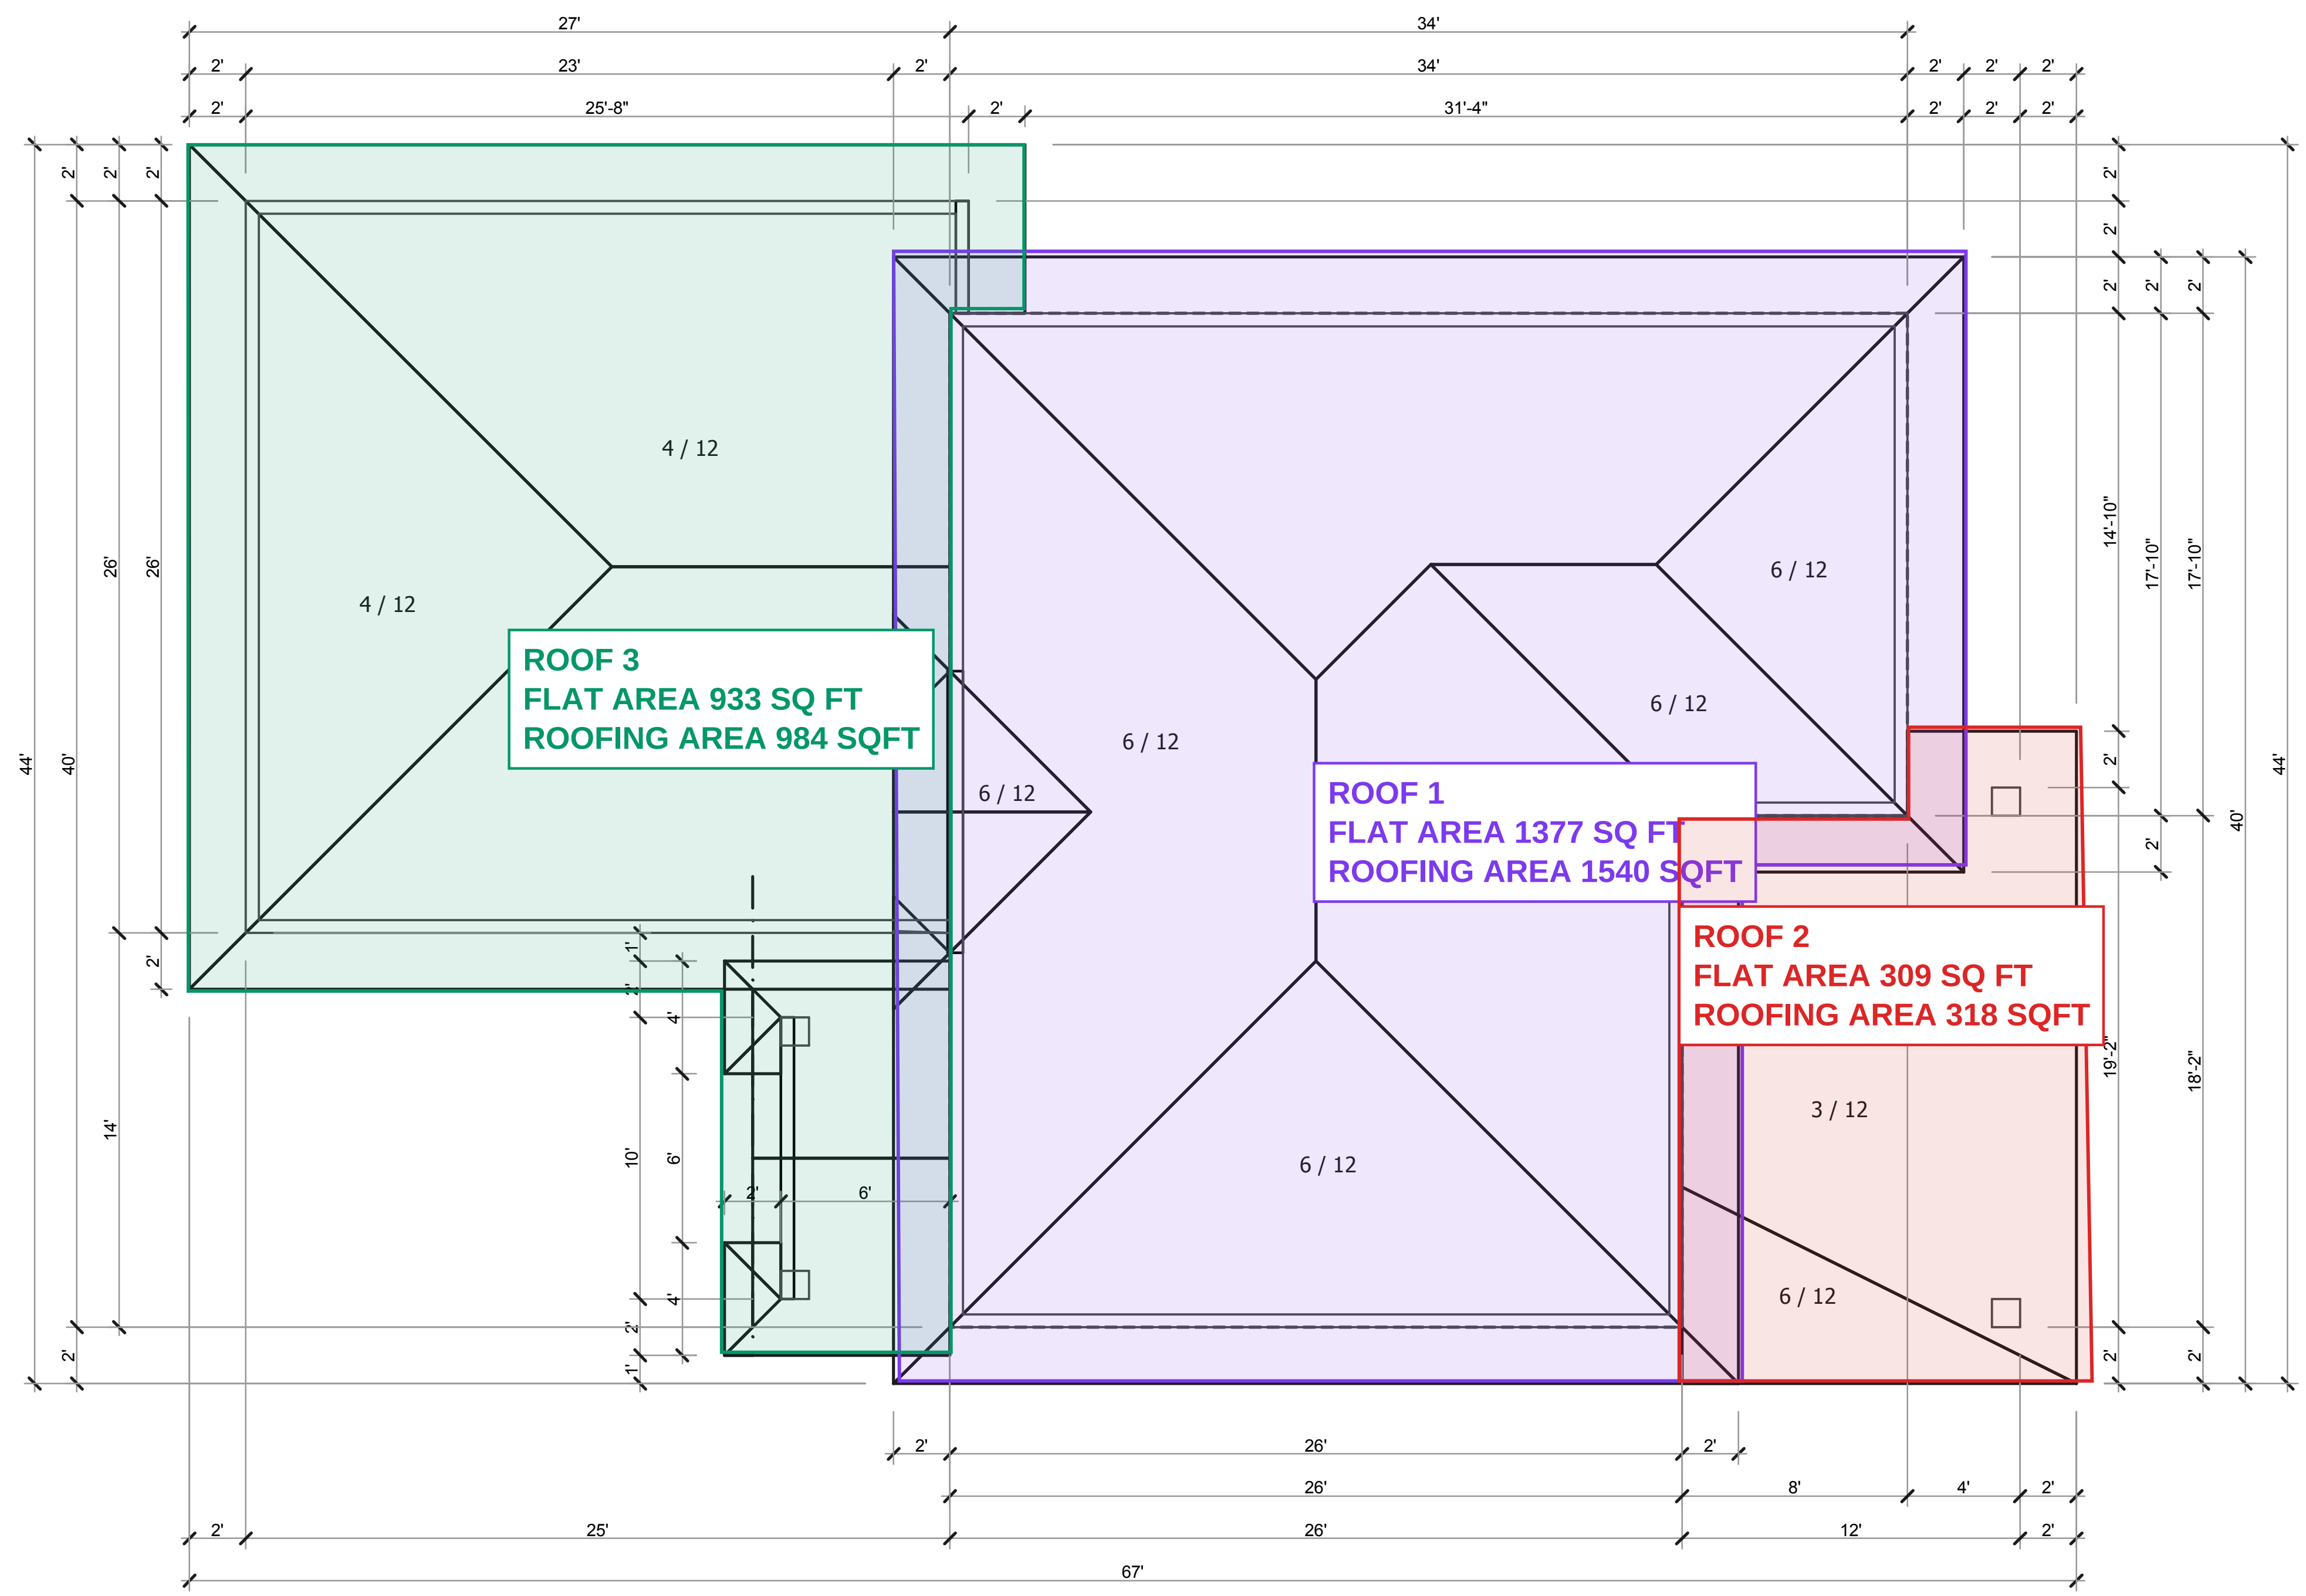

1 ROOF PLAN
SCALE 1/8" = 1'-0"

ROOF PLAN
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK
BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

WINDOW & DOOR ROUGH OPENINGS
VERIFY WINDOW AND DOOR ROUGH OPENINGS WITH CONFIRMED WINDOW AND DOOR ORDER PRIOR TO CONSTRUCTION.

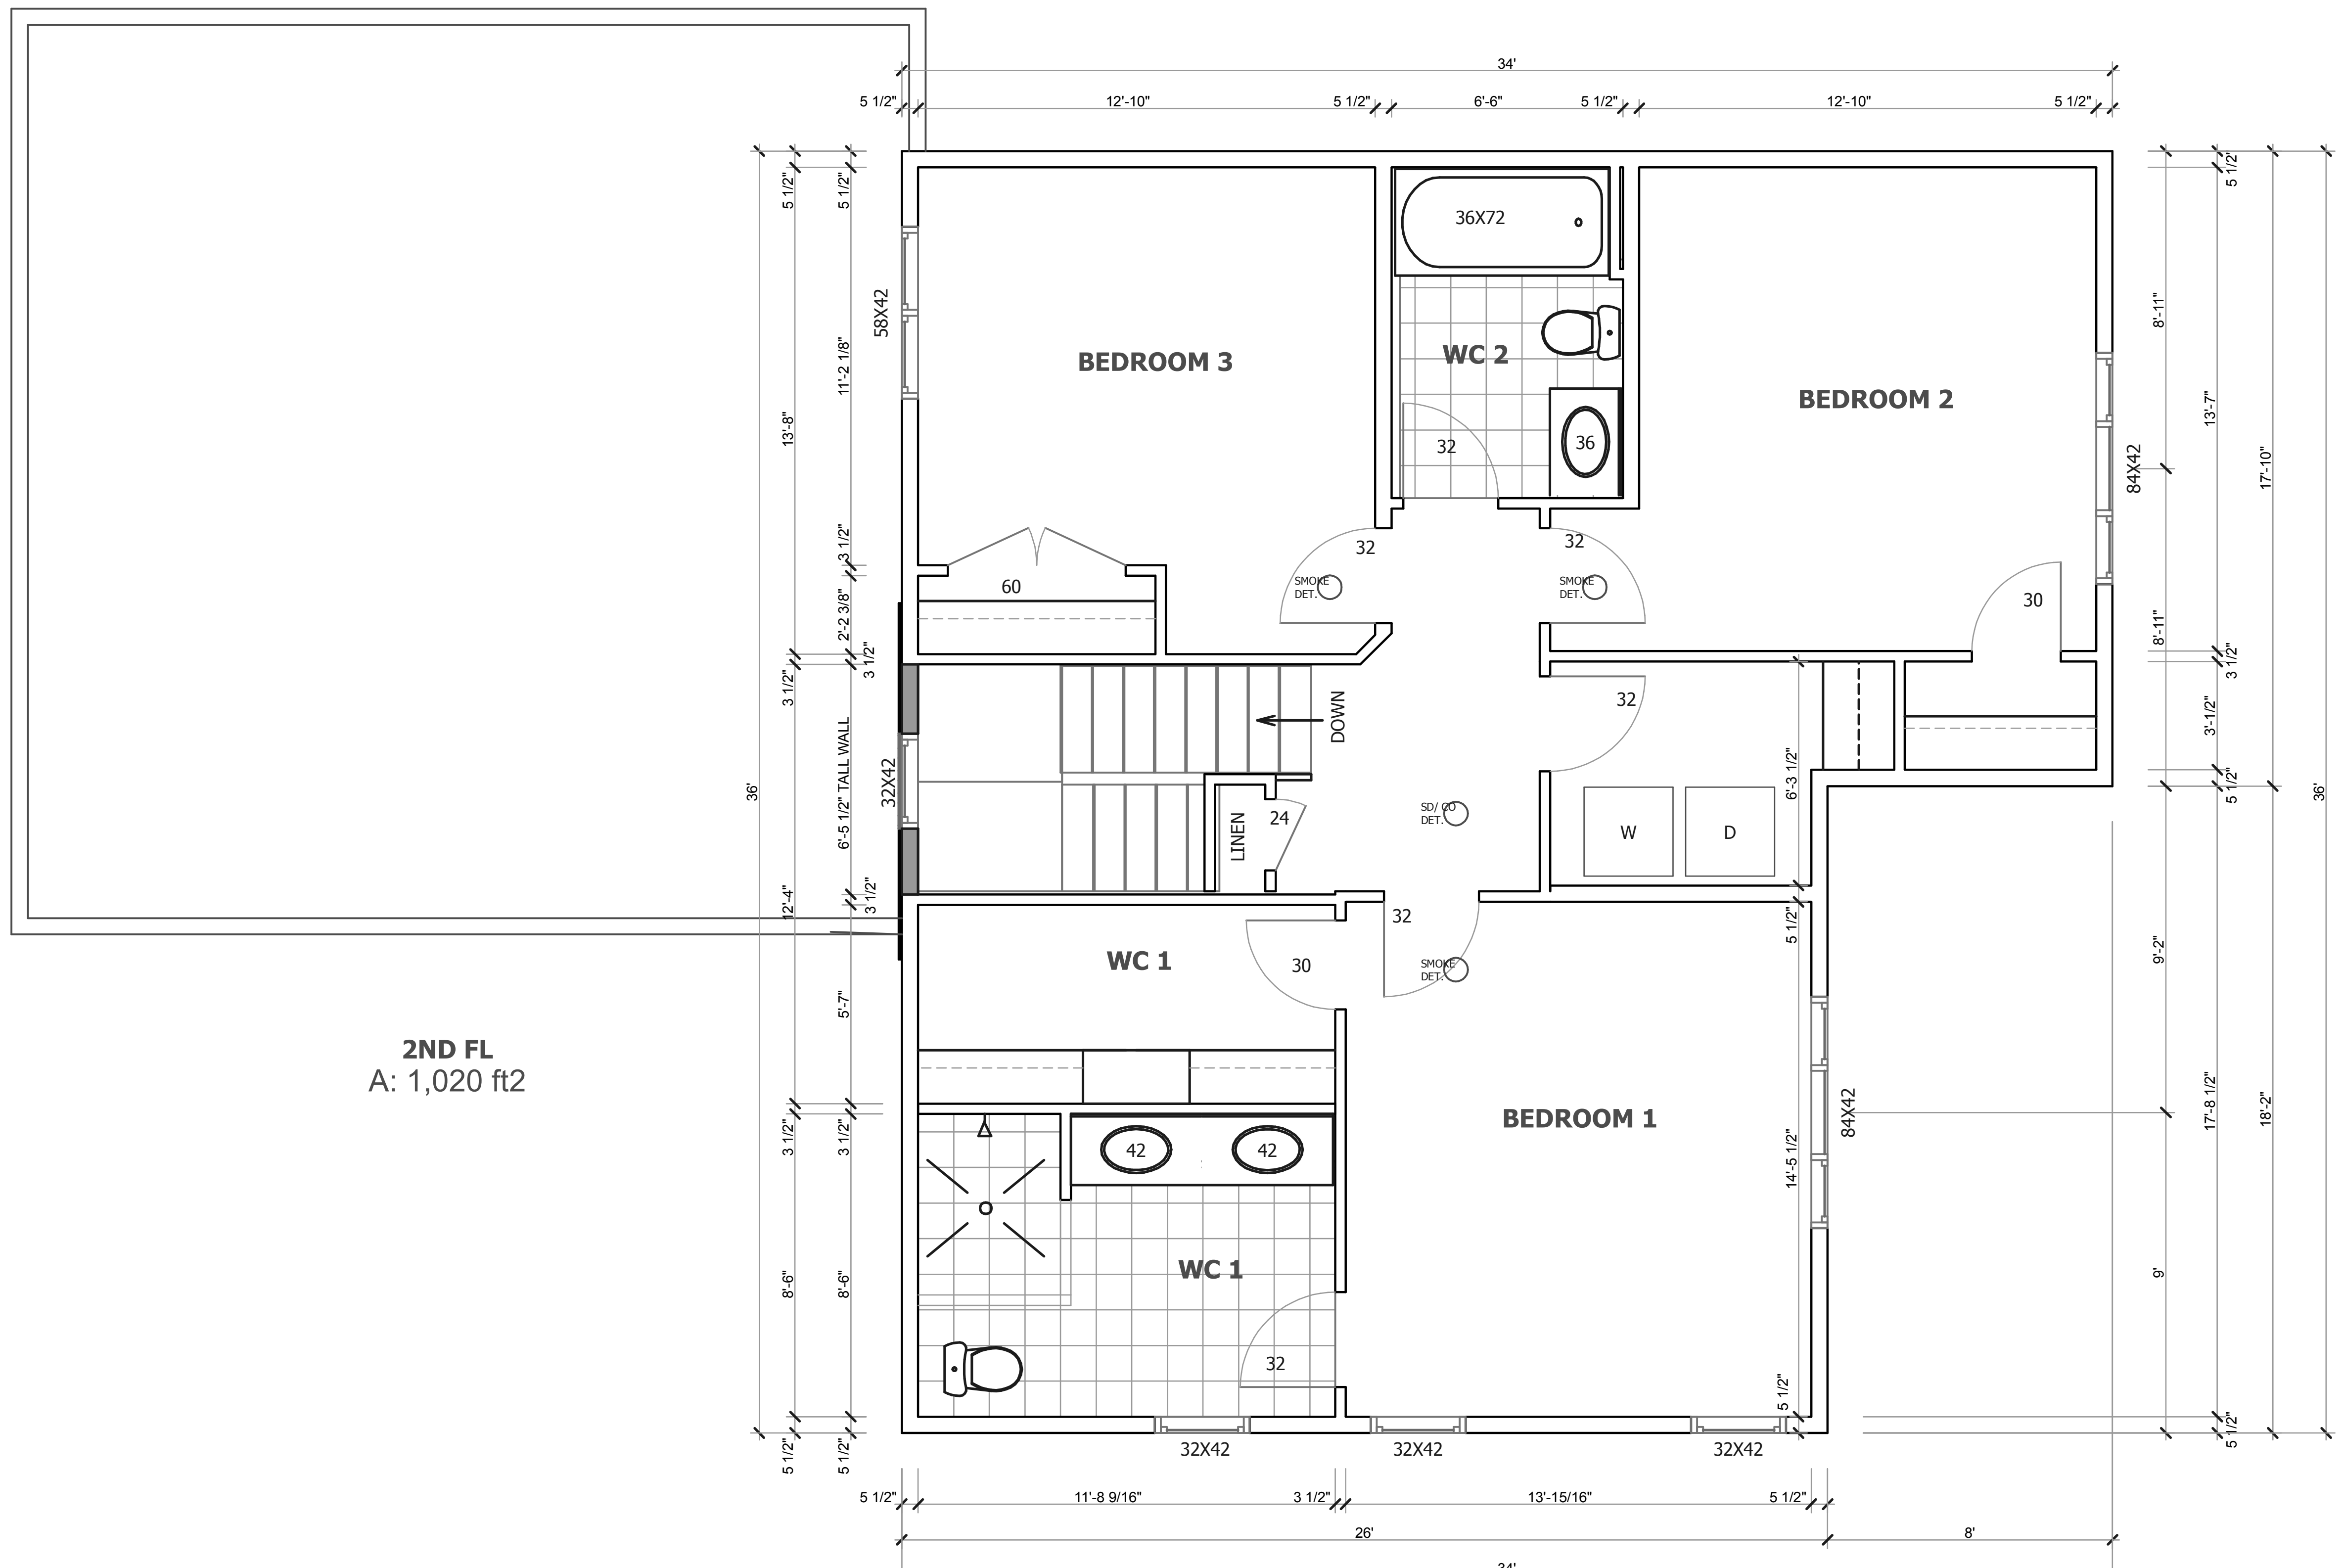

1 2ND FL PLAN
SCALE 3/16"= 1'-0"

2ND FL PLAN
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK
BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty.ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

3

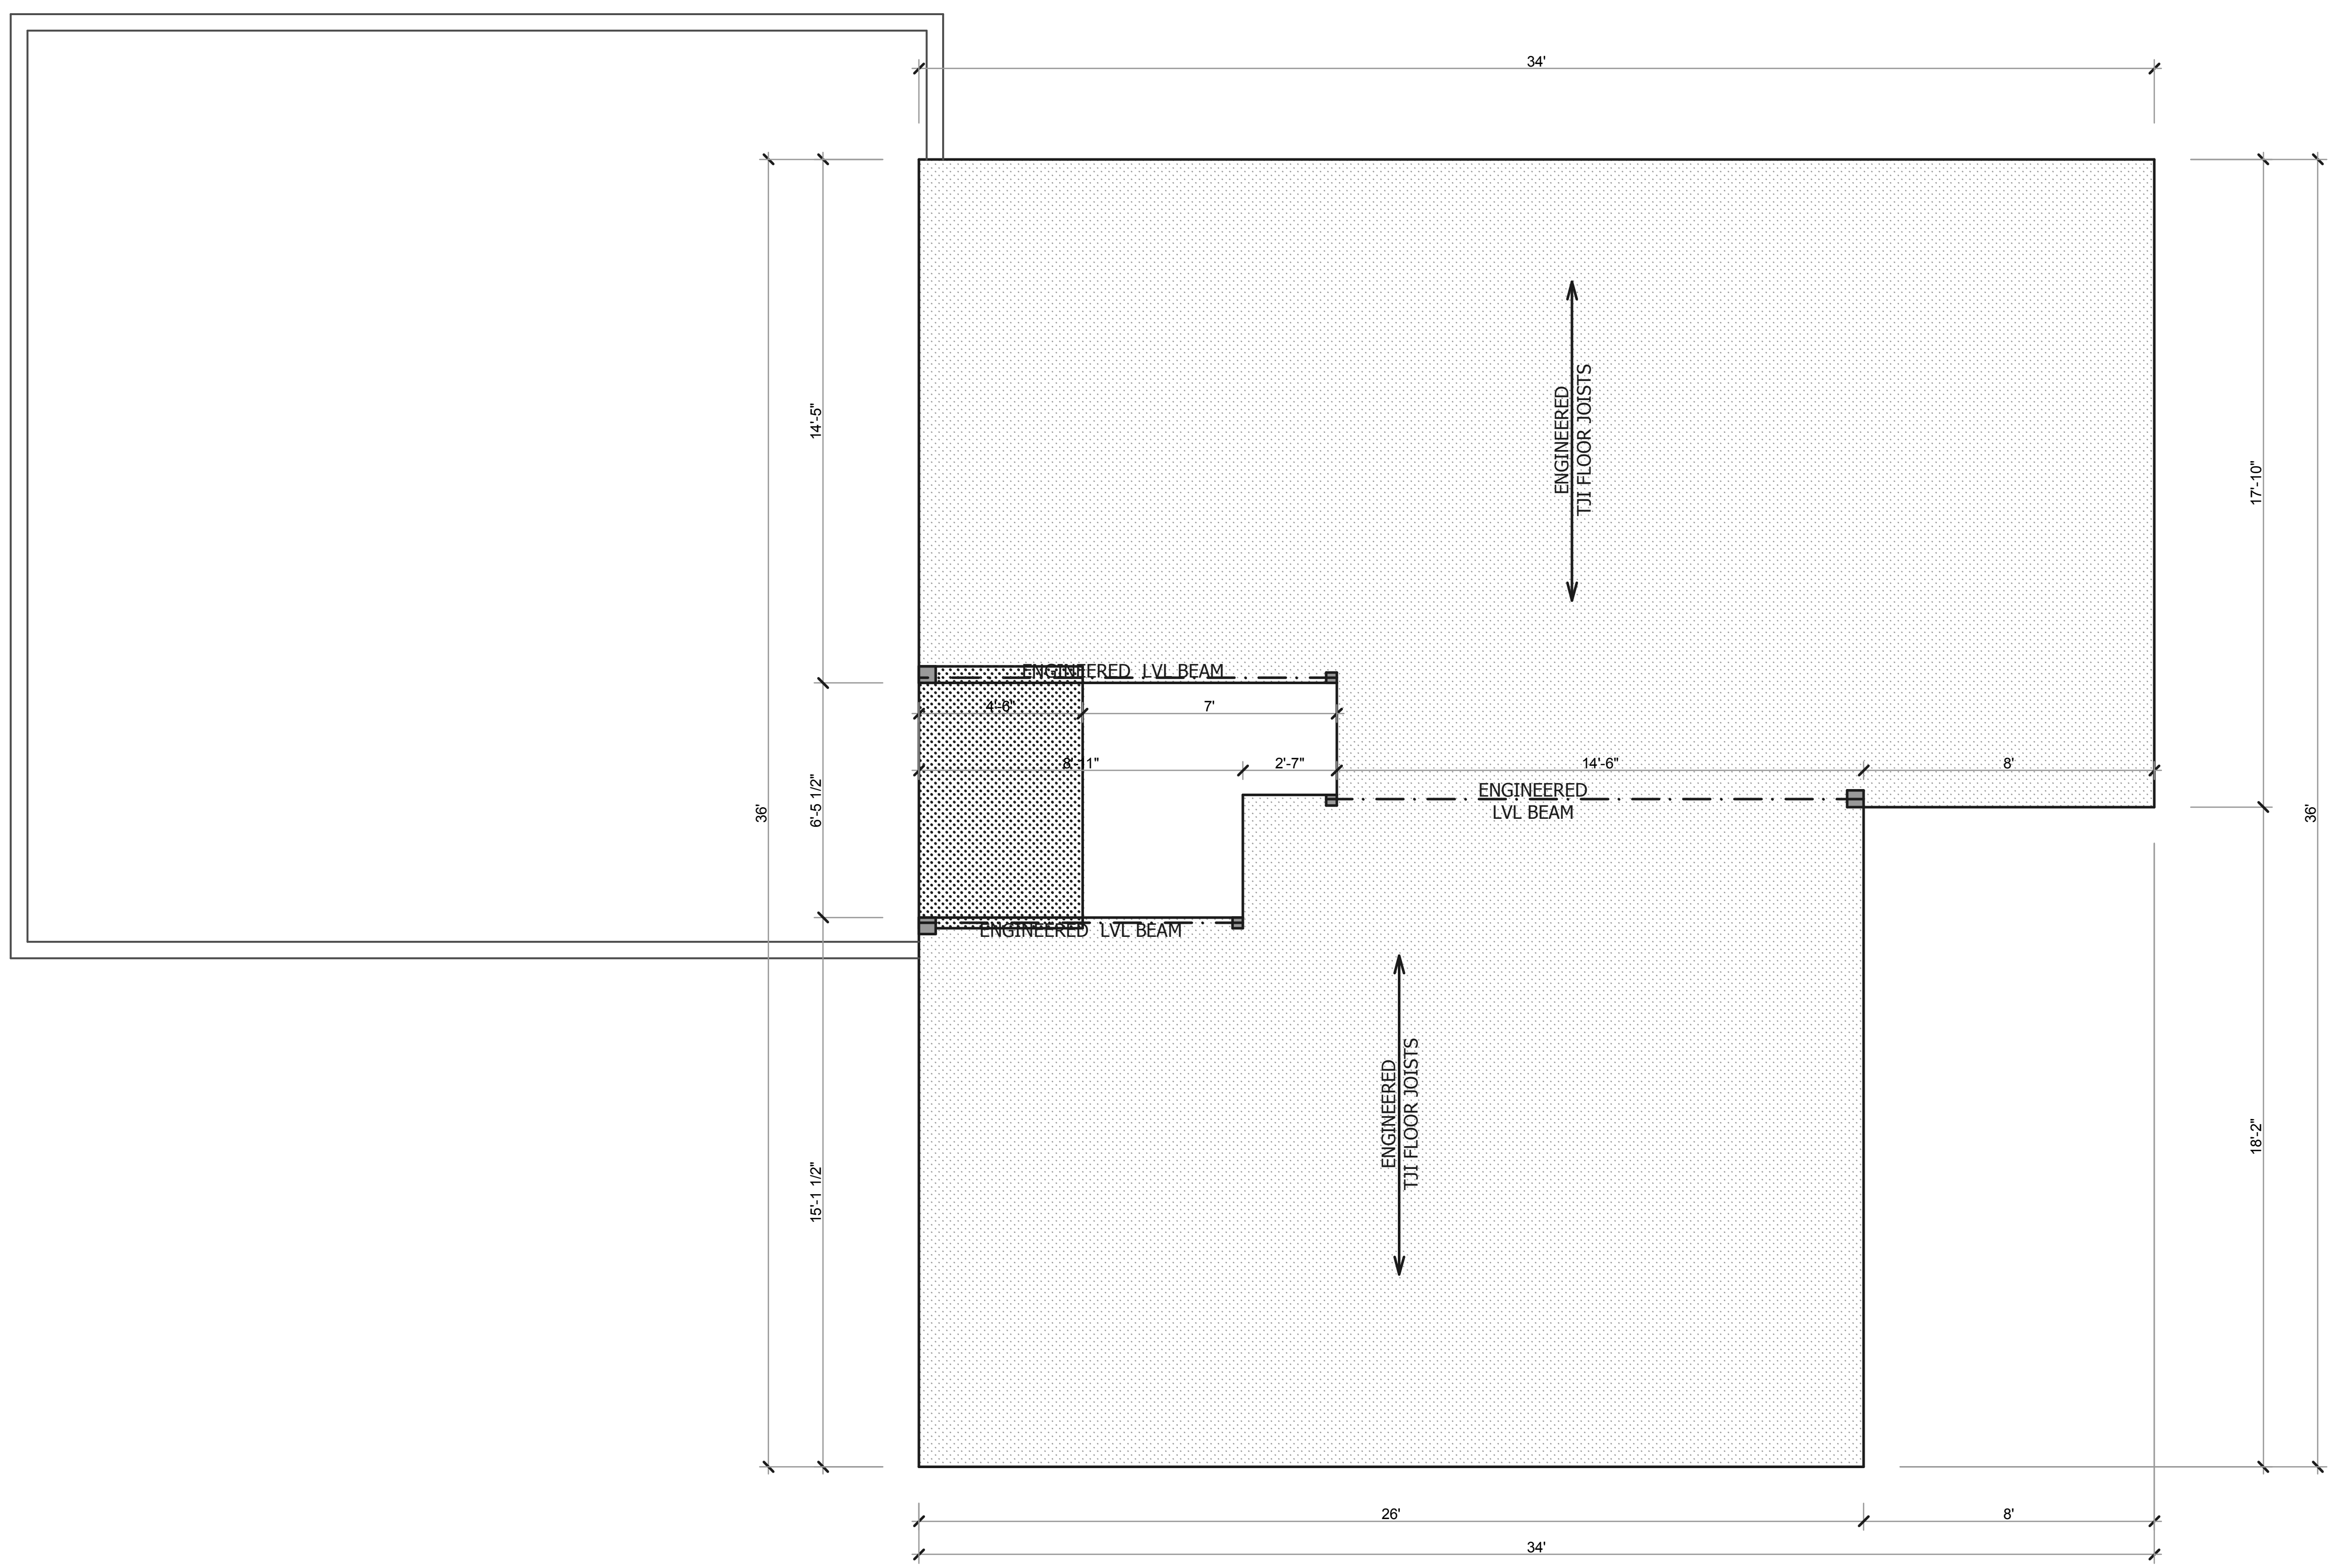

1 2ND FLOOR

SCALE 3/16"= 1'-0"

2ND FL LAYOUT
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK

BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty.ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

WINDOW & DOOR ROUGH OPENINGS
VERIFY WINDOW AND DOOR ROUGH OPENINGS WITH CONFIRMED WINDOW AND DOOR ORDER PRIOR TO CONSTRUCTION.

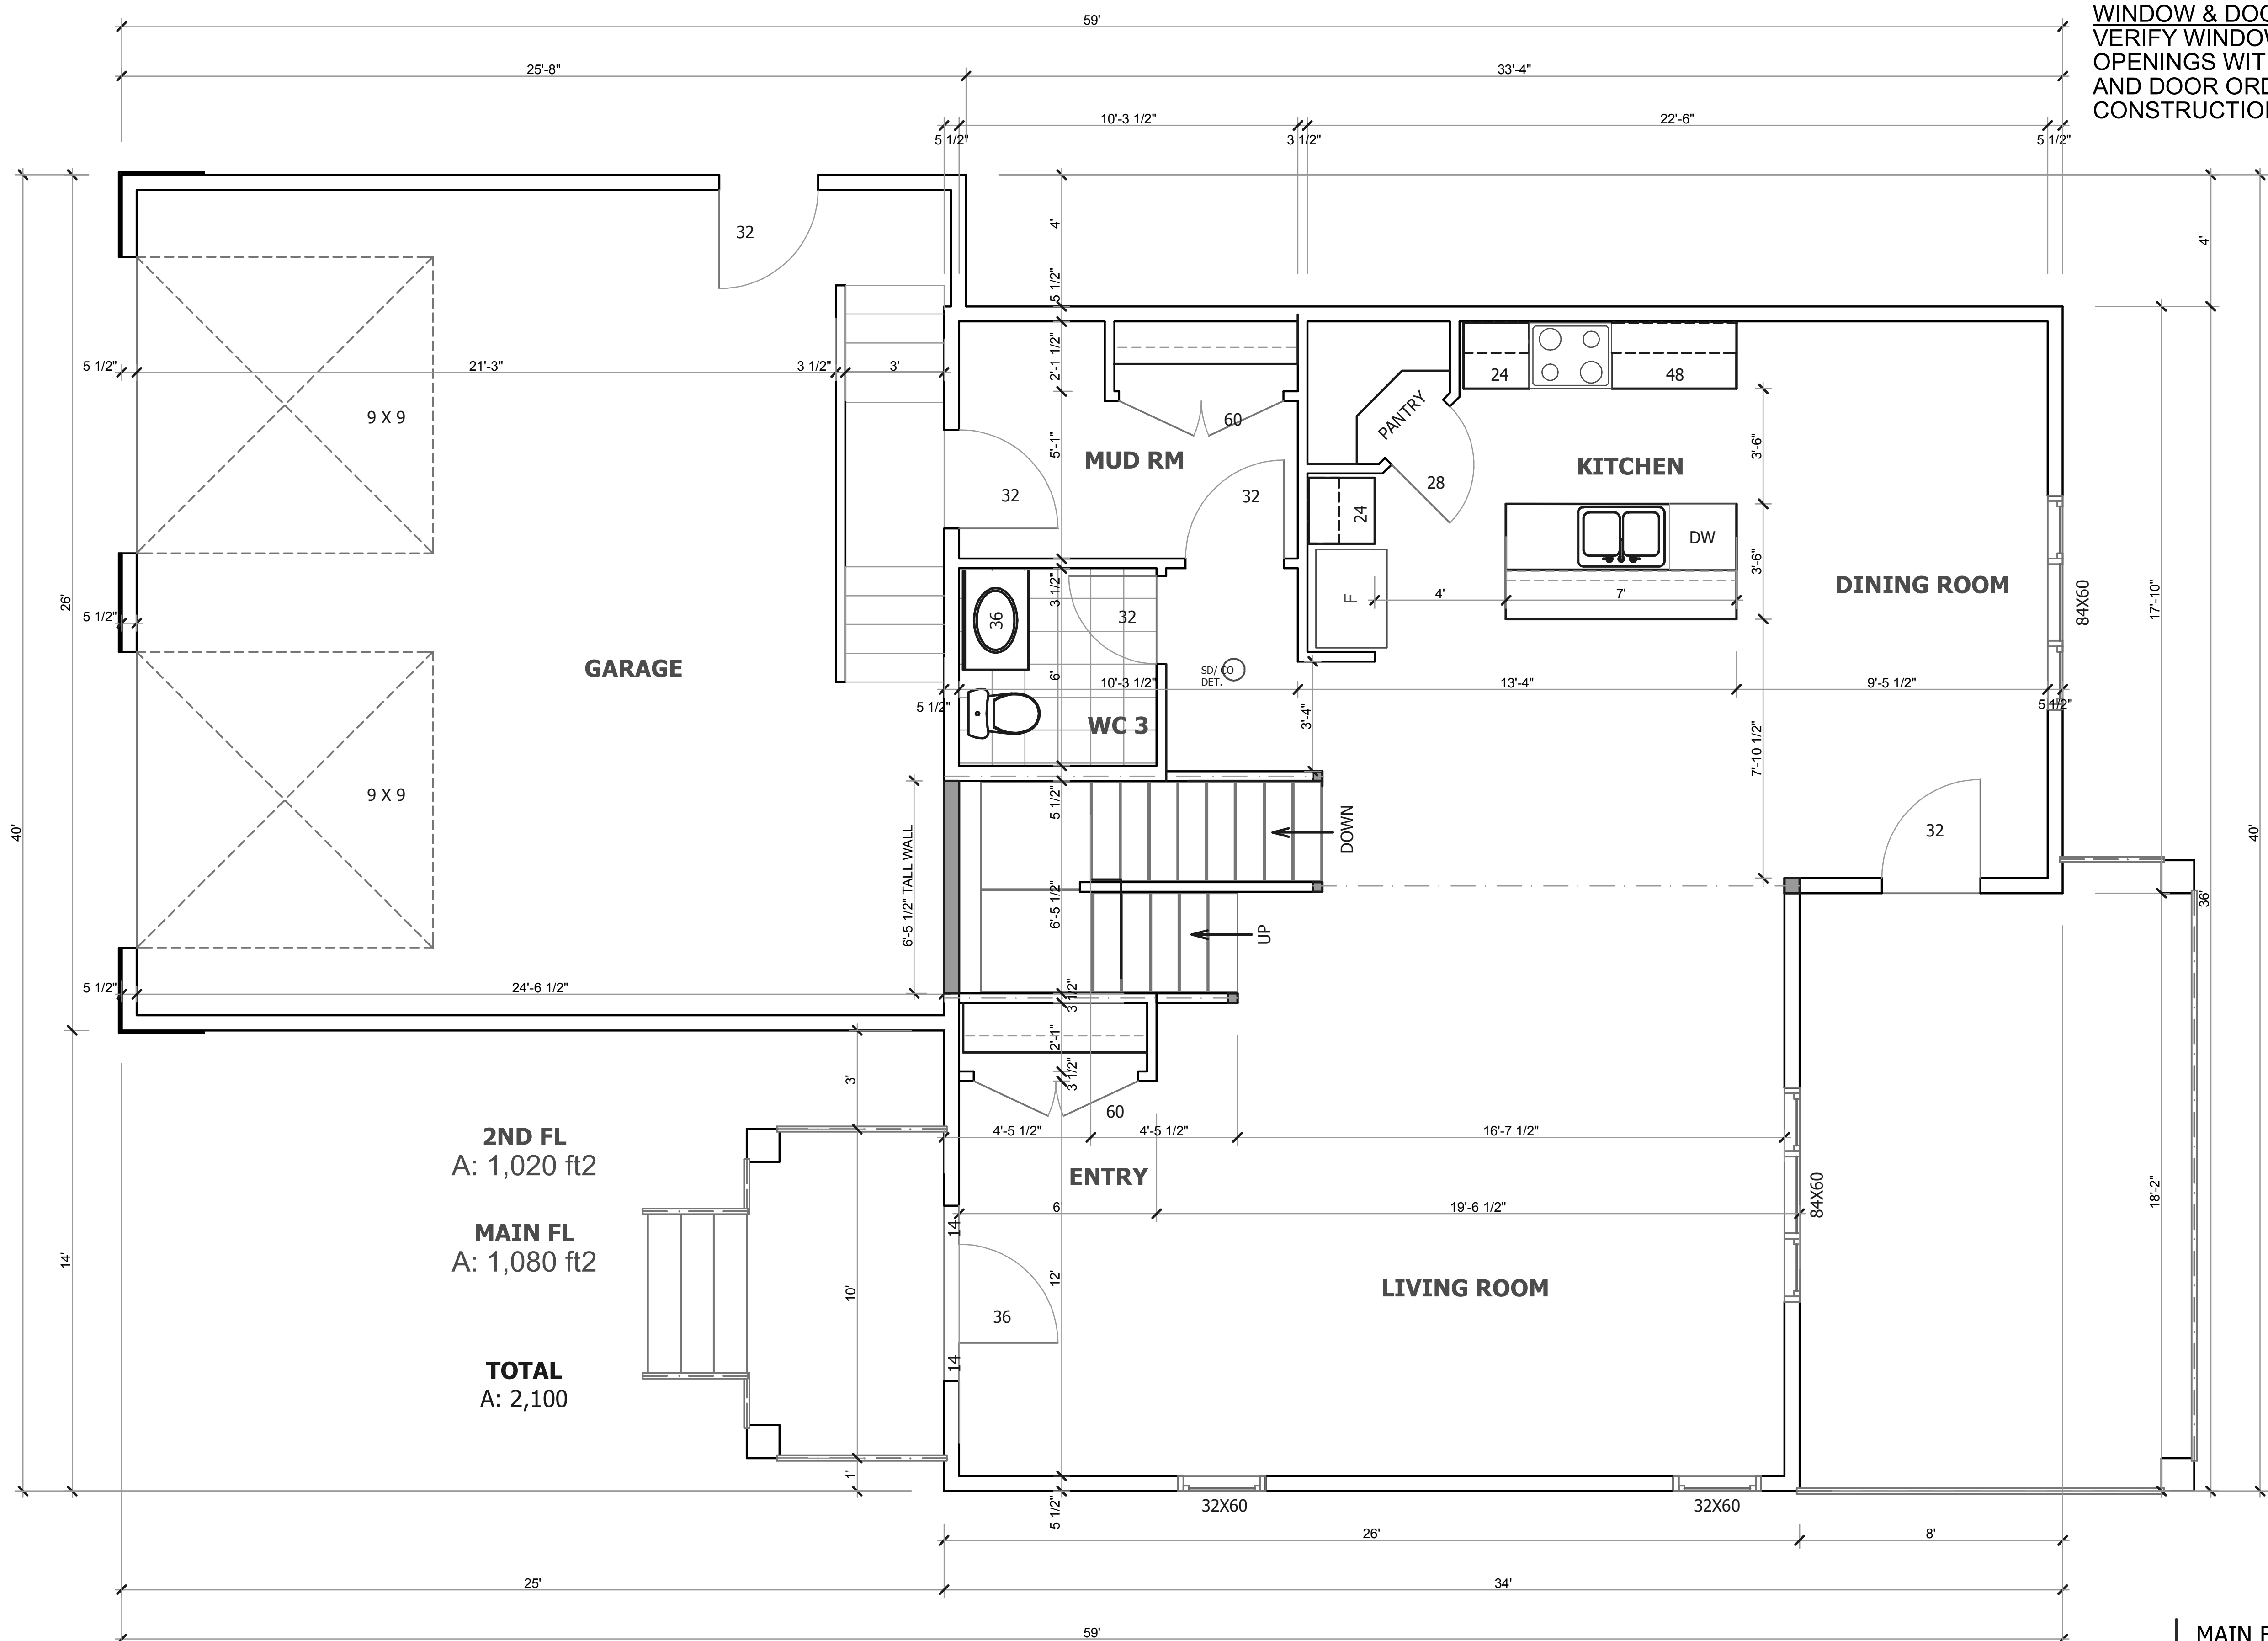

1 MAIN FL PLAN
SCALE 3/16"= 1'-0"

MAIN FL PLAN
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK
BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

702 KENSINGTON.skp

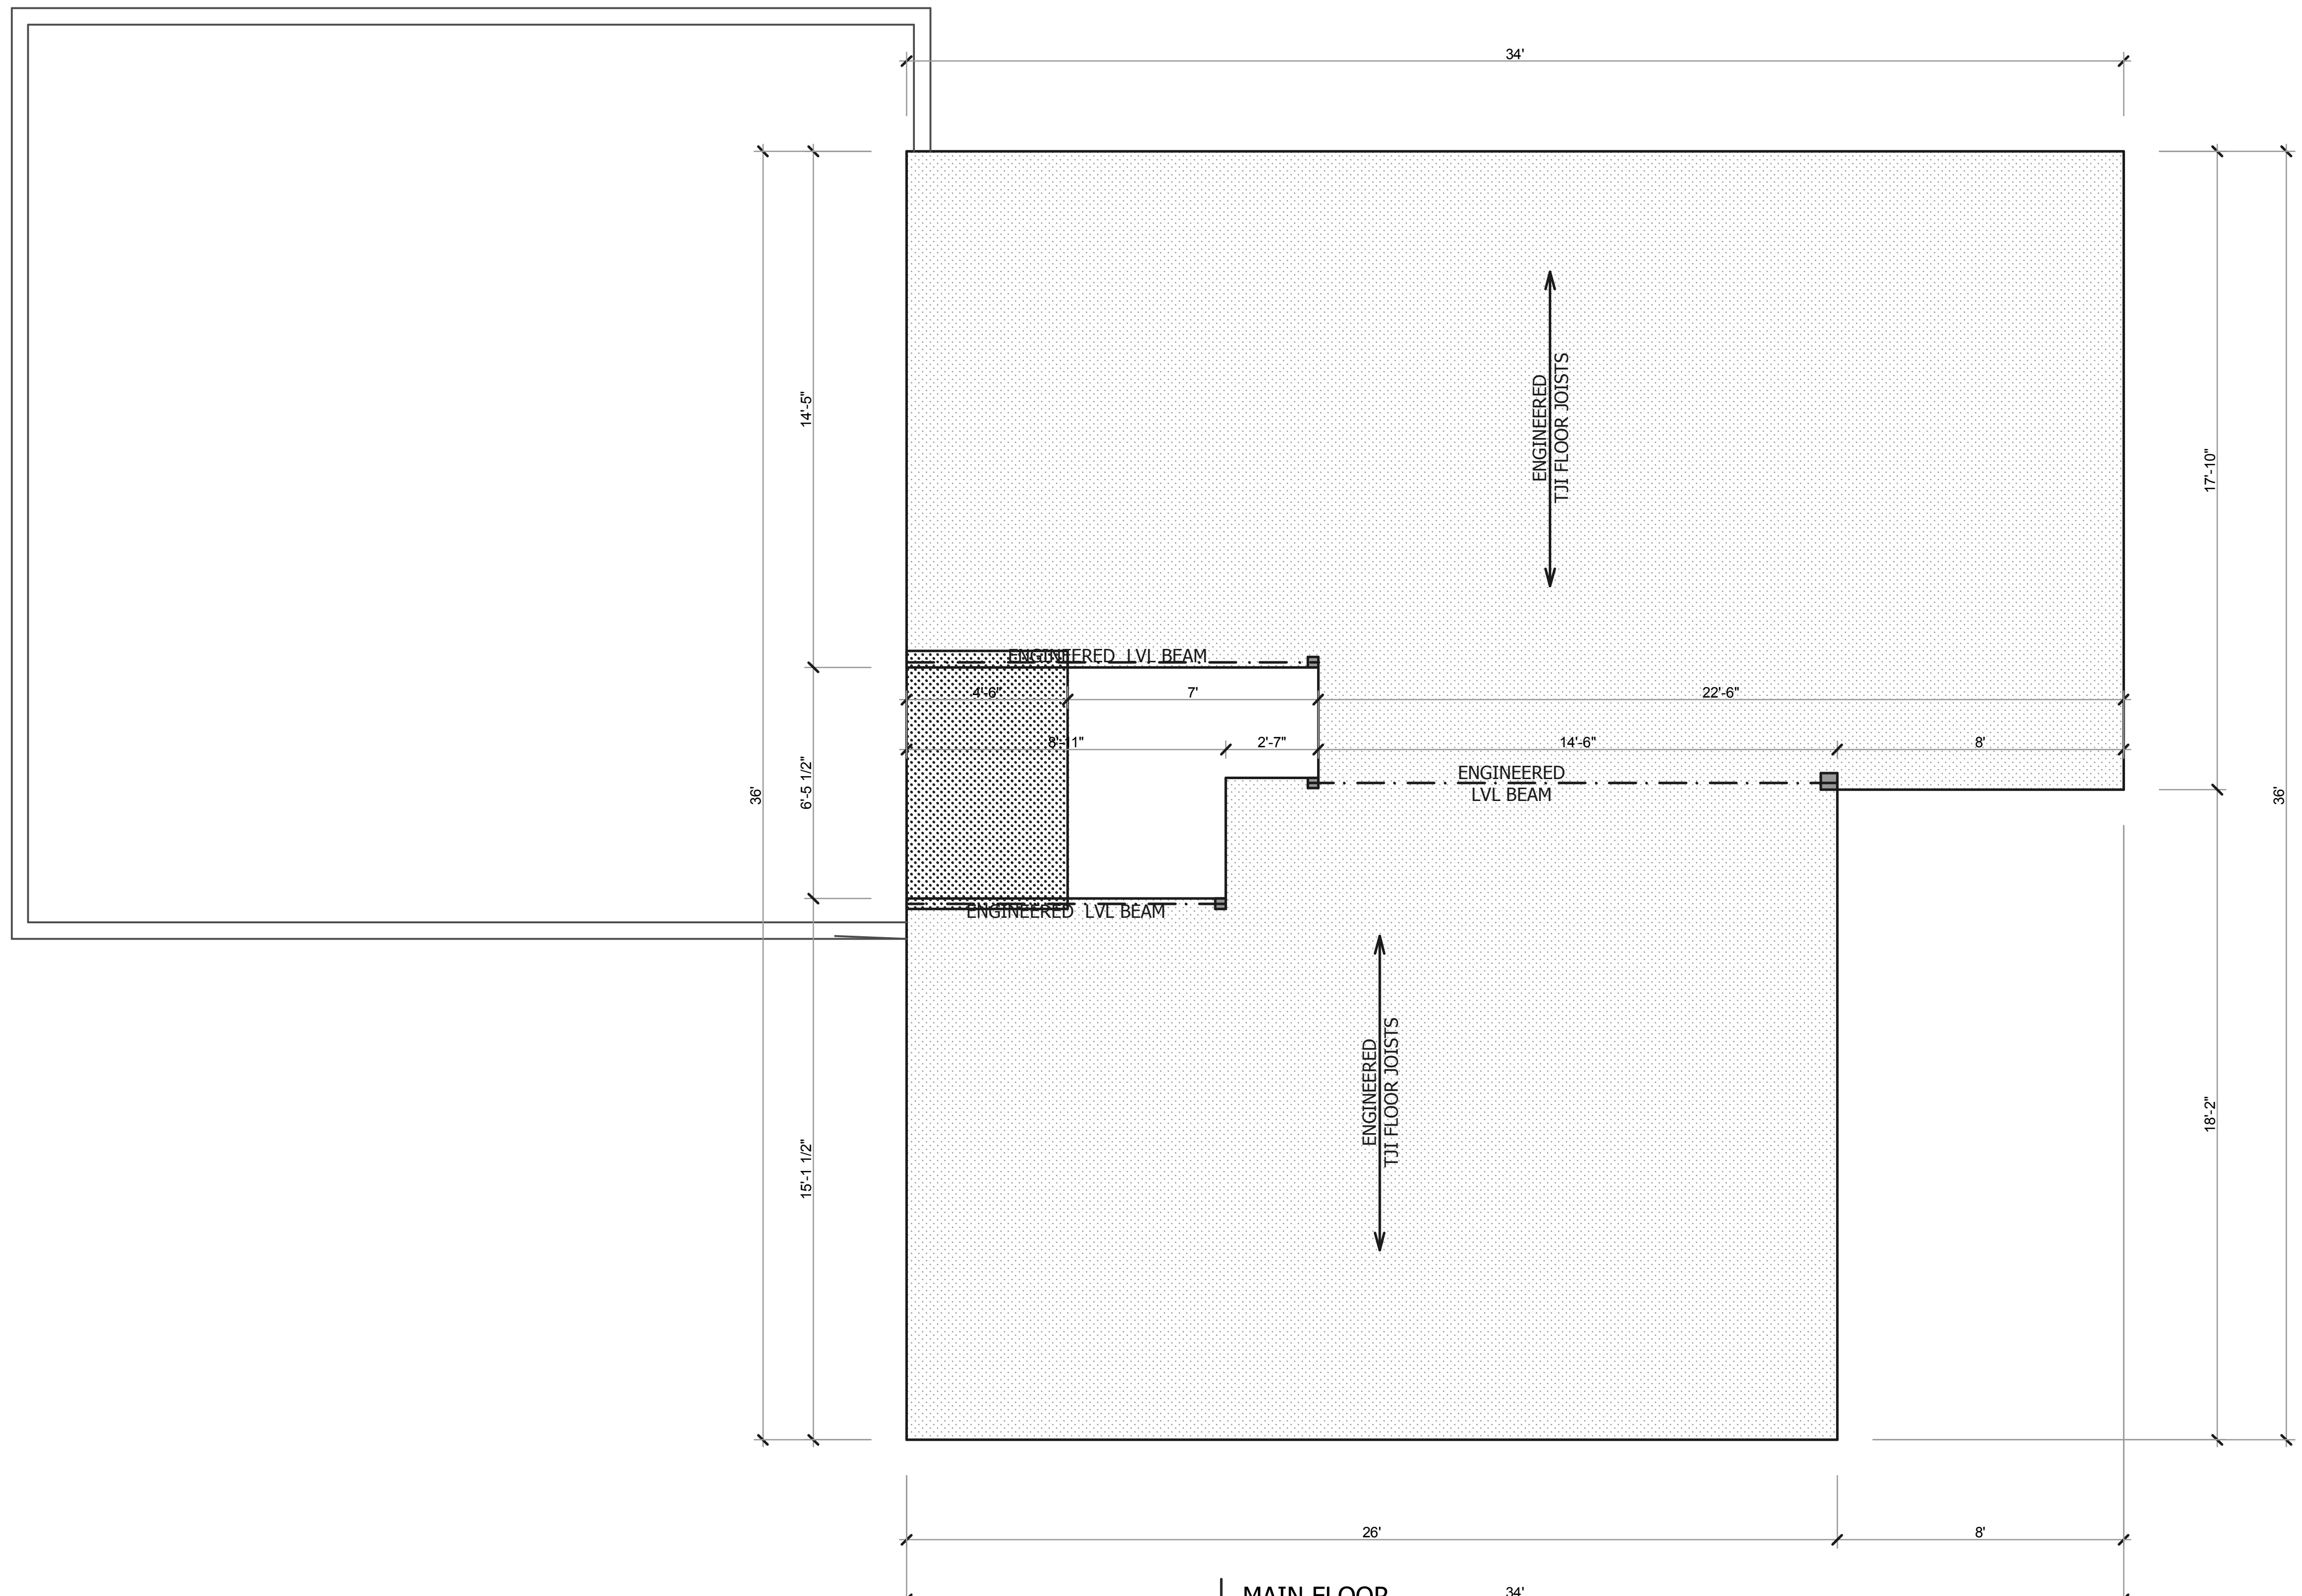

1 MAIN FLOOR

SCALE 3/16"= 1'-0"

MAIN FL LAYOUT
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK

BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

6

702 KENSINGTON.skp

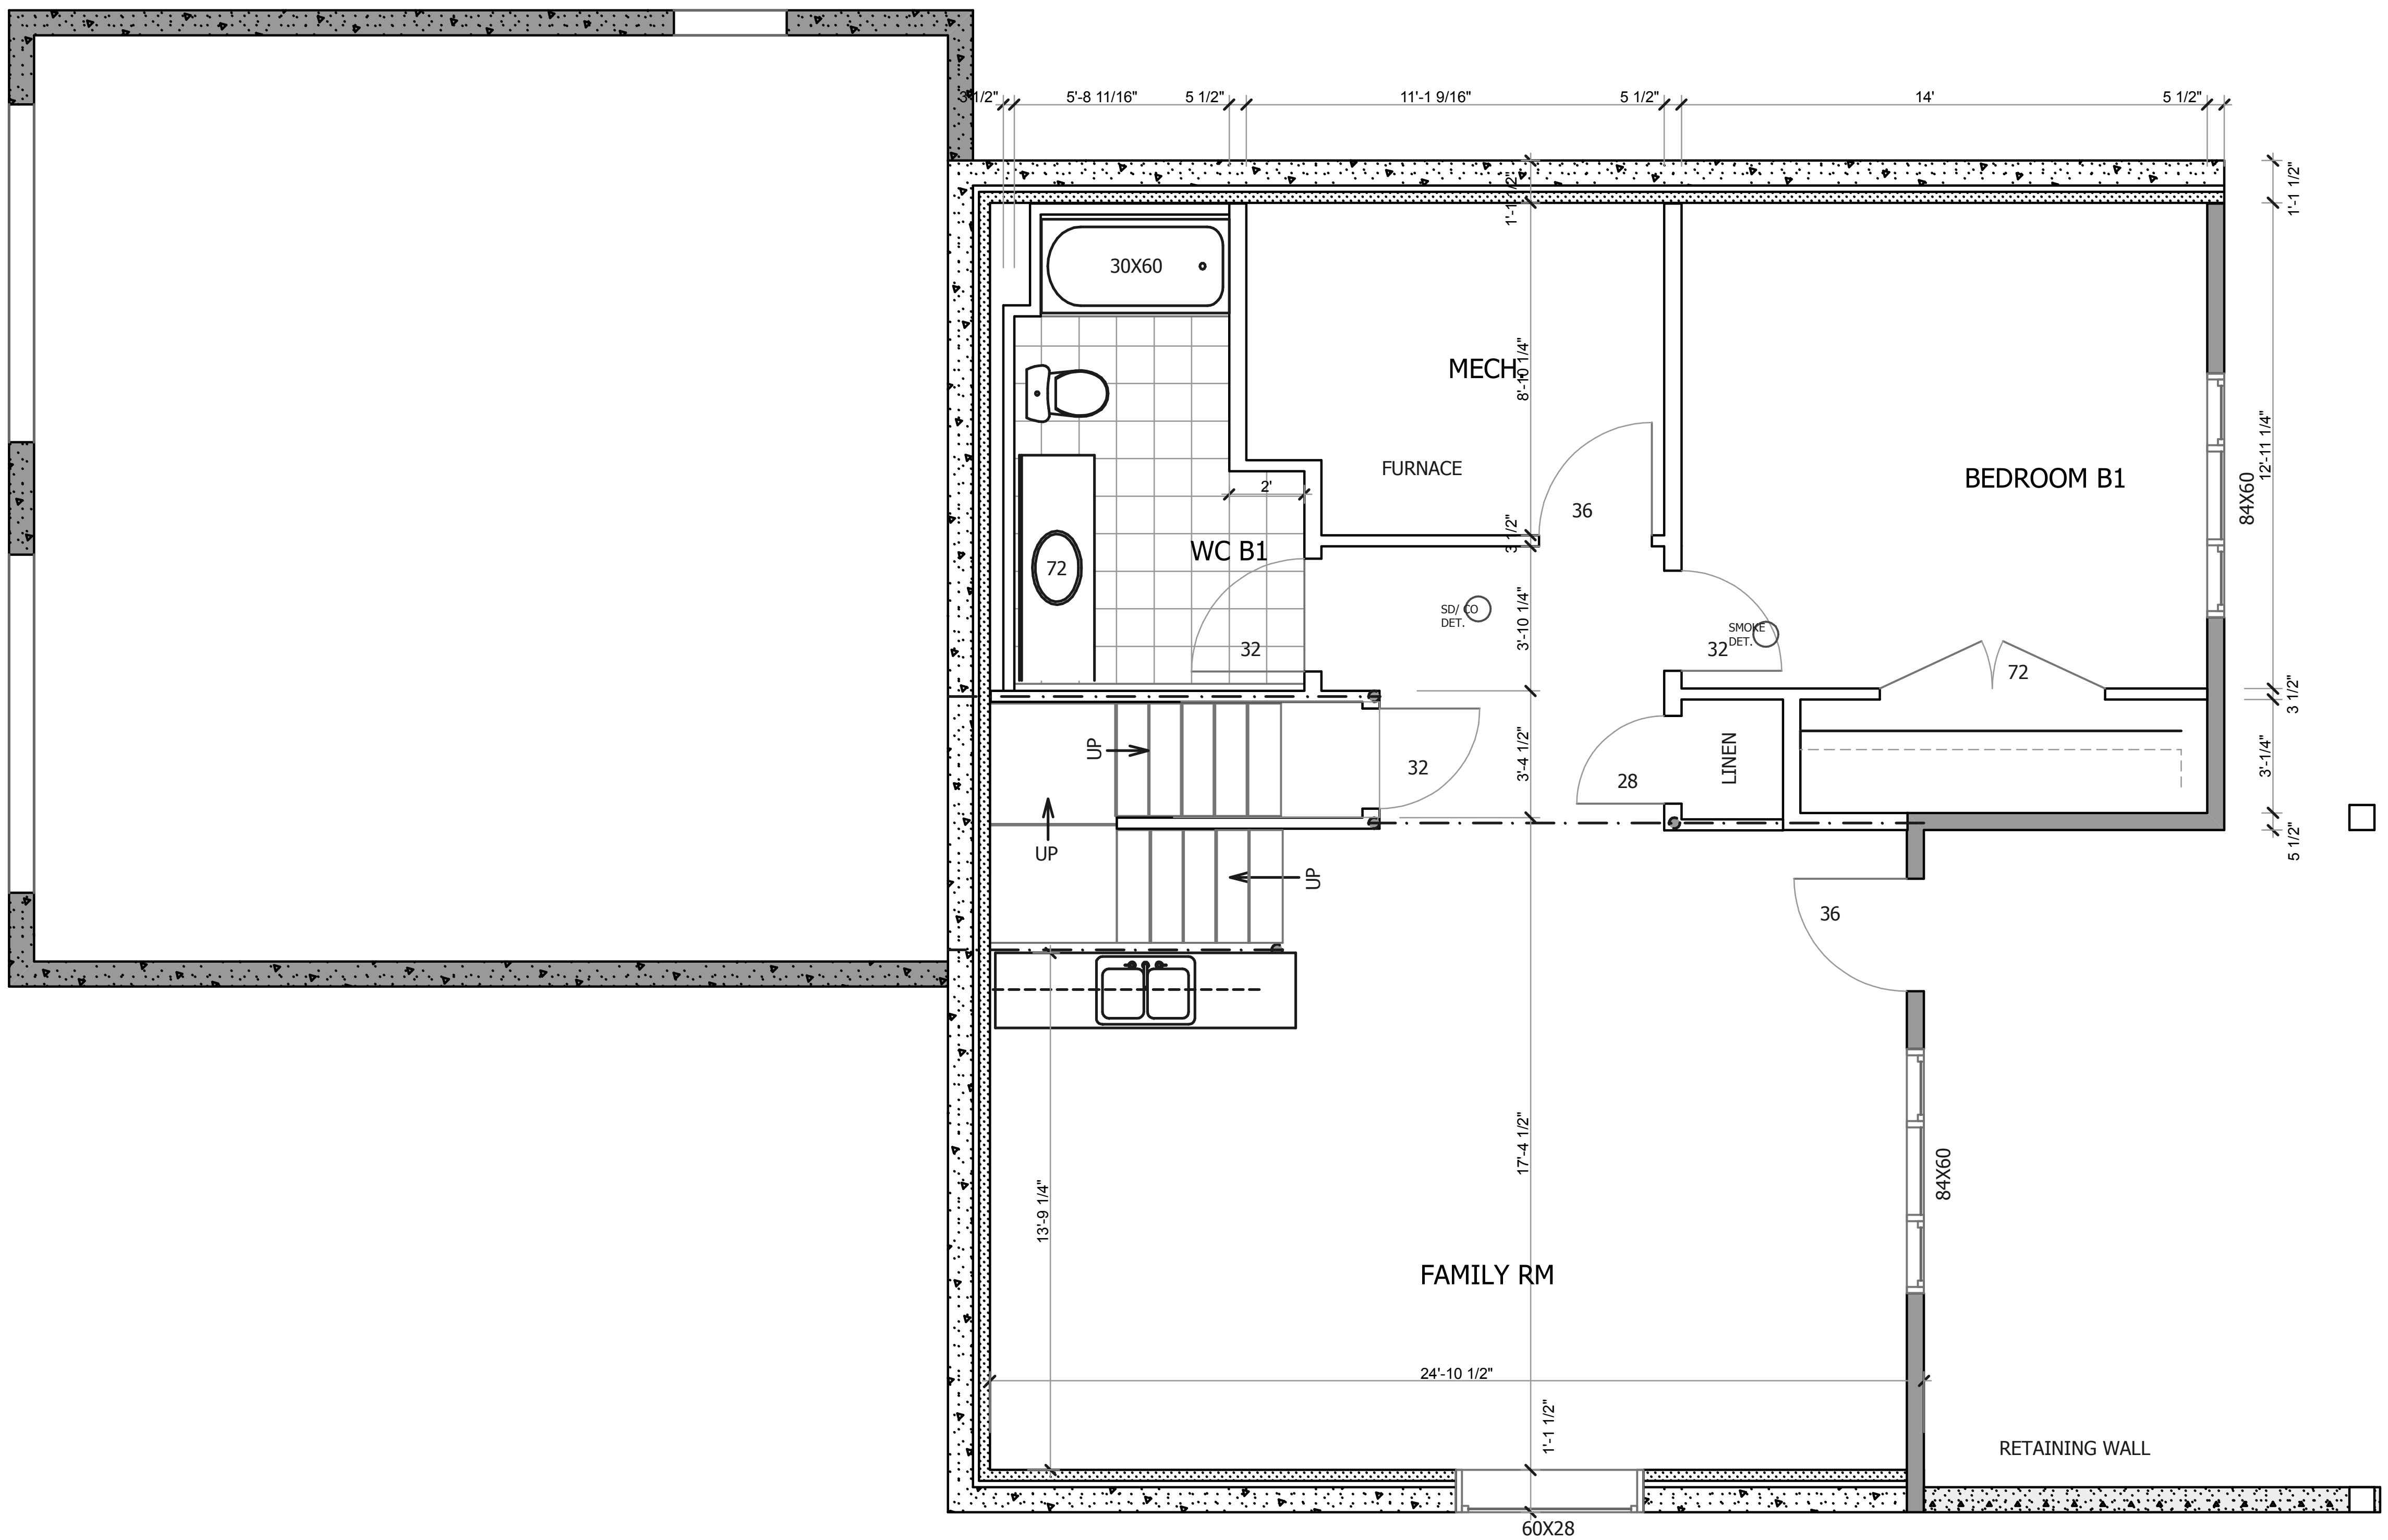

WINDOW & DOOR ROUGH OPENINGS
VERIFY WINDOW AND DOOR ROUGH OPENINGS WITH CONFIRMED WINDOW AND DOOR ORDER PRIOR TO CONSTRUCTION.

1 BASEMENT
SCALE 3/16"= 1'-0"

BASEMENT
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK
BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

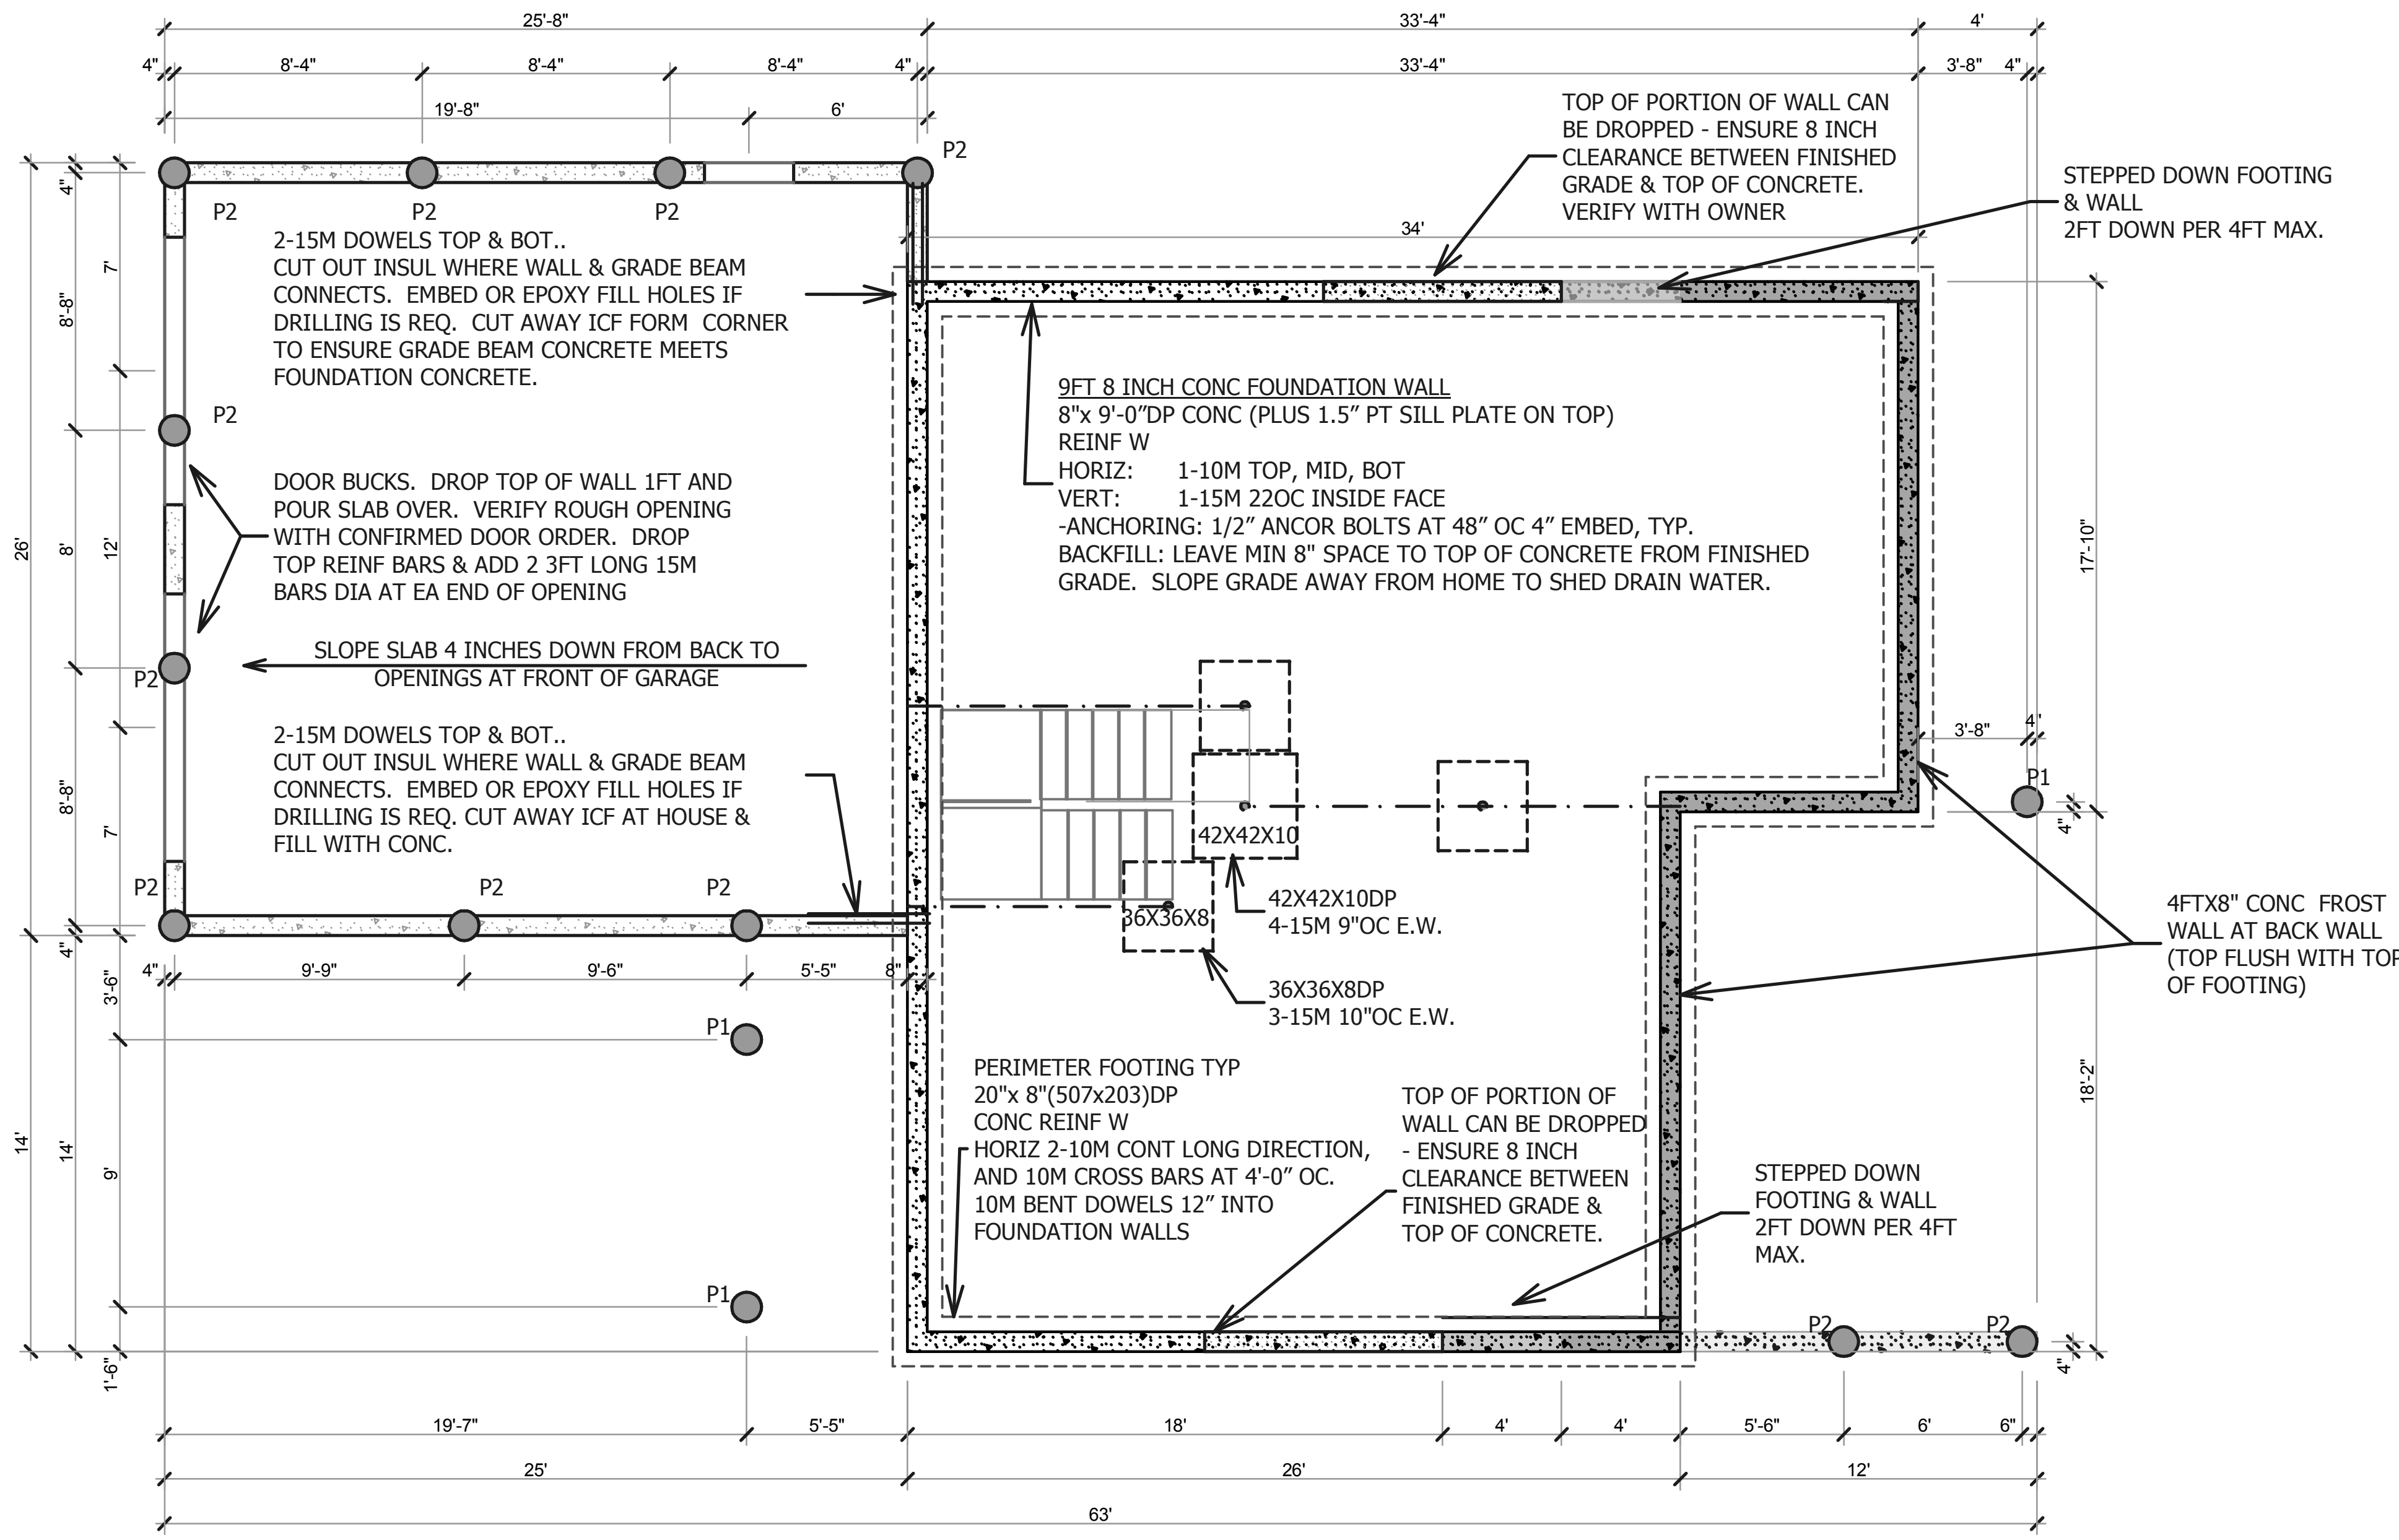

1 FOUNDATION
SCALE 1/8" = 1'-0"

FOUNDATION
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK

BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

702 KENSINGTON.skp

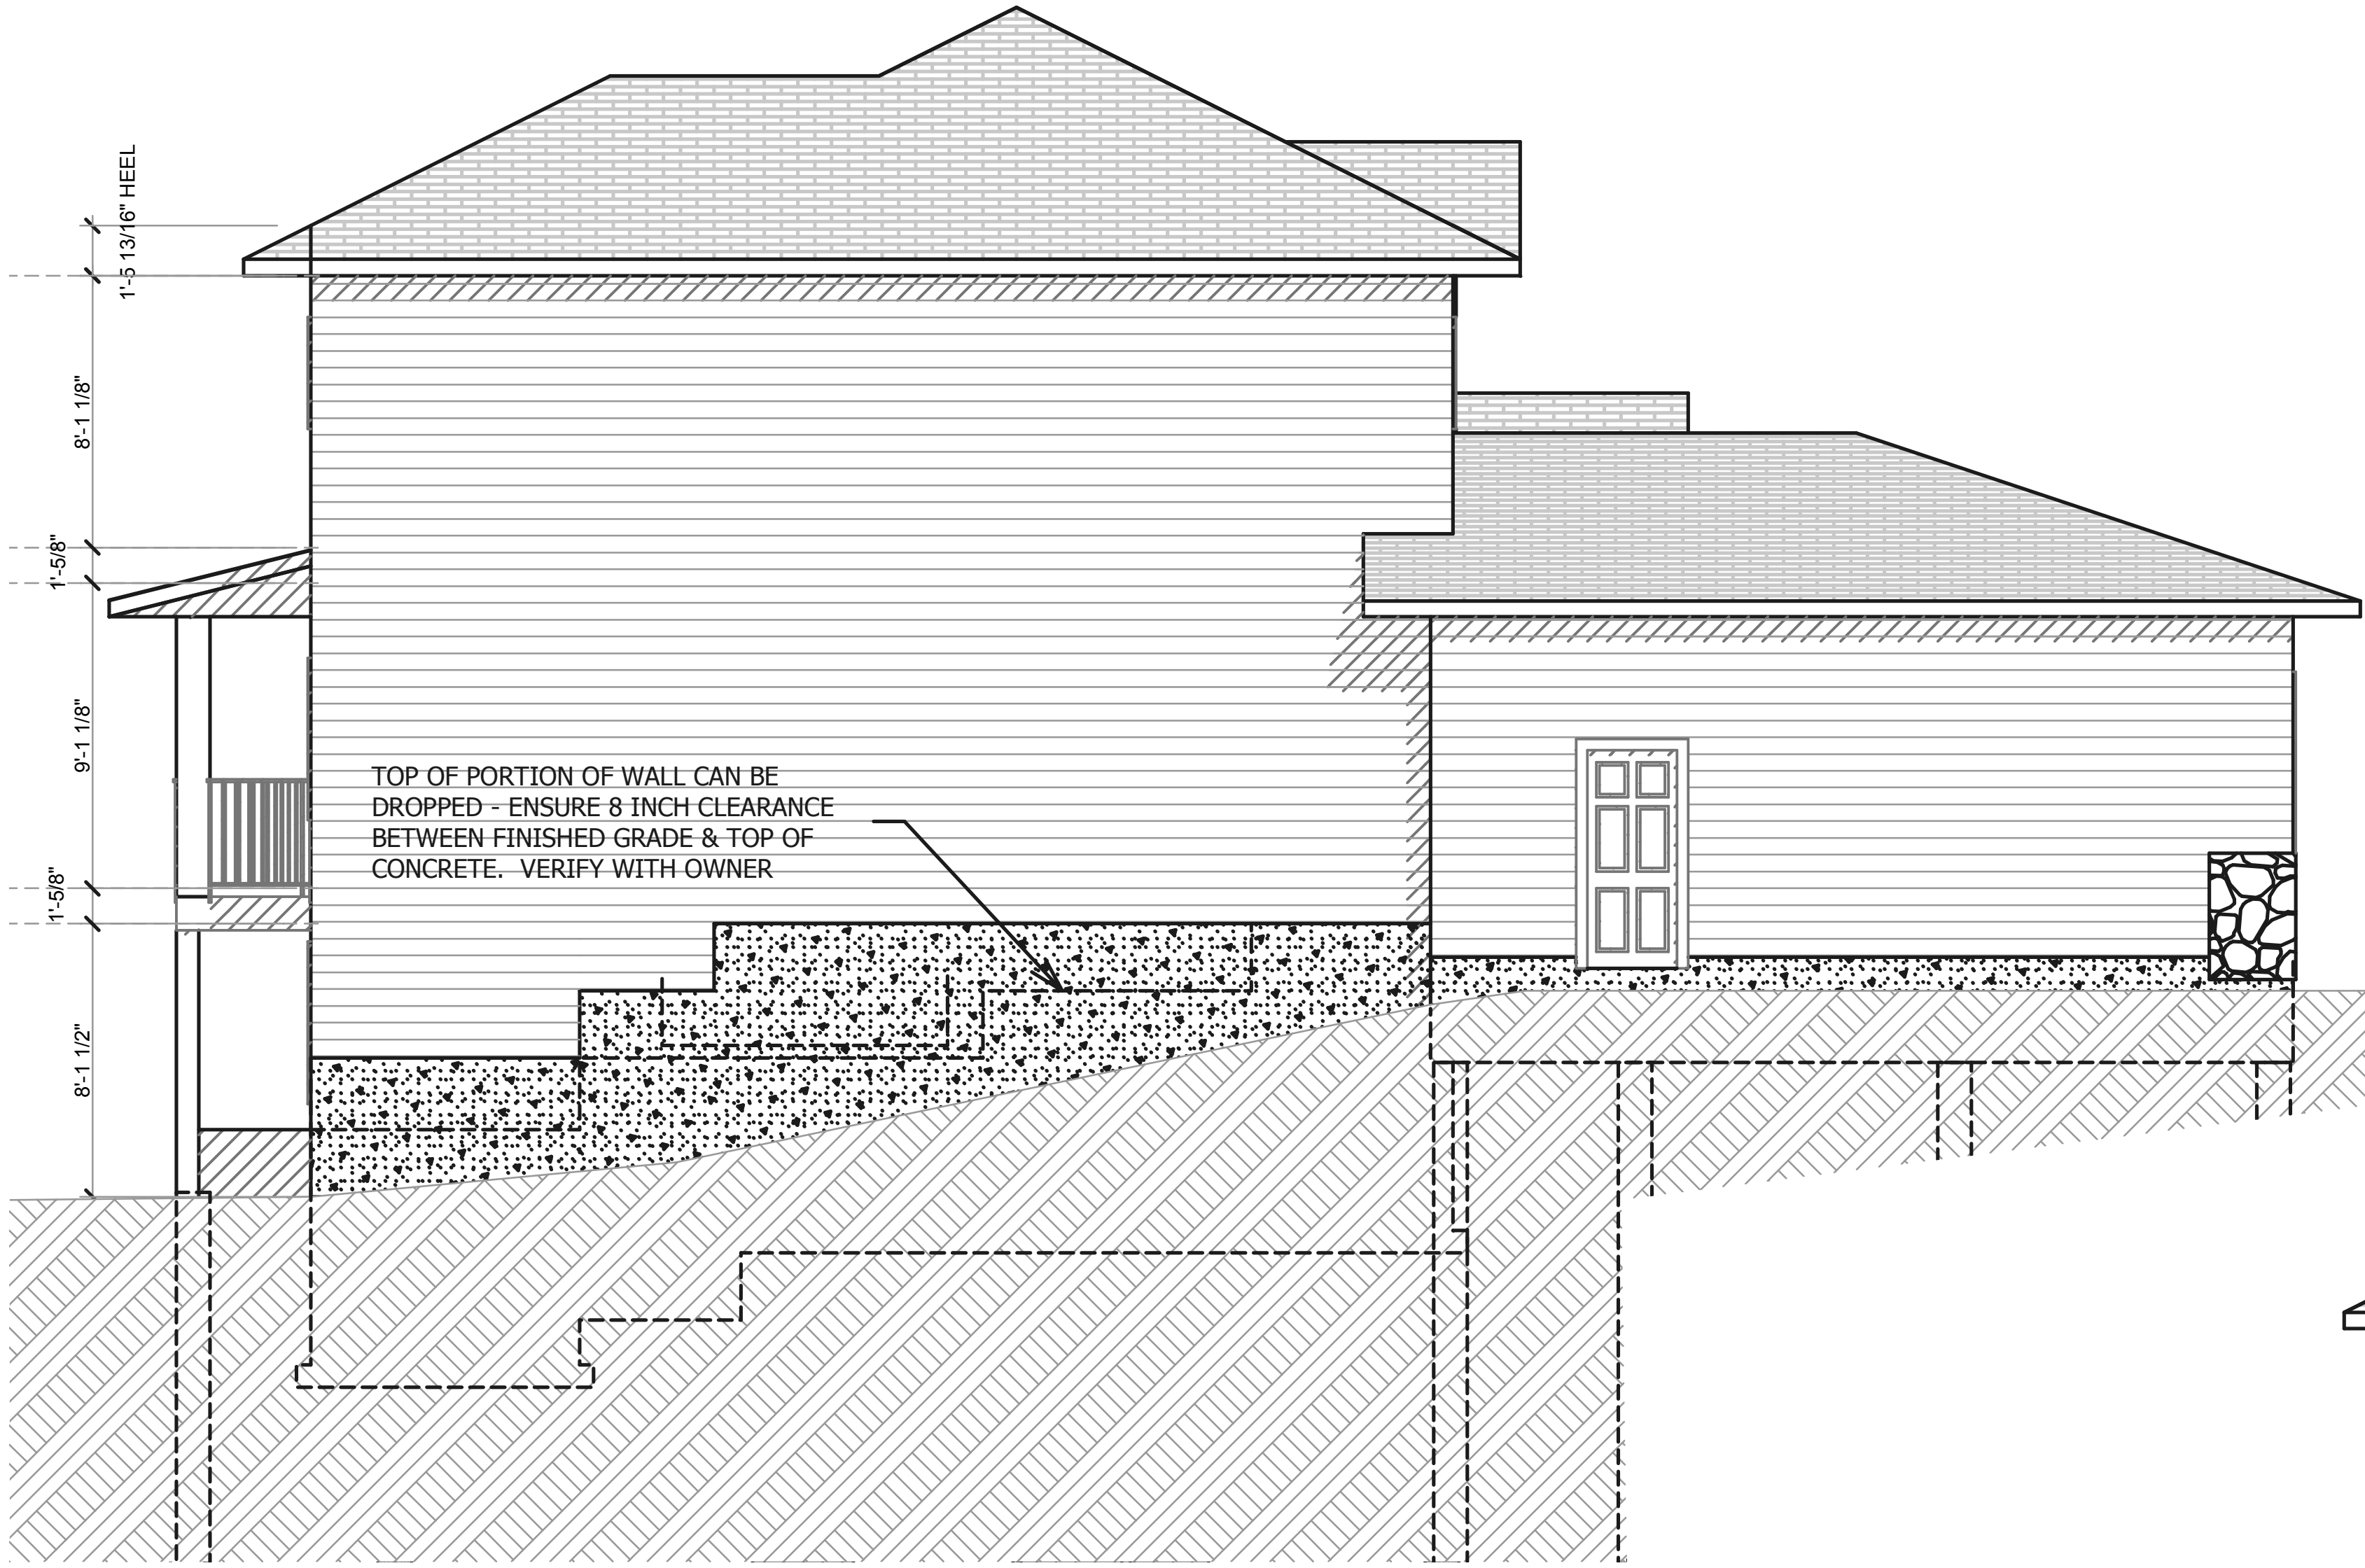

2 E2 LEFT ELEVATION
SCALE 1/8" = 1'-0"

1 E1 FRONT ELEVATION
SCALE 1/8" = 1'-0"

ELEVATIONS
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK

BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty.ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

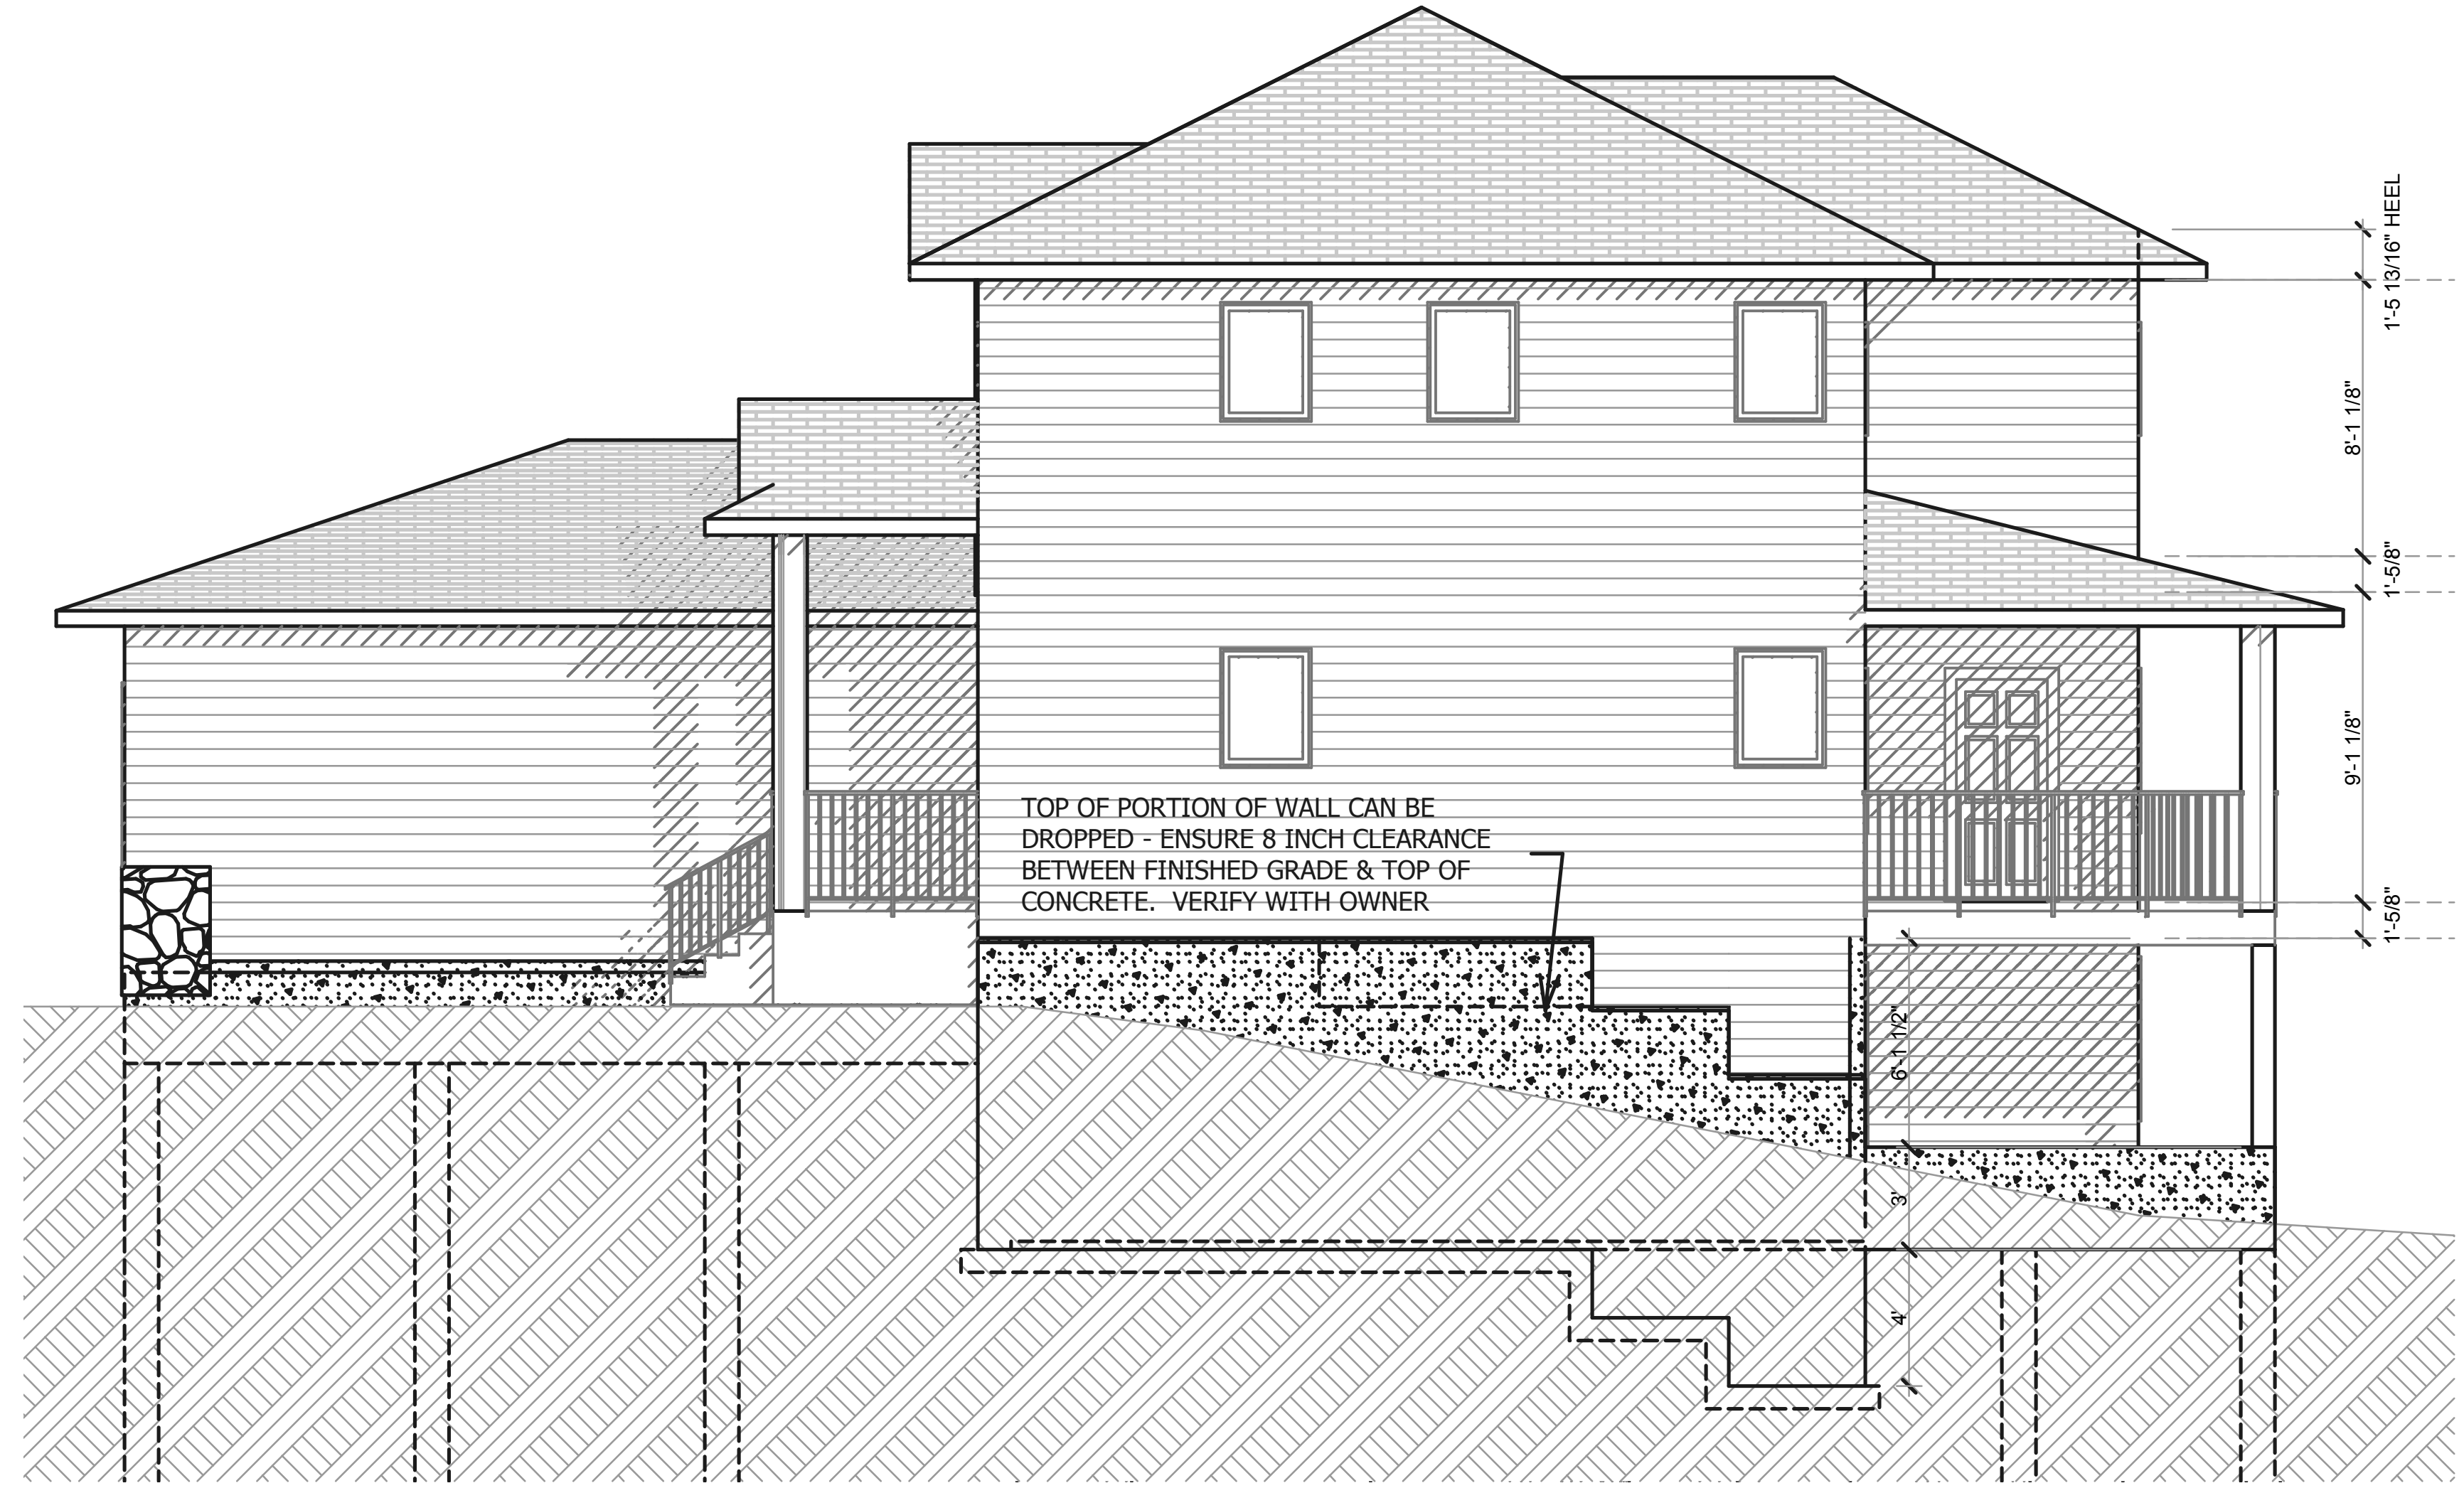

2 E4 RIGHT ELEVATION
SCALE 1/8" = 1'-0"

1 E3 BACK ELEVATION
SCALE 1/8" = 1'-0"

ELEVATIONS
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK
BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY:
KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

2ND FL STAIRS
16 TOTAL RISERS
5 UPPER RISERS TO LOFT 7 5/8"
11 LOWER FLIGHT RISERS 7 5/8"

BASEMENT STAIRS
14 TOTAL RISERS AT 7.65"

11" TREADS RUN AT 10 1/2" W 1/2" NOSING
3'-0" HEIGHT HANDRAIL ON ONE SIDE

3'-6" HEIGHT GUARDRAIL OR PONY WALL AROUND OPENING OF STAIRS. IF RAIL WITH SPINDLES IS USED MAX 4" SPACING BETWEEN SPINDLES

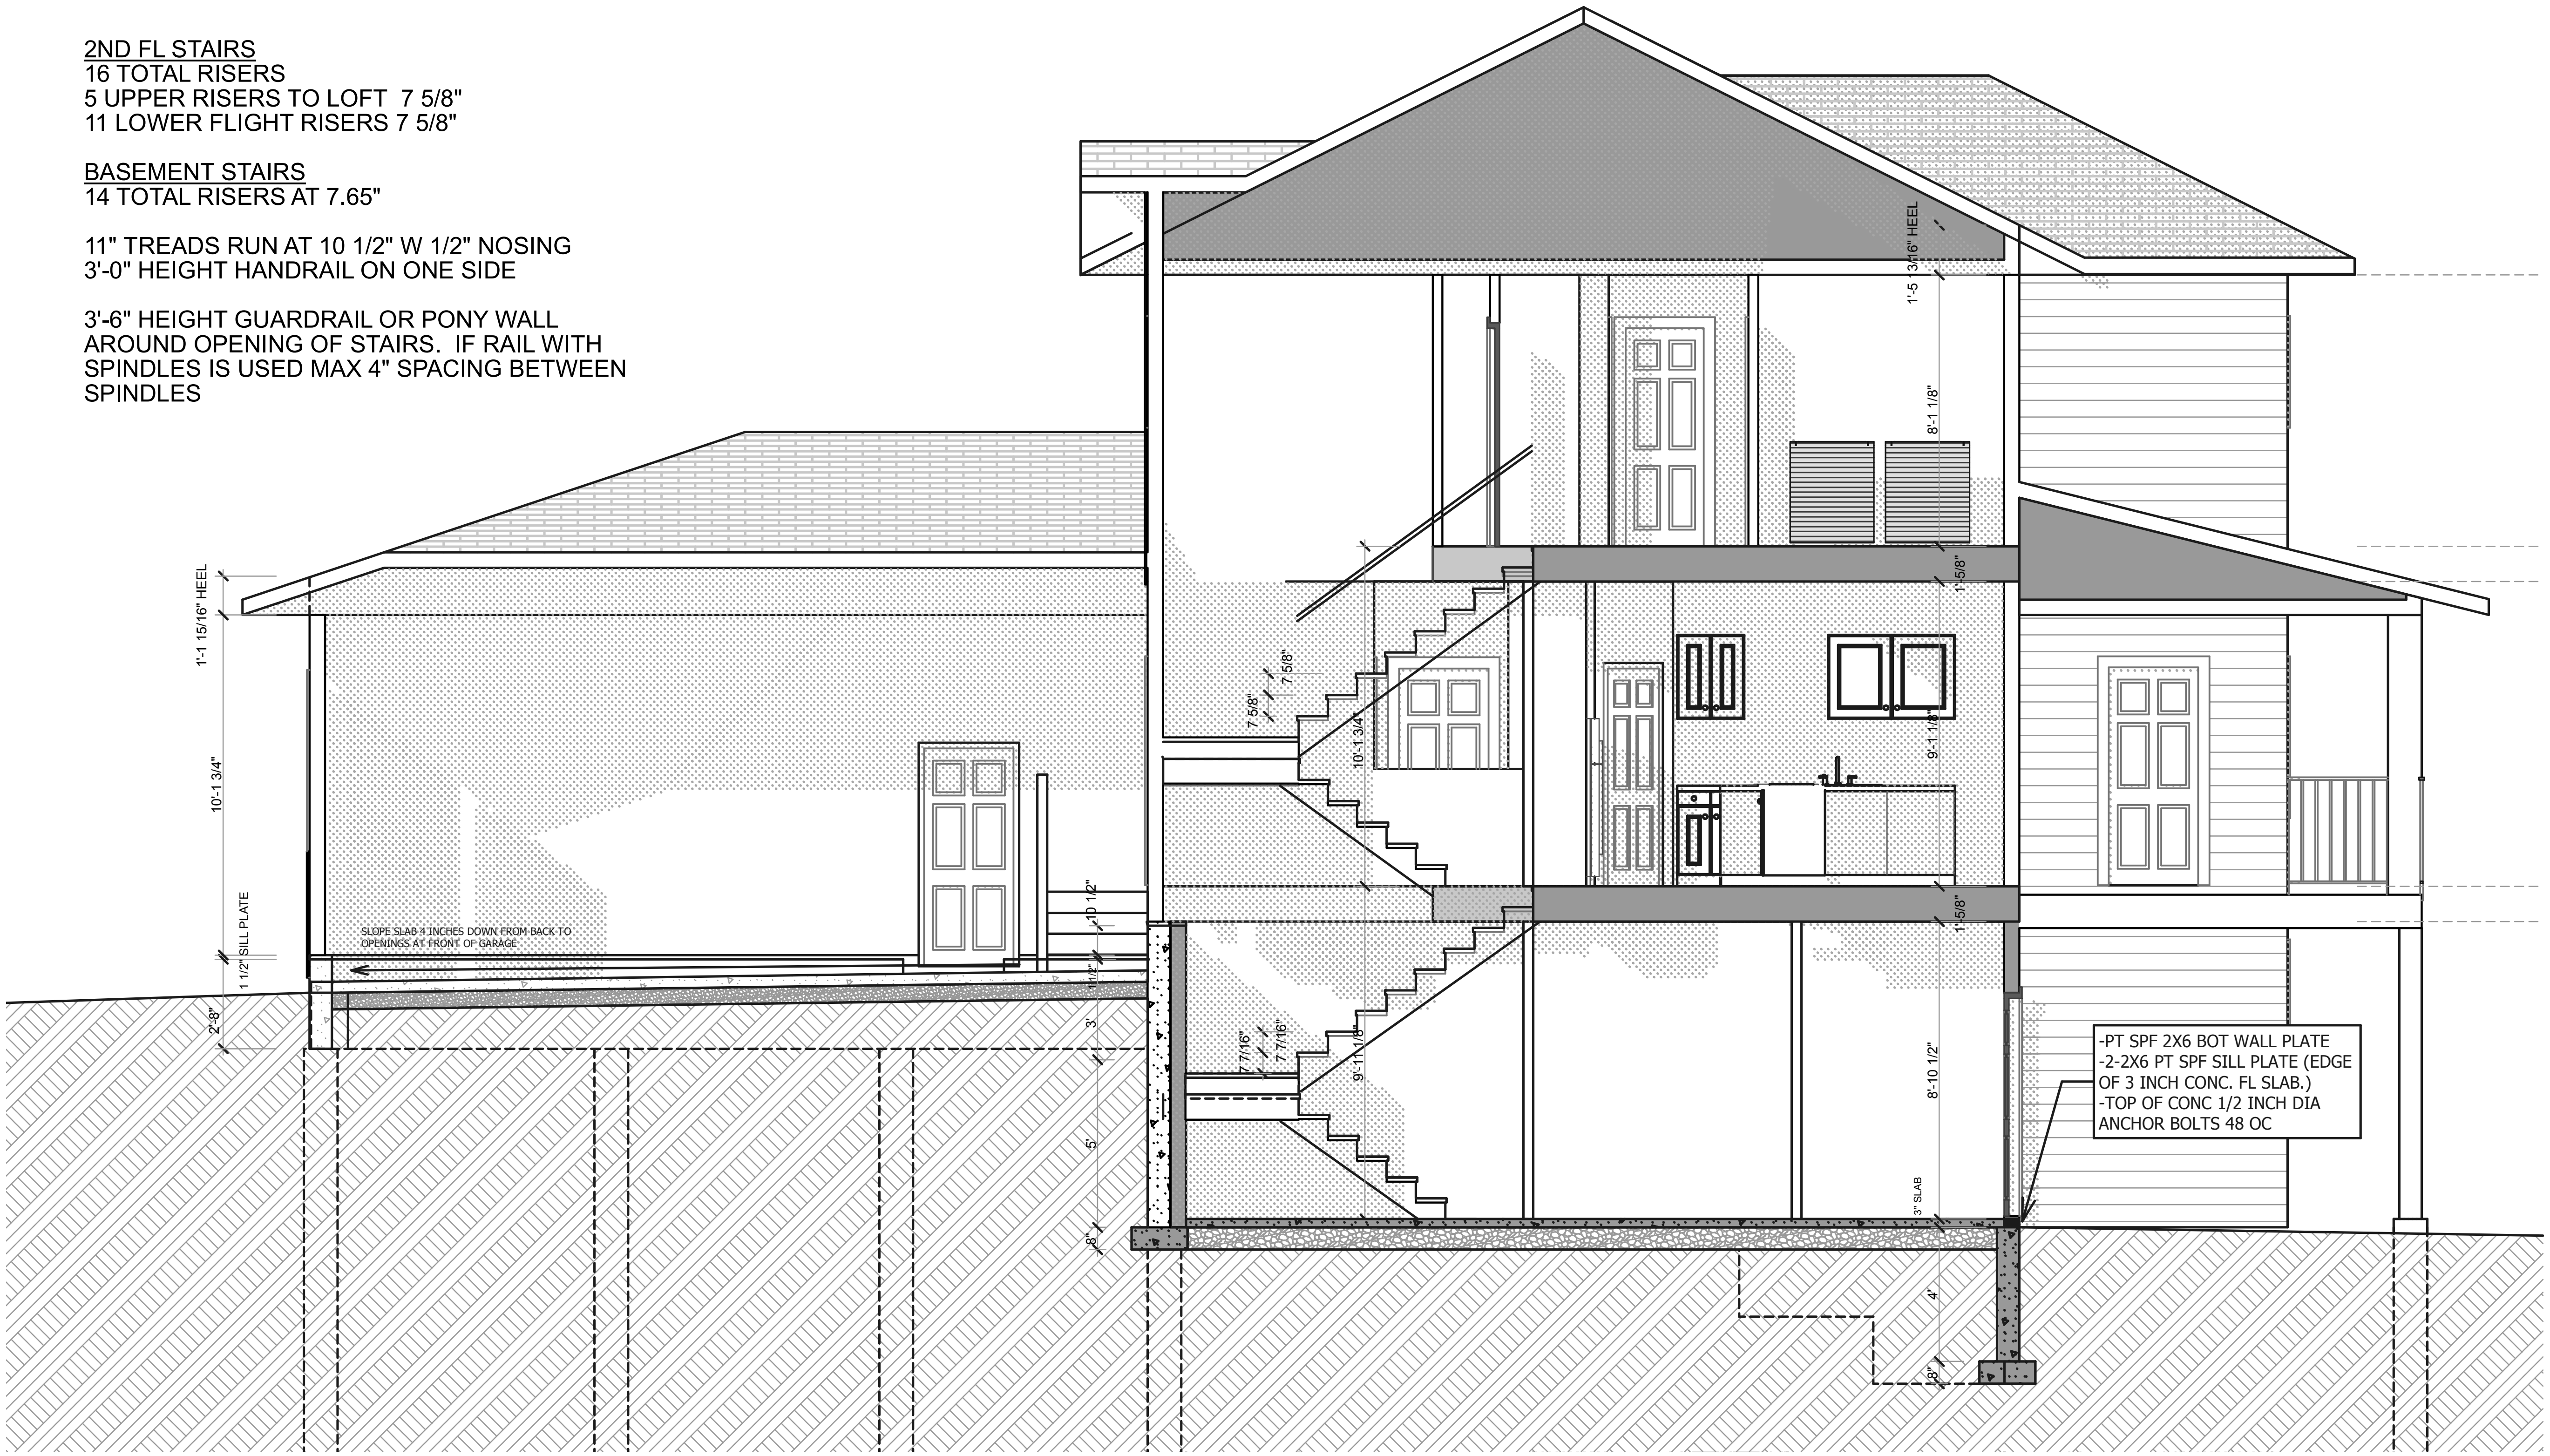

1 S1 STAIR SECTION
SCALE 3/16"= 1'-0"

SECTION
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK
BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

702 KENSINGTON.bk

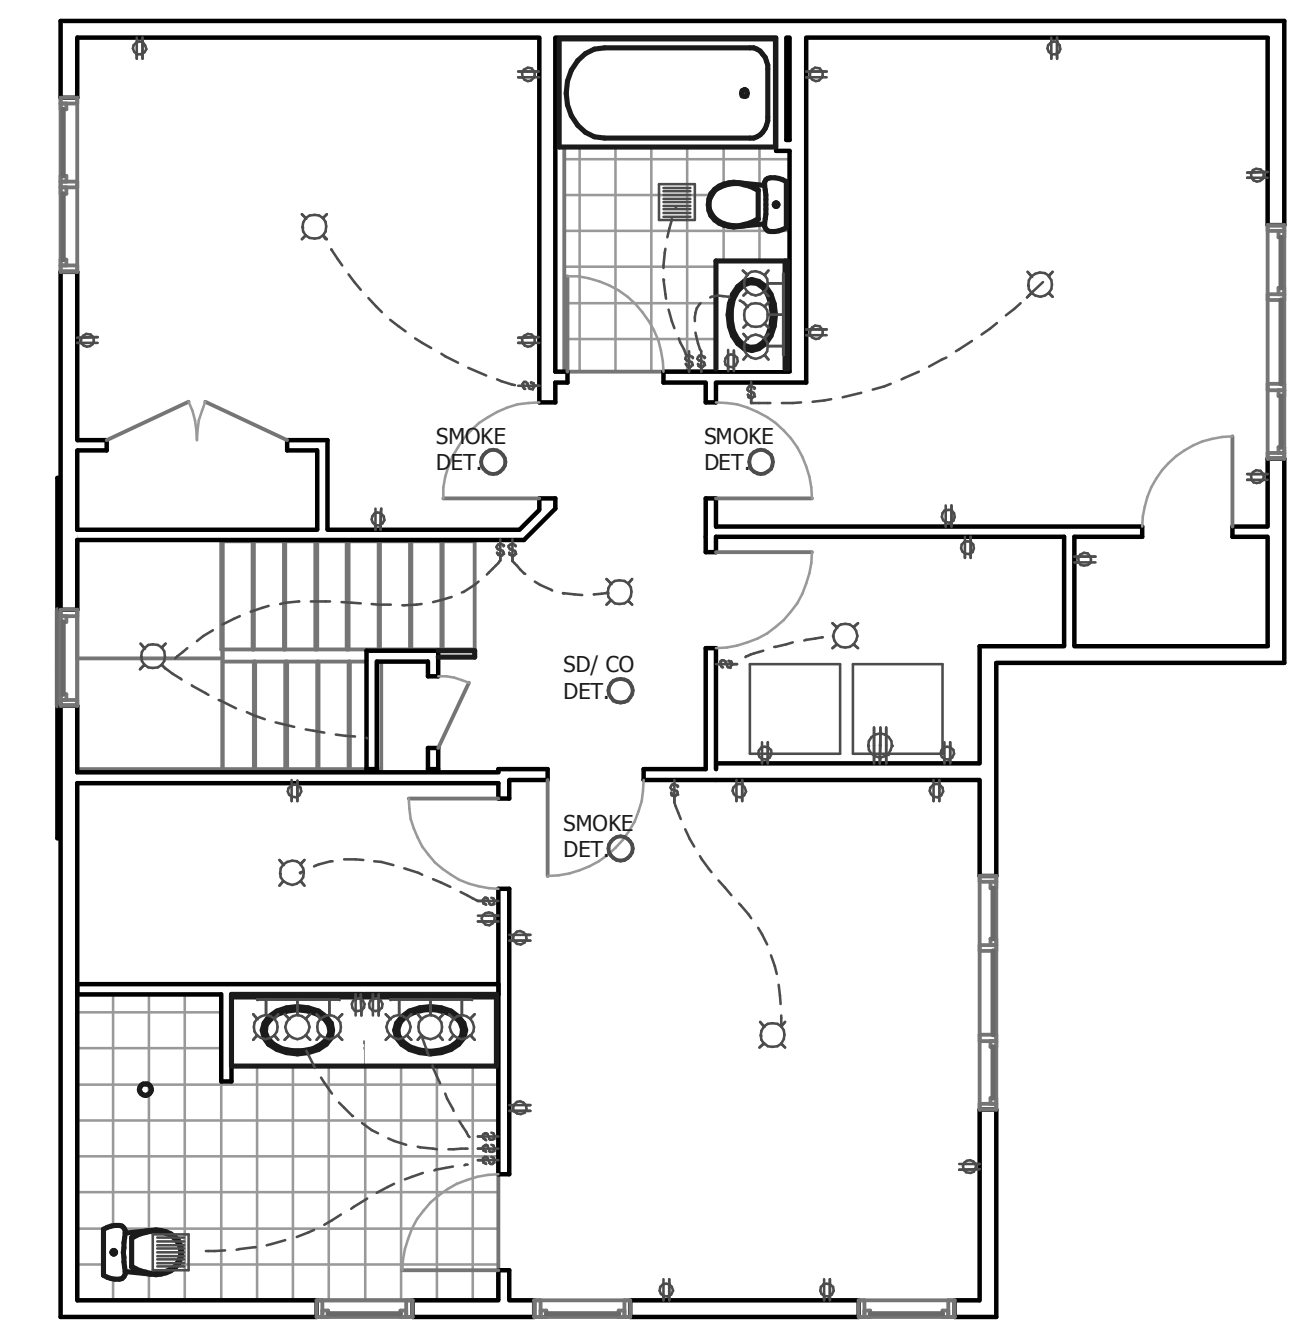

2 | 2ND FL ELECGTRIC
SCALE 3/32"= 1'-0"

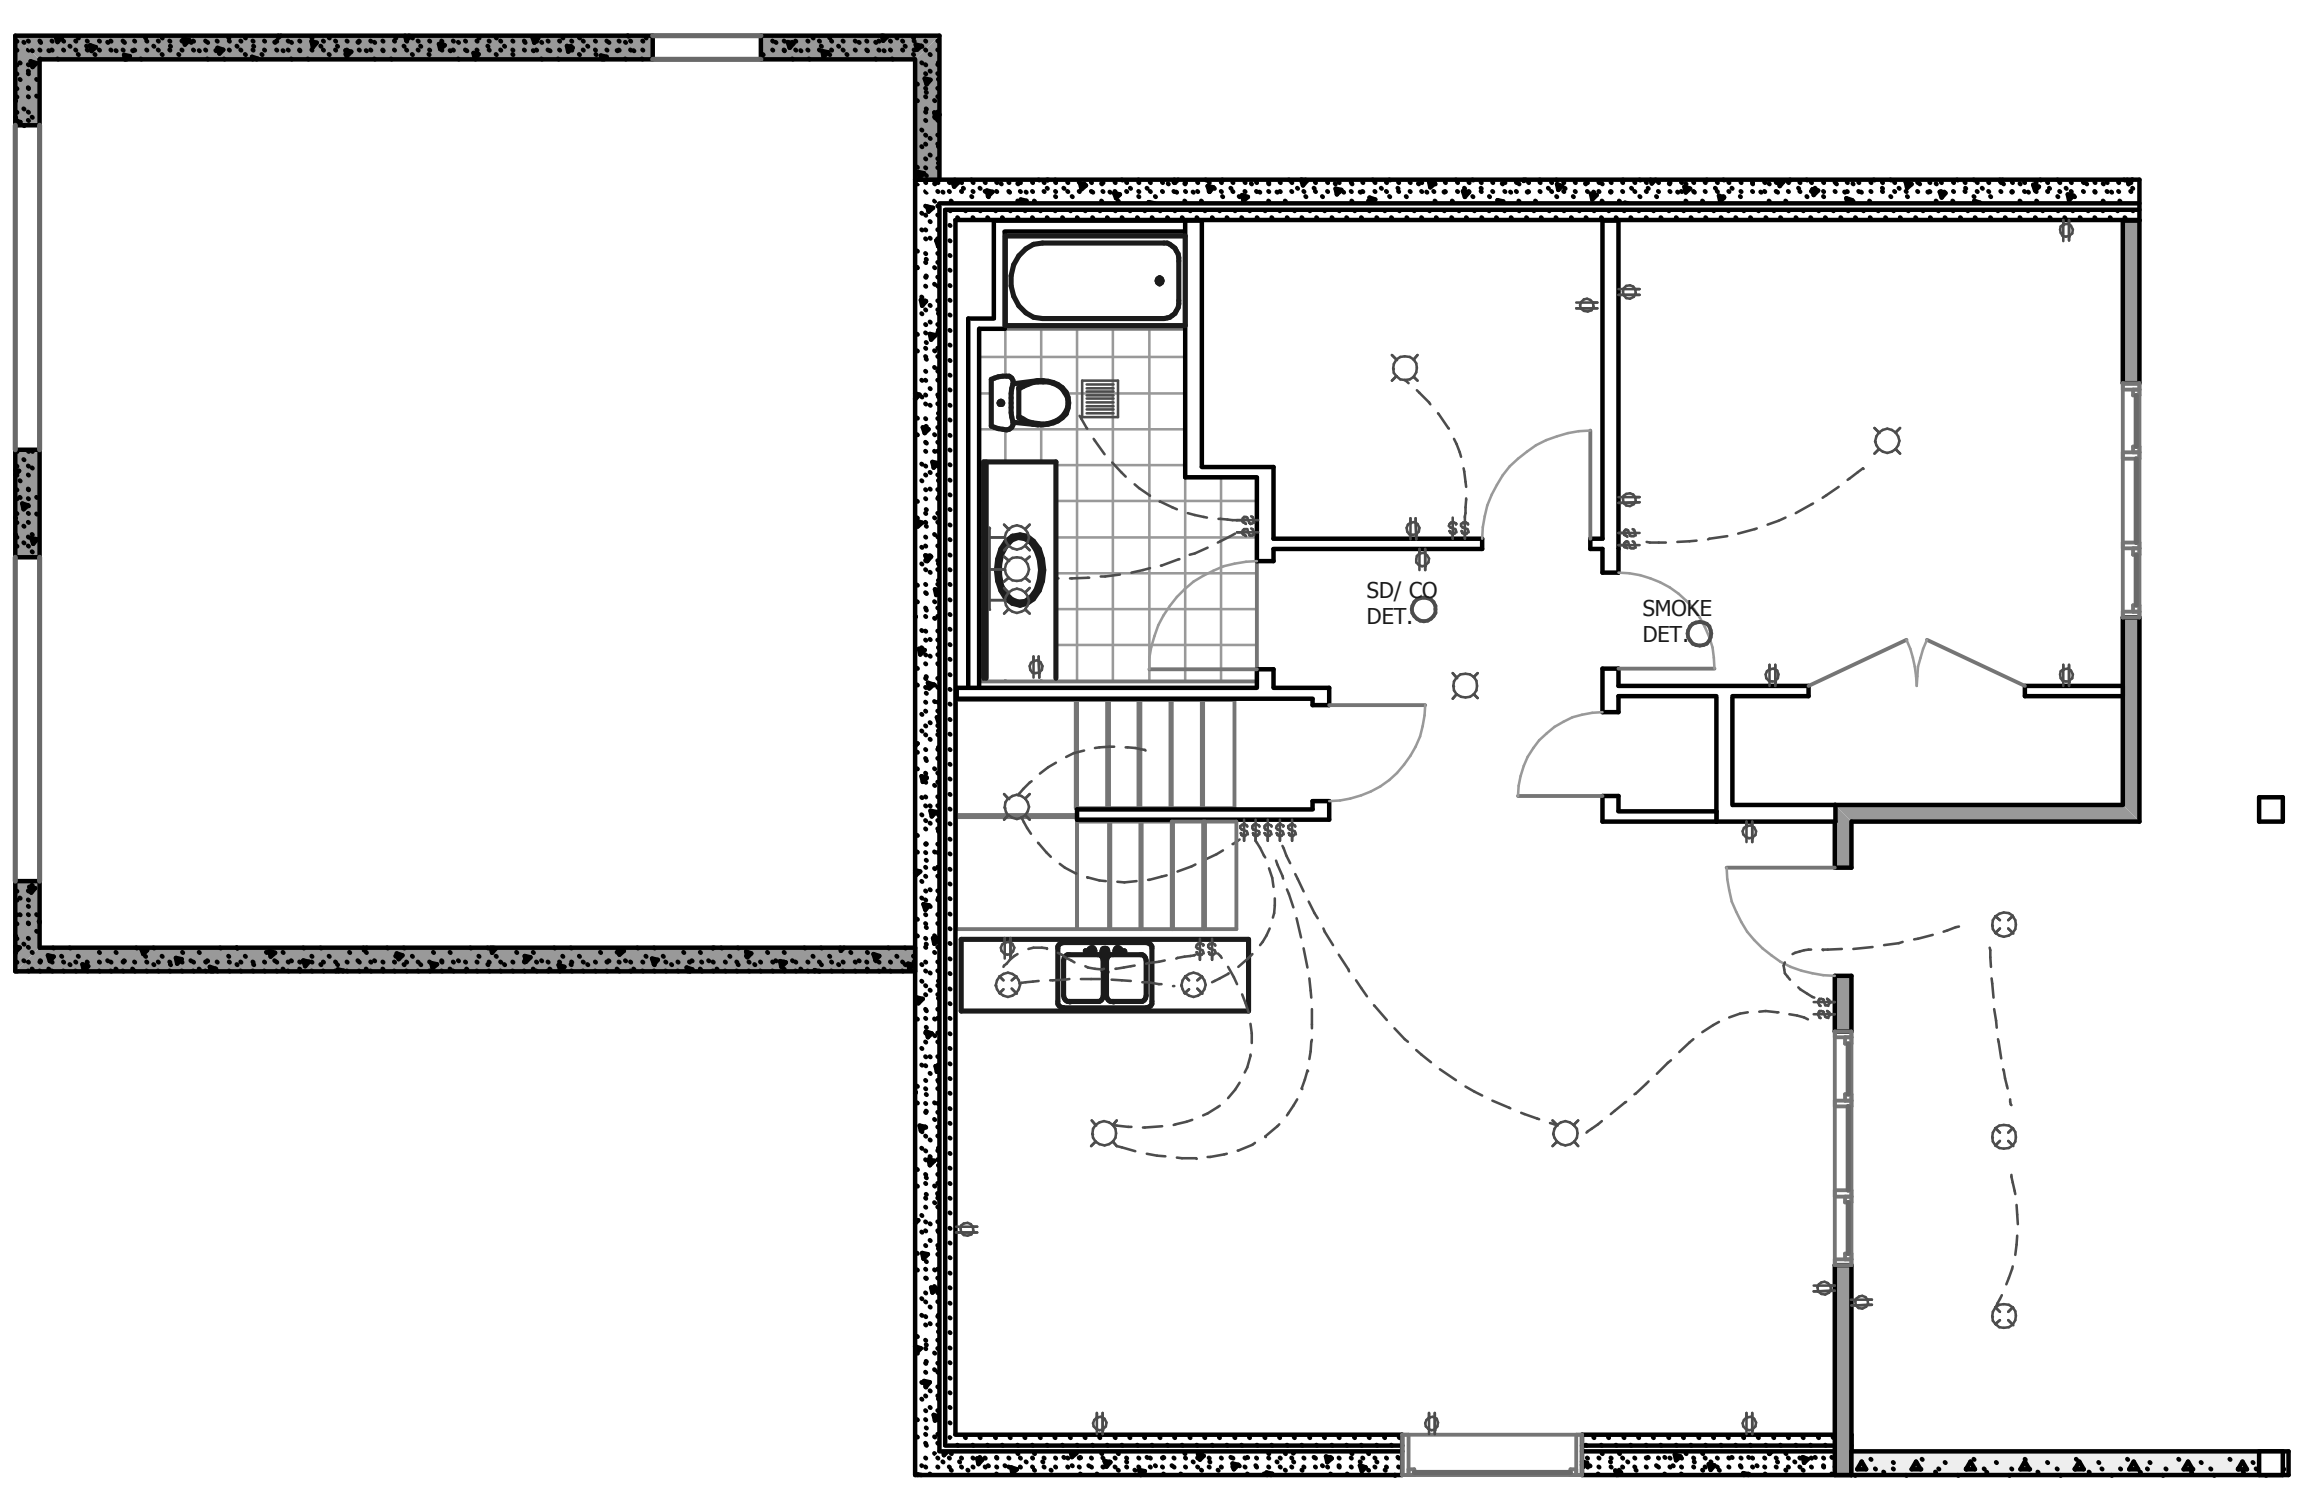

3 | BASEMENT ELECTRIC
SCALE 3/32"= 1'-0"

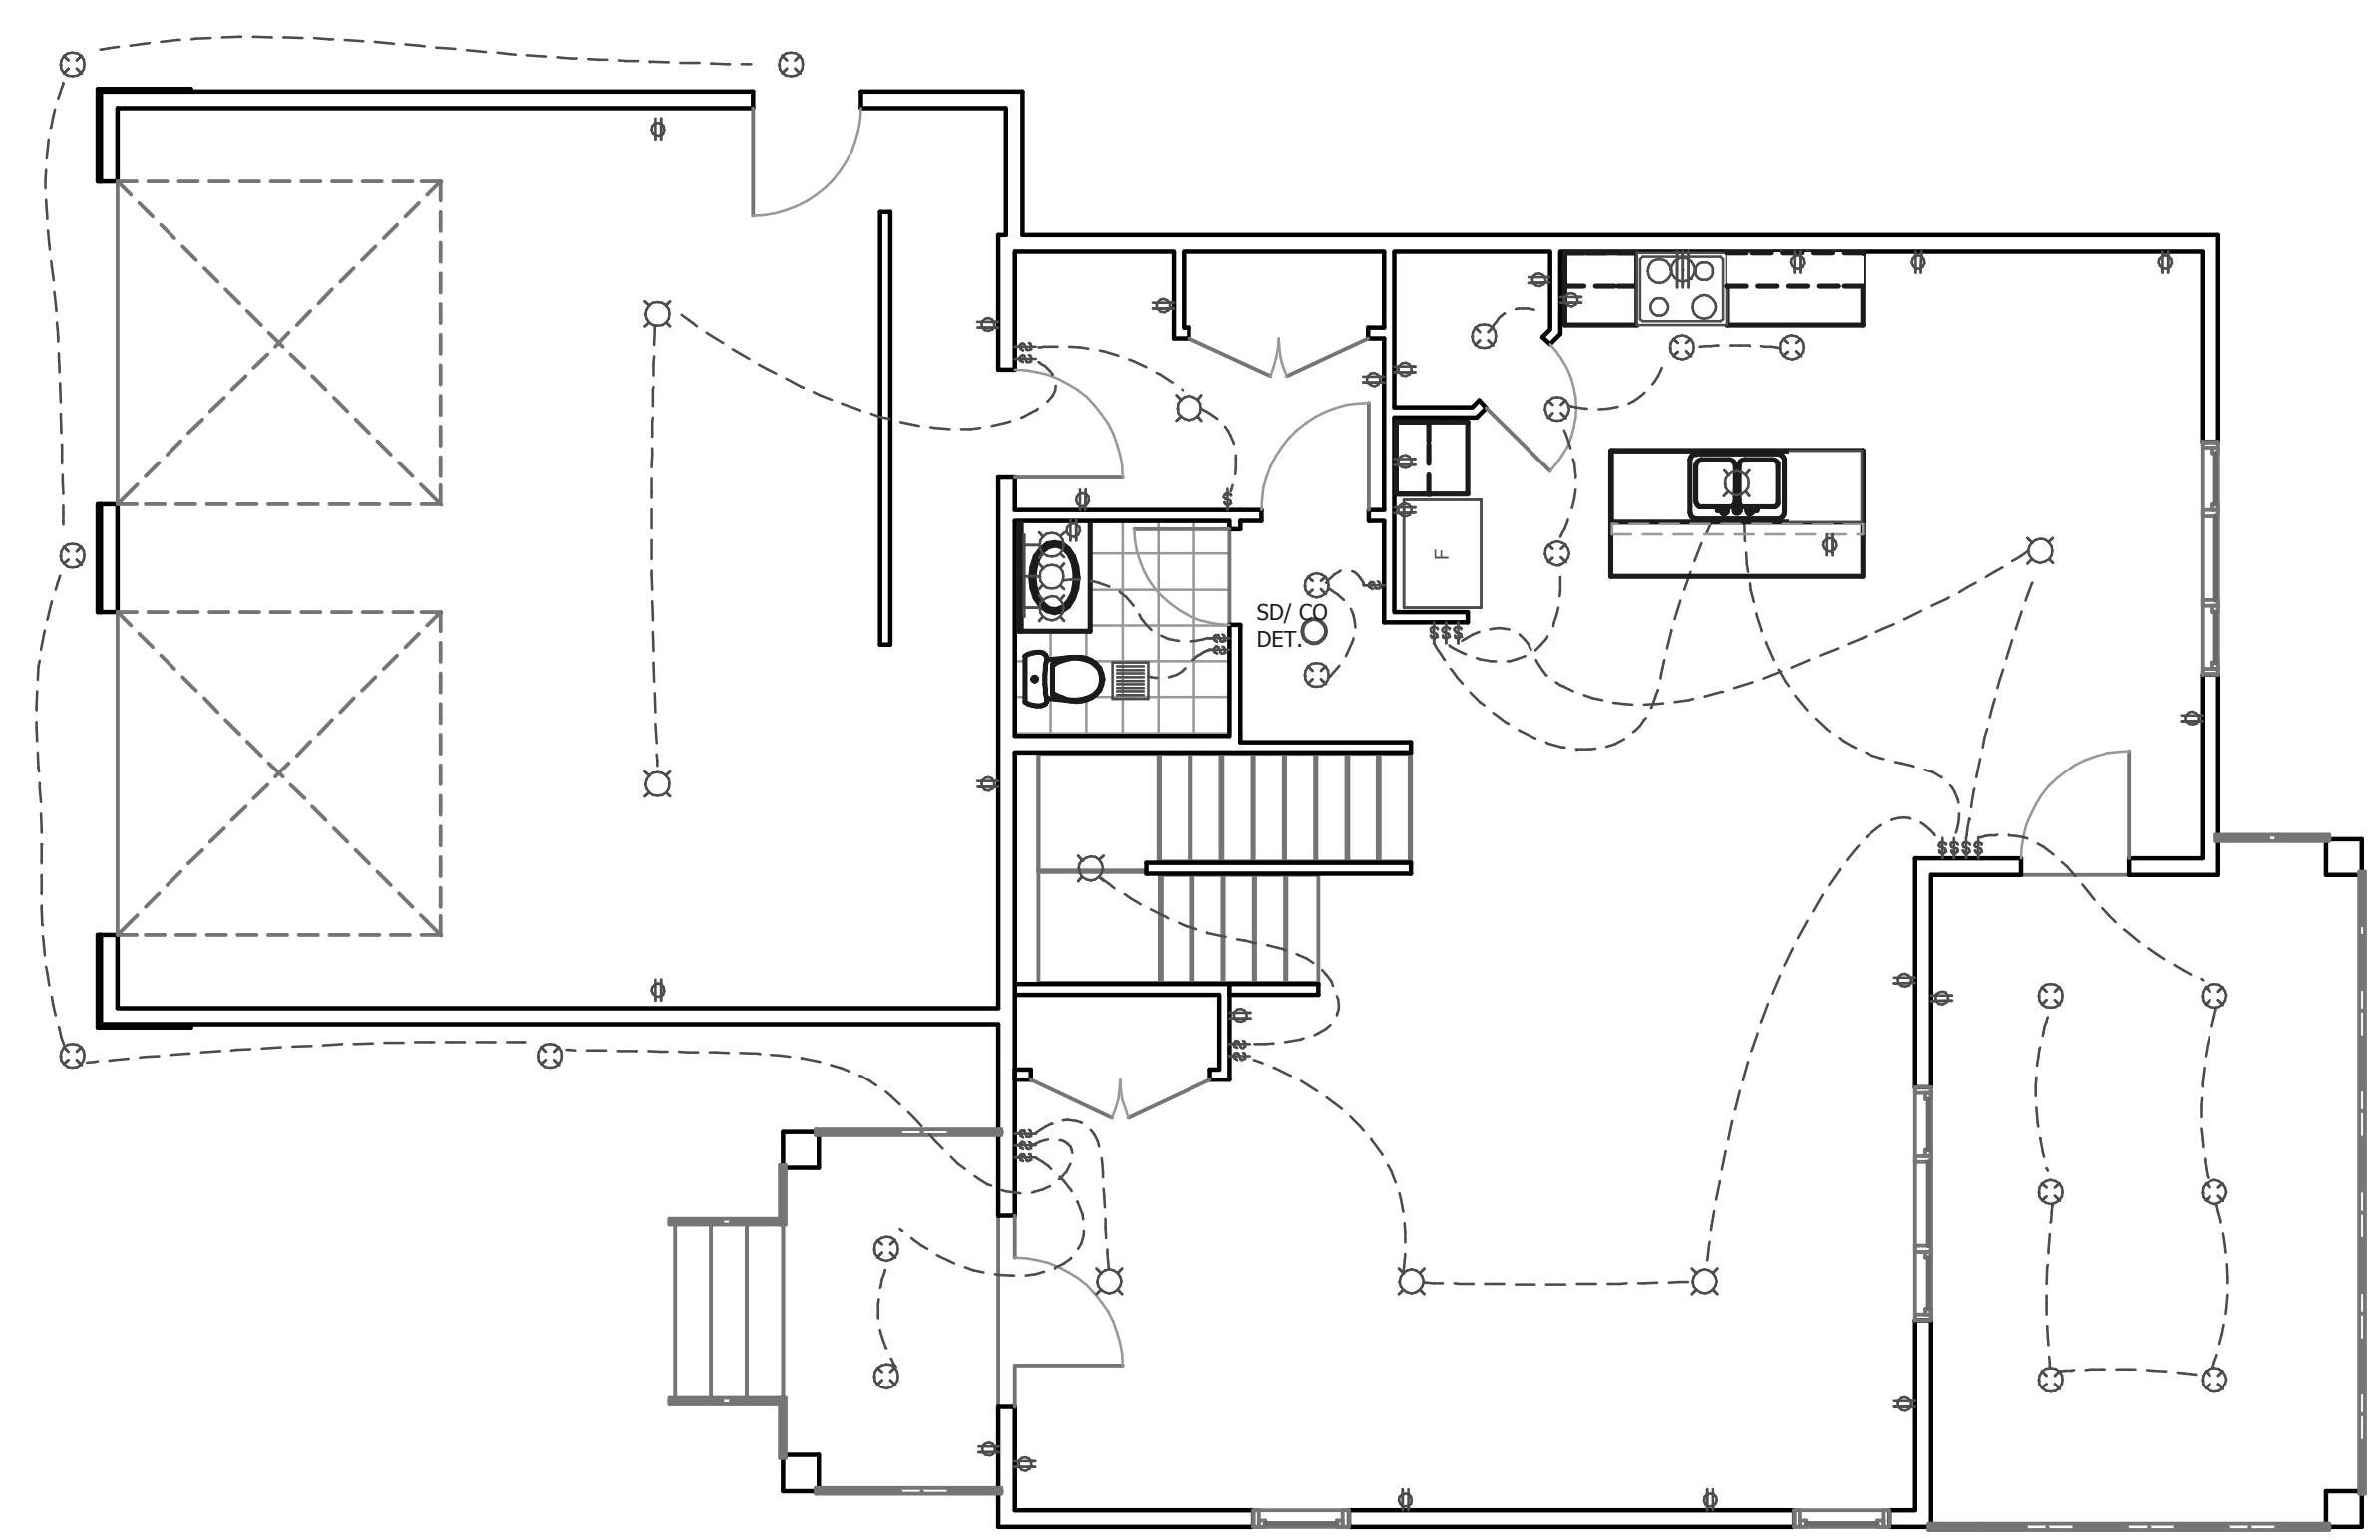

1 | MAIN FL ELECTRIC
SCALE 3/32"= 1'-0"

ELECTRIC PLAN
NEW HOME

BUILDING ADDRESS
702 KENSINGTON BLVD.
SASKATOON, SK

BUILDING CONTRACTOR
BONDICI ALEXANDRU
306-220-0842

REVISION: -

DATE: 28/04/2026

DRAFT BY: KRIS EYVINDSON

bluejetty .ca
HOME DESIGN

1632 AVE C N
SASKATOON SK
S7L 1L5
306 649-0350

BUILDING PROJECT SPECIFICATIONS

GENERAL NOTES

1 – A ABBREVIATIONS

ADJ	ADJUSTABLE	LVL	LAMINATED VENEER LUMBER
AUTO	AUTOMATIC		
BOT	BOTTOM	MAX	MAXIMUM
CGSB	CANDIAN GENERAL STANDARDS BOARD	MECH	MECHANICAL
		MED	MEDIUM
CONC	CONCRETE	MFR	MANUFACTURER
CONT	CONTINUOUS	MID	MIDDLE
DIAG	DIAGONAL	MIN	MINIMUM
DP	DEEP	MPa	MEGAPASCAL
EA	EACH	OC	ON CENTRE
ELEC	ELECTRIC PANEL	O/H	OVERHEAD
ENG'D	ENGINEERED	OSB	ORIENTED STRAND BOARD
EW	EACH WAY	OWJ	OPEN WEB JOISTS
EXIST	EXISTING	P.ENG	PROFFESSIONAL ENGINEER
EXT	EXTERIOR		
FG	FIRE GUARD	PFM	PRE-FINISHED METAL
FL	FLOOR	POLY	POLYETHE
FRR	FIRE RESISTANCE RATING	PT	PRESSURE TREATED
GALV	GALVANIZED	PVC	POLYVINYL CHLORIDE
GF	GAS FURNACE	NBCC	NATIONAL BUILDING CODE OF CANADA
GYP	GYPSUM		
HORIZ	HORIZONTAL	REINF	REINFORCED
HR	HOUR	REQ	REQUIRED
HS	HIGH STRENGTH	SEP	SEPERATION
HT	HEIGHT	SIM	SIMILAR
HVAC	HEATING/VENTILATION/AIR CONDITIONING SYSTEM	SPECS	SPECIFICATIONS
		SPF	SPRUCE PINE FIR
HWH	HOT WATER HEATER	SQFT	SQUARE FEET
IAW	IN ACCORDANCE WITH	SQM	SQUARE METERS
ICF	INSULATION CONCRETE FORM	T&G	TOUNGE & GROOVE
		TYP	TYPICAL
INSUL	INSULATION	VAC	VACUUM
INT	INTERIOR	VB	VAPOUR BARRIER
LBS	POUNDS	VERT	VERTICAL
LSL	LAMINATED STRAND LUMBER	W/	WITH

METRIC CONVERSION IS SHOWN IN MM AFTER IMPERIAL DIMENSION

1 – B RESPONSIBILITIES ASSUMED BY THE CONTRACTOR:

1 – VERIFY SUITABILITY OF DRAWINGS FOR CONSTRUCTION; REPORT ERRORS OR OMMISSIONS TO THE ATTENTION OF KRIS EYVINDSON BLUEJETTY.CA HOME DESIGN PRIOR TO CONSTRUCTION AT LANDLINE 306 649-0350. IF YOU NEED CLARIFICATION ABOUT ANYTHING ON THE PLANS PLEASE CONTACT ME ANYTIME AND I WILL GET BACK TO YOU AS SOON AS I CAN.

2 – ENSURE CONSTRUCTION METHODS APPLIED MEET OR EXCEED THE STANDARDS SET FORTH IN THE NATIONAL BUILDING CODE OF CANADA AND LOCAL MUNICIPLE BYLAWS APPLICABLE AT THE TIME OF CONSTRUCTION.

3 – SITE SAFETY, SECURITY & WASTE REMOVAL.

2 SITEWORK

-SURVEYOR TO VERIFY ALL DIMENSIONS & EASEMENT LOCATONS PRIOR TO EXCAVATION & REPORT DISCREPANCIES TO BLUEJETTY.CA HOME DESIGN .

2 – A EXCAVATION

- ALL FOOTINGS SHALL BE CAST UPON UNDISTURBED SOIL. OVEREXCAVATION MUST BE FILLED WITH CONC.

-DO NOT CAST FOOTING ON FROZEN SOIL AND DO NOT ALLOW SOIL FOOTING TO FREEZE THEREAFTER.

2 – B FOUNDATION DRAINAGE

- PERIMETER FOOTING DRAINAGE TILE:
FILTER FABRIC COVERS MIN 6" CRUSHED STONE ON
4" PREFORATED DRAINGAGE TILE FULL PERIMETER OF FOOTING.

-PROVIDE 2 LAYERS OF 2” RIGID INSULATION AS SHOWN ON PLAN. JOINST TO BE LAPPED. INSULATION TO BE PLASTI-FAB DUROSPAN OR APPROVED EQUIVALENT

-INSTALL 4” PVC CHANNEL IN FOOTING & TIE WEEPING TILE INTO RADON TRAP & SUMP PIT.
-PLASTIC SUMP PIT MIN 2'-0” FROM ANY FOOTING. INSTALL MECH AUTO PUMP W/ 30" COVER, POWER SUPPLY & DISCHARGE LINE.

2 – C FENCES & DECKS

DECK CONSTRUCTION
PT SPF 2x6" DECKING SCREWED TO
PT SPF 2x10" (38x254) JOISTS 16"(406)OC
W/ BRIDGING MIN 6'-10"(2100)OC RESTING ON
3-PLY 2x10" (38x235) SPF BEAM ON
2X6 COLUMN FASTENED IN POST SUPPORT EMBEDDED IN TOP OF PILE OR RESTING IN CONCRETE POST SUPPORT DUG INTO SOIL 2” FOR LATERAL SUPPORT

GUARDS FOR DECKS
ARE PERMITTED TO BE MIN 2'11-1/2" (900) IN HEIGHT WHERE THE WALKING SURFACE OF THE DECK IS NOT MORE THAN 70-1/2" (1800) ABOVE FINISHED GROUND LEVEL.
EXT DECKS MORE THAN 70-1/2" (1800) IN HEIGHT MUST HAVE A GUARD AT MIN 42" (1070).
EXT DECKS LESS THAN 23-1/2" (600) IN HEIGHT DO NOT REQ A GUARD.
SECURE EXT DOORS LEADING TO DECK UNTIL DECK & GUARDRAIL IS FULLY CONSTRUCTED.

-ALL OPEN RAILS MUST HAVE NO MORE THAN 4” (100) SPACE BETWEEN VERT MEMBERS. -PROVIDE SAFETY GLASS FOR GUARDS WHERE APPLICABLE.

3 CONCRETE

-CAST IN PLACE CONCRETE WORK IN ACCORDANCE WITH CSA A23.1

-REINFORCING STEEL TO CSA G30.18,GRADE 400. PLAIN FINISH FOR ALL BARS. MINIMUM SPLICE LENTH 36”

-CONCRETE REINFORCING WORK AS PER CAN/CSA A23.3

3 – A PILES

CONCRETE PILE SCHEDULE

PILE MARK	PILE SIZE AND REINFORCING	PILE LOAD (KPS) FACTORED
P1	10" DIA X 14' LONG 2-15MX16' VERTICAL	5.0
P2	12" DIA X 15' LONG 2-15MX17' VERTICAL	15.0
P3	12" DIA X 26' LONG 2-15MX20' VERTICAL	30.0

*VERTICAL REINFORCING LENGTH INCLUDES EXTENSION INTO GRADE BEAM.

THE CAST IN PLACE CONCRETE PILE DESIGN IS BASED ON THE ASSUMPTION THAT THE SOIL IS COHESIVE (CLAY OR TILL) AND HAS A MINIMUM SKIN FRICTION OF CAPACITY OF 20 KPa. IF THE CONTRACTOR OBSERVES A SOIL THAT IS COHESIONLESS (SAND OR SILT) CONCRETE PILES MAY NOT BE APPROPRIATE.
IF THE PILES ARE PLACED IN FILL MATERIAL MORE THAN 6'-0” IN DEPTH, THE PILE SHOULD BE LENGTHENED BY THE FILL DEPTH GREATER THAN 6'-0”. IF WATER SEEPAGE IS ENCOUNTERED DURING DRILLING, CASING SHOULD BE USED TO KEEP PILE HOLES OPEN AND DRY DURING THE PLACEMENT OF THE CONCRETE. AS CASING EXTRACTED, CONCRETE IN CASING MUST HAVE ADEQUATE HEAD TO DISPLACE ALL WATER IN THE ANNULAR SPACE.

STEEL SCREW PILE OPTIONAL
STEEL SCREW PILES MAY BE USED AS ALTERNATE PILE FOUNDATION.
-SCREW PILE DESIGN TO BE COMPLETED & SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE
PROVINCE OF SASKATCHEWAN TO RESIST THE FACTORED LOADS NOTED ON THE DRAWING, BASED ON
BEARING ON THE HELIX AND SKIN FRICTION ON THE SHAFT WHERE APPROPRIATE. DESIGN BASED ON
TORQUE REQUIRED TO INSTALL IS NOT ACCEPTABLE.
-PILES SHALL BE DESIGNED SO NOT TO BE AFFECTED BY FROST.
- REINFORCE WITH 2-15M X 4' LONG EMBEDDED IN CONCRETE FILLED SCREW PILE, EXTEND TO TOP BARS OF
GRADE BEAM (MAX 28”)

3 – C FOOTINGS

*FOOTINGS HAVE BEEN DESIGNED FOR AN ASSUMED ALLOWABLE BEARING CAPACITY OF 75kPa

-FOOTING CONC SHALL ATTAIN A 28 DAY COMPRESSIVE STRENGTH OF 25 MPa USING SULFATE RESISTANT CEMENT, TYPE 50/HS.
-INSTALL 4" PVC CHANNEL IN FOOTING FOR WEEPING TILE TO TIE INTO THE SUMP PIT.

PERIMETER FOOTING TYP (STEPPED AT BACK)
20"x 8"(509x203)DP
CONC REINF W
HORIZ 2-10M CONT LONG DIRECTION,
AND 10M CROSS BARS AT 4'-0” OC
FOR LATERAL SUPPORT: FORM KEYWAY OR
EMBED 10M BENT DOWELS 12” INTO FOUNDATOIN WALLS

MEDIUM LOAD PAD FOOTING
42x42x10"DP (1066x1066X254 DP)
REINF W 4- 15M @ 9” OC E/W MIN 3” FROM BOTTOM
3"ø (76ø) ADJ STEEL TELEPOST

TYP LOAD PAD FOOTING
36x36x8"DP (915x915X203DP)
REINF W 3- 15M @ 10” OC E/W MIN 3” FROM BOTTOM
3"ø (76ø) ADJ STEEL TELEPOST

3 – D FOUNDATION WALL
-FOUNDATION WALL CONCRETE SHALL ATTAIN A 28 DAY COMPRESSIVE STRENGTH OF 25 MPa USING SULFATE RESISTANT CEMENT, TYPE 50/HS.
-DRILL HOLES MIN. 6” DP IN EXISTING CONC, EPOXY FILL HOLES & INSERT 15M REBAR DOWEL BARS SPACED 4'(1200)OC. FASTEN TO NEW CONC REBAR.
-VERIFY SIZE OF BEAM POCKETS WITH FLOOR SUPPLIER
-REBAR COVERGE 1 1/4” MIN 2” MAX
-BEND REBAR AT CORNERS.

NOTE: FOUNDATION WALLS HAVE BEEN DESIGNED ASSUMING CONTINUOUSLATERAL SUPPORT IS PROVIDED AT THE TOP AND BOTTOM OF THE WALLS. CONTRACTOR AND SUPPLIER TO ENSURE THAT THE FLOOR STRUCTURE PROVIDES ADEQUATE LATERAL SUPPORT AS PER PART 9 OF THE NBCC 2015.

BACK RETAINING WALL
36” DP GRADE BEAM TYP
8” X 48”DP CONC
REINF W
HORIZ: 2-15M TOP AND BOTT
-RETAINING WALL ANCHORING: EMBED GALV. METAL POST SUPPORT IN TOP OF WALL.

GARAGE FOUNDATION
32” DP GRADE BEAM TYP
8” X 32”DP CONC (PLUS 1.5” PT SILL PLATE ON TOP)
REINF W
HORIZ: 2-15M TOP AND BOTT
-GARAGE ANCHORING: 1/2” ANCOR BOLTS AT 48” OC 4” EMBED, TYP.

HOUSE WALL 9'-0” DP 8” CONC FOUNDATION WALL TYP
8" X 9'-0”DP CONC (PLUS 1.5” PT SILL PLATE ON TOP)
REINF W
HORIZ: 2-10M TOP MID & BOT.
VERT: 15M 22" O.C. INSIDE FACE
-ANCHORING: 1/2” ANCOR BOLTS AT 48” OC 4” EMBED, TYP.

HOUSE WALL 4'-0” DP 8” CONC FOUNDATION WALL TYP
8" X 9'-0”DP CONC (PLUS 1.5” PT SILL PLATE ON TOP)
REINF W
HORIZ: 2-10M TOP BOT.
VERT: 15M 22" O.C. INSIDE FACE
-ANCHORING: 1/2” ANCOR BOLTS AT 48” OC 4” EMBED, TYP.

3 – E SLAB

BASEMENT SLAB TYP
SHALL ATTAIN A 28 DAY COMPRESSIVE STRENGTH OF 25 MPa USING SULFATE RESISTANT CEMENT, TYPE 50. APPLY JOINT SEALANT TO PROVIDE CONTINUOUS SEAL BETWEEN SLAB AT PERIMETER & ALL PENETRATIONS.
3" (76) MIN. CONC SLAB
6 MIL CGSB POLY VB ON
MIN 6” (150) CRUSHED STONE.

GARAGE SLAB TYP
SHALL ATTAIN A 28 DAY COMPRESSIVE STRENGTH OF 32 MPa USING SULFATE RESISTANT CEMENT, TYPE 50/HS
SLOPE TO GARAGE DOOR MIN. 1/8":12" – 4" BACK TO FRONT
4" (102) CONC SLAB REINF W
10M 16"(408) OC EW ON
MIN 6"(150) CRUSHED STONE

4 MASONRY
N/A

5 STRUCTURAL STEEL
3” DIA STEEL ADJUSTABLE POSTS SUPPORT BASEMENT BEAMS OR BUILT UP WOOD COLUMNS THAT SUPPORT FULL BEAM WIDTH CAN ALSO BE USED.

6 WOOD CONSTRUCTION

-ROOF TRUSS, PRE-ENGINEERED BEAMS & FLOOR JOISTS
*ENGINEERED BY MANUFACTURER OR AS NOTED ON DRAWING WITH CONVENTIONAL LUMBER. *PROFESSIONAL ENGINEER MUST BE LICENSED TO PRACTICE IN THE PROVINCE OF CONSTRUCTION.
-PT WOOD USED IN CASES WHERE WOOD FRAMING COMES IN CONTACT WITH CONCRETE AND WHERE WOOD FRAMING IS LESS THAN 6" ABOVE FINISHED GRADE.
-ALL OTHER WOOD USED IS TO BE SPF #2 OR BETTER.

6 – A ROOF CONSTRUCTION
C1 ROOF TYP
FIBREGLASS SHINGLES STYLE SELECTED BY OWNER - INSTALLED IAC MANFACTURERS SPECIFICATIONS.
7/16"(11) OSB SHEATHING "H" CLIP SEAMS
ENGINEERED ROOF TRUSS SYSTEM
1X4"(21x89) TRUSS BRACING'
18" - 24" DP (R50-70) BLOWN INSULATION FLAT CEILINGS
6 mil CGSB POLY VB
1/2"(13) GYP CEILING FINISH

6 – B FLOOR CONSTRUCTION
-INSTALL BLOCKING IN FLOOR TO SUPPORT FULL WIDTH OF COLUMNS

C2 MAIN FLOOR TJI
FINISH FLOORING (CONFIRM W OWNER)
3/8" (9) OSB UNDERLAYMENT BOARD
3/4" (19)T&G SUBFLOOR
ENGINEERED TJI (11 7/8")
1/2"(13) GYP CEILING FINISH

C2 2ND FLOOR TJI
FINISH FLOORING (CONFIRM W OWNER)
3/8" (9) OSB UNDERLAYMENT BOARD
3/4" (19)T&G SUBFLOOR
ENGINEERED TJI (11 7/8")
1/2"(13) GYP CEILING FINISH

6 – C WALL CONSTRUCTION
-SIZE WIDTH OF BUILT UP WOOD COLUMNS TO SUPPORT FULL WIDTH OF BEAM
-LINTELS OVER OPENING WIDER THAN 6'-0" REQ. ENGINEERED LVL BY MFR.
-LINTELS OVER OPENING UP TO 6'-0" REQ. 2-PLY 2X10 SPF LINTEL.

C3 EXT WALL TYP
FINISH SELECTED BY OWNER – VINYL SIDING
TYVEK OR SIM. AIR BARRIER
3/8" OSB SHEATHING
2X6 SPF 16" OC BASEMENT & MAIN FL / 24" OC 2ND FL
R22 BATT INSULATION
6 MIL CGSB POLYETHELENE VB
1/2" GYP WALL FINISH

C4 INT WALL TYP
1/2"(13) GYP
2X4 SPF 24" OC
1/2"(13) GYP
*INSTALL 2X4 BRACING IN KITCHEN WALL TO ANCHOR UPPER CABINETS.

7 THERMAL & MOISTURE PROTECTION

7 – A DAMP PROOFING
-DAMP PROOFING APPLIED TO EXTERIOR FOUNDATION WALL & FOOTING TO FINISH GRADE.
-DAMP PROOFING IS NOT REQUIRED ON THE INTERIOR FOUNDATION WALL IF AN INSULATED WALL AND VAPOUR BARRIER ARE INSTALLED.

7 – B ROOF
-ROOF SHINGLES & EAVE PROTECTION:
- -ASPHALT/FIBREGLASS SHINGLES STYLE SELECTED BY OWNER.
- -INSTALLED IAC MANFACTURERS SPECIFICATIONS.
- -NO 25 GLASS BASE SHEET OR BETTER PRODUCT EAVE PROTECTION 4" HEAD AND END LAP MIN.
- -COVER REMAINING EXPOSED ROOF DECK WITH 1 PLY UNDERLAYMENT MIN 2" HEAD LAP AND 4" END LAP PARALLEL TO EAVE PROTECTION.

-ROOF VENTILATION

-1/300 ATTIC VENTING REQ.
-CARDBOARD INSUL STOP TO ALLOW MIN 2" SOFFIT VENTILATION FULL PERIMETER OF ROOF.
-PFM FASCIA, VENTED SOFFIT, DRIP EDGE, GUTTER & DOWNSPOUTS.

7 – C VAPOUR BARRIER & FUME BARRIER
-DARK DASHED LINE REPRESENTS 6mil CGSB VB. LAP & SEAL ALL JOINTS & PENETRATIONS.
-EFFECTIVE FUME BARRIER & 5/8" FG INSTALLED BETWEEN THE ATTACHED GARAGE AND INT OF THE HOME. THE DOOR FROM HOUSE TO GARAGE SHALL BE INSTALLED WITH WEATHER-STRIPPING AND AUTOMATIC DOOR CLOSER.

7 – D INSULATION
-INSUL FLOOR JOIST CAVITY AT EXT WALL WITH 2-LAYERS R20 BATT INSUL & & 6 MIL VAPOUR BARRIER

CEILING INSUL TYP
FLAT CEILING: 18" - 24" DP (R50-70) BLOWN INSULATION
6 mil CGSB POLY VB

EXT WALL INSUL TYP
TYVEK OR SIM. AIR BARRIER
R22 BATT INSULATION
6 MIL CGSB POLYETHELENE VB

BASEMENT WALL INSUL AT CONCRETE TYP
LEAVE MIN ½ AIR SPACE FROM CONC WALL
2X6 SPF OR EQUIV SPACE CAN USE 2X3 OR 2X4 SPF 24" OC W/ R22 BATT INSUL
6 MIL CGSB POLYETHELENE VB

7 – D INSULATION – ENERGY CODE COMPLIANCE
SASKATOON SK **CLIMATE ZONE 7A**

***HRV REQUIRED**

FLAT CEILING INSUL TYP
(TARGET RSI MIN **8.67** RSIe W HRV; **10.43** RSIe NO HRV)
TOTAL EFFECTIVE RSI = **11.30** RSIe

CEILING INSUL. CALCULATION:
7/16” OSB ROOF SHEATHING
(11.1MM X 0.098RSI/MM = **0.11** RSIe)
18" DP BLOWN CELLULOSE ON FLAT SURFACES
(3.5” 88.9MM X 0.025RSI/MM =
2.22 RSI / **1.80** RSIe) REF. TABLE R3-1
(14.5” 368.3 MM X 0.025RSI/MM = **9.20** RSIe)
(**11.00** RSIe TOTAL)
1/2"(12.7) GYP CEILING FINISH
(12.7MM X 0.0063RSI/MM = **0.08** RSIe)
INT AIR FILM (**0.11** RSIe)

EXT WALL INSUL BATT TYP
(TARGET RSI MIN **2.97** RSIe W HRV; **3.08** RSIe NO HRV)
TOTAL EFFECTIVE RSI = **2.99** RSIe

WALL INSUL CALCULATION:

EXT AIR FILM (**0.03** RSIe)
3/8” OSB WALL SHEATHING (9.5MM X 0.0098RSI/MM = (**0.09** RSIe)
2X6 SPF 24" OC W/ 2X6 R22 BATT INSUL
(3.87 RSI / **2.67** RSIe) REF. TABLE WA-2
1/2"(12.7) GYP FINISH (12.7MM X 0.0063RSI/MM = (**0.08** RSIe)
INT AIR FILM (**0.12** RSIe)

JOIST CAVITY INSUL BATT TYP
-INSUL FL JOIST CAV(MIN**2.97**RSIeW HRV; **3.08** RSIe NO HRV)
3 INCHES R21 SPRAY FOAM INSUL. (**3.70** RSIe)

FOUNDATION WALL INSUL TYP
(TARGET RSI MIN **2.98** RSIe W HRV; **3.46** RSIe NO HRV)
TOTAL EFFECTIVE RSI = **3.14** RSIe

FOUNDATION WALL INSUL CALCULATION:

EXT AIR FILM (**0.03** RSIe)
8” CONC. WALL
(203.2MM X 0.0004RSI/MM = **0.08** RSIe)

LEAVE MIN ½ AIR SPACE FROM CONC TO 2X6 WALL (**0.16** RSIe)

2X6 SPF 24" OC W/ 2X6 R22 BATT INSUL
(3.87RSI / **2.67** RSIe) REF. TABLE WA-2

1/2"(12.7) GYP FINISH
(12.7MM X 0.0063RSI/MM = (**0.08** RSIe)

INT AIR FILM (**0.12** RSIe)

8 DOORS & WINDOWS
8 – A DOORS & FINISH HARDWARE
-ALL EXTERIOR & DOORS TO HAVE DEADBOLTS & WEATHERSTRIPPING
-SECURE EXTERIOR DOORS LEADING TO DECK UNTIL DECK & GUARDRAIL IS FULLY CONSTRUCTED.
-DOORS FROM GARAGE TO HOUSE W/ SELF CLOSURE DEVICE & WEATHERSTRIPPING

8 – B WINDOWS
-ALL BEDROOMS MUST HAVE AN OPENABLE WINDOW WITH AN UNOBSTRUCTED OPENING OF NO LESS THAN 15” (380)x 15” (380) AND A MAX TOTAL UNOBSTRUCTED OPENING OF NO MORE THAN 3.75 SQFT (0.35SQM)
-AWNING OPENINGS DO NOT MEET THE ESCAPE EGRESS REQ.
-REMOVEABLE SCREENS INSTALL ON ALL OPENING WINDOWS

9 FINISHES
9 – A INTERIOR FINISH
-PAINT & FLOORING FINISH, & MILLWORK SELECTED BY OWNER
-INT GUARDRAILS AT 3'-6” (1070) HT, INT HANDRAILS AT 3' (900) HT.
-ALL RAILS MUST HAVE NO MORE THAN 4” (100) SPACE BETWEEN VERT MEMBERS.
-PROVIDE SAFETY GLASS AROUND TUB & SHOWER ENCLOSURES ENTRACE SIDELIGHTS AND GUARDS WHERE APPLICABLE.
-BATHROOM MIRROR & TOWEL BAR INSTALLED IN ALL BATHROOMS.
-WINDOW DRESSINGS SELECTED BY OWNER.

9 – B EXTERIOR FINISH
-ACRYLIC PARGING FROM 6" BELOW FINISHED GRADE TO TOP OF FOUNDATION WALL
-EXT WALL FINISH STYLE SELECTED BY OWNER

* STUCCO (FINISH) *IF USED
-APPLY A LAYER OF TYVEK STUCCO WRAP LAPPED MIN 6" AND TAPED.
-APPLY A LAYER OF STANDARD TYVEK AIR BARRIER HOUSE WRAP.
-APPLY SELF FURRING METAL LATH OR ADHESIVE BASE COAT. (KEEP DRY & ALLOW TO CURE FOR 1 MONTH PRIOR TO FINISH STUCCO APPLICATION)
-APPLY 3/8IN. - 3/4IN. PORTLAND CEMENT OR SYNTHETIC STUCCO SYSTEM.

-PFM SOFFITS FASCIA GUTTERS & DOWNSPOUTS
-INSTALL NON-VENTED PFM SOFFITS ON ALL EAVES THAT ARE WITHIN 4' FROM PROPERTY LINE, INSTALL VENTED PFM SOFFITS ON ALL OTHER EAVES

10 FIREPLACE
OPTIONAL FIREPLACE SELECTED BY OWNER - NATURAL GAS FIREPLACE W/ ¾ HR FRR..

11 EQUIPMENT
11 – A GARAGE
O/H DOOR OPENER

11 – B UTILITY
WASHER & DRYER SELECTED BY OWNER.

11 – C KITCHEN
FRIDGE, STOVE & DISHWASHER SELECTED BY OWNER.

12 BUILT-IN CABINETS
-CABINETS SELECTED BY OWNER.

13 FIRE & HEALTH PROTECTION
-SMOKE ALARMS INSTALLED IN NOTED LOC'S BY PERMENENT CONNECTION TO AN ELECTRICAL CIRCUIT AND SHALL HAVE NO DISCONNECT SWITCH BETWEEN THE OVERCURRENT DEVICE AND THE SMOKE ALARM.
-CARBON MONOXIDE DETECTORS INSTALLED AT LOCATION OF SMOKE ALARMS.
-EFFECTIVE FUME BARRIER & 1/2" FG INSTALLED ON GARAGE SIDE OF SHARED EXT HOUSE WALL CONT W/ MUD & TAPED JOINTS.
-DOOR FROM HOUSE TO GARAGE SHALL HAVE WEATHER-STRIPPING AND AUTOMATIC DOOR CLOSER.
-RADON TRAP INSTALLED IN FOUNDATION DRAINAGE / SUMP SYSTEM..

14 PLUMBING
-ROUGH-IN PLUMBING FOR BASEMENT BATHROOM. VERIFY LOCATION WITH OWNER.

15 MECHANICAL
15 – A HEATING
-FURNACE TYPE & HWH TYPE SELECTED BY OWNER.
OPTIONAL -INSTALL IN-FLOOR RADIANT HEAT PIPING IN BASEMENT

SLAB – VERIFY FLOOR AREAS WITH OWNER PRIOR TO CONSTRUCTION.

15 – B VENTILATION

-HVAC DESIGNED BY SUPPLIER/INSTALLER.
-EXHAUST FAN IN EA WC AND ABOVE THE STOVE. DUCTING TO OUTSIDE OR TO HEAT RECOVERY UNIT.

15 – 3 AIR CONDITIONING

-CENTRAL AIR CONDITIONING – VERIFY INSTALLATION WITH OWNER.

15 – 4 CENTRAL VACUUM

-CENTRAL VAC CONDITIONING – VERIFY INSTALLATION WITH OWNER.

16 ELECTRICAL & COMMUNICATIONS

16 – A ELECTRICIAN

LICENSED ELECTRICIAN TO VERIFY ELECTRICAL PLAN WITH OWNER PRIOR TO INSTALLATION.

16 – B ELECTRICAL SYMBOLS:

TEL/CABLE/LAN JACK	VENT FAN / LIGHT
TEL.JACK	VENT FAN
CABLE JACK	LED UNDERCABINET LIGHT
LAN JACK	RECESSED LIGHT
220V AC POWER OUTLET	WALL MOUNTED LIGHT
110V AC POWER OUTLET	CEILING MOUNTED LIGHT
SWITCH	SWITCH/LIGHT WIRE