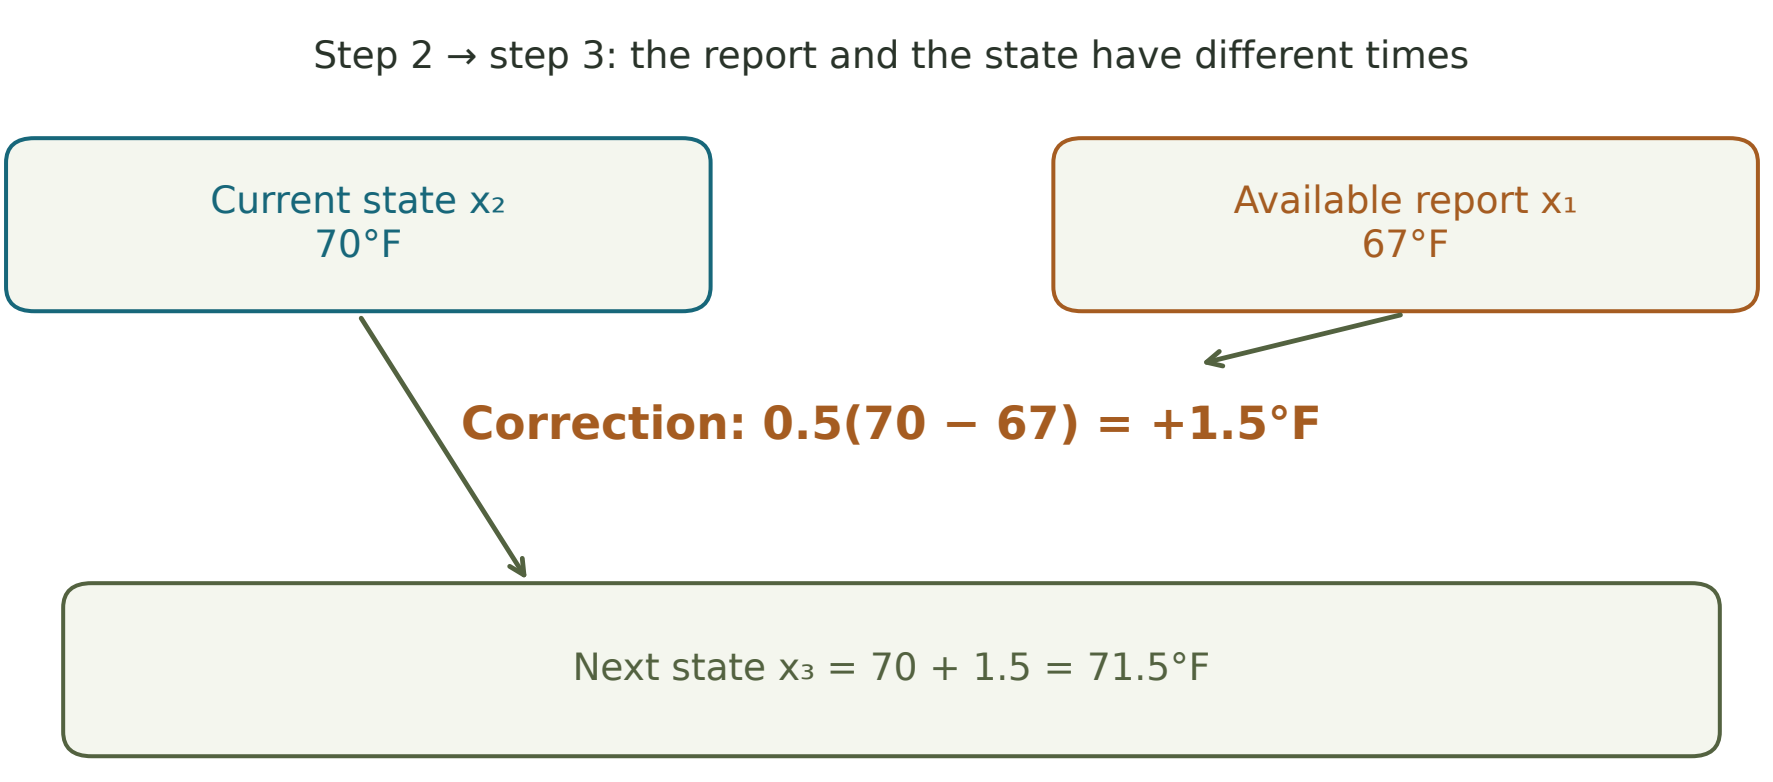
Step 2 → step 3: the report and the state have different times
Current state x₂
70°F
Available report x₁
67°F
Correction: 0.5(70 − 67) = +1.5°F
Next state x₃ = 70 + 1.5 = 71.5°F