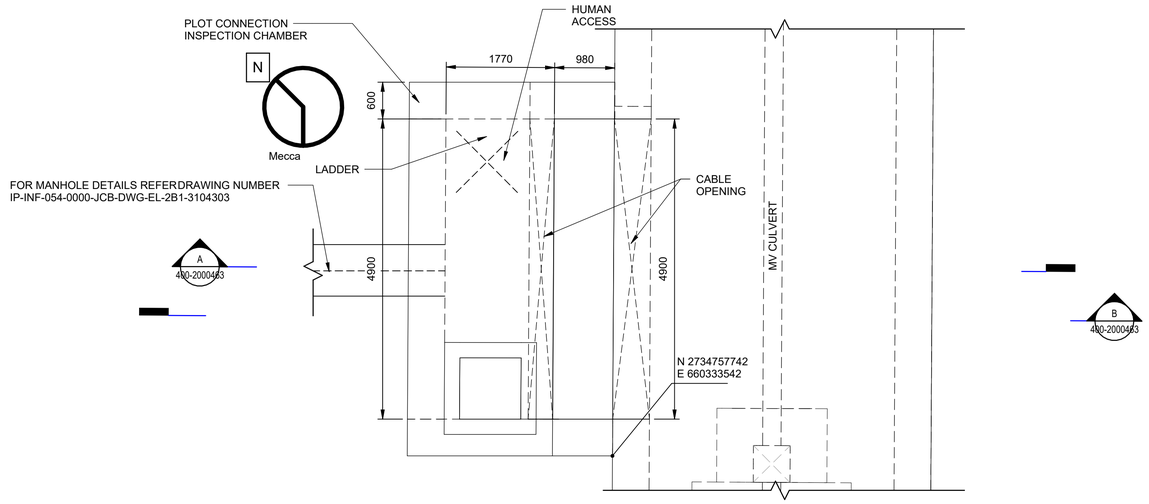

PLAN VIEW OF PLOT TO PLOT CONNECTION PC-03 (SPECIAL)

1 : 50

REFER DRAWING IP-INF-054-0000-JCB-DWG-ST-200-2000103 FOR LOCATION OF THE PLOT CONNECTION

CRANE BEAM NOT SHOWN FOR CLARITY

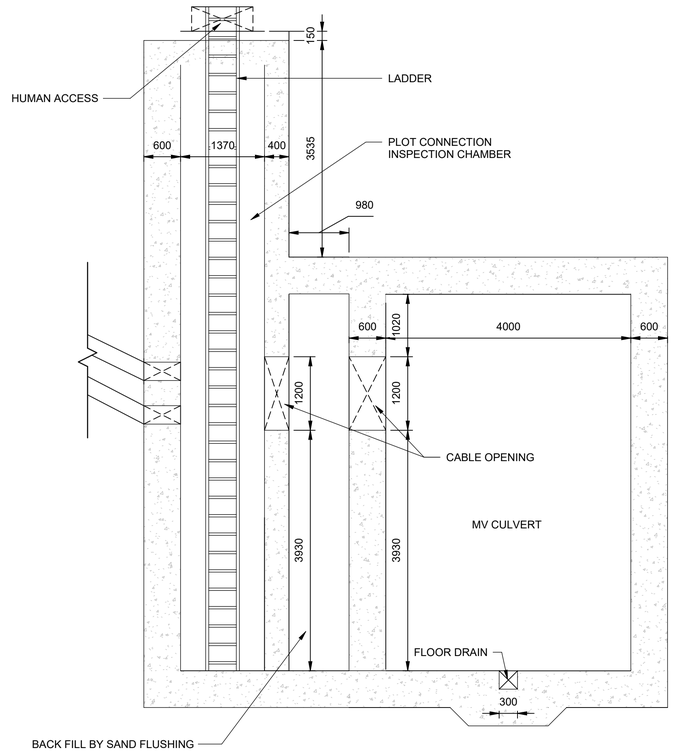

A
-
SECTION-A
1 : 50

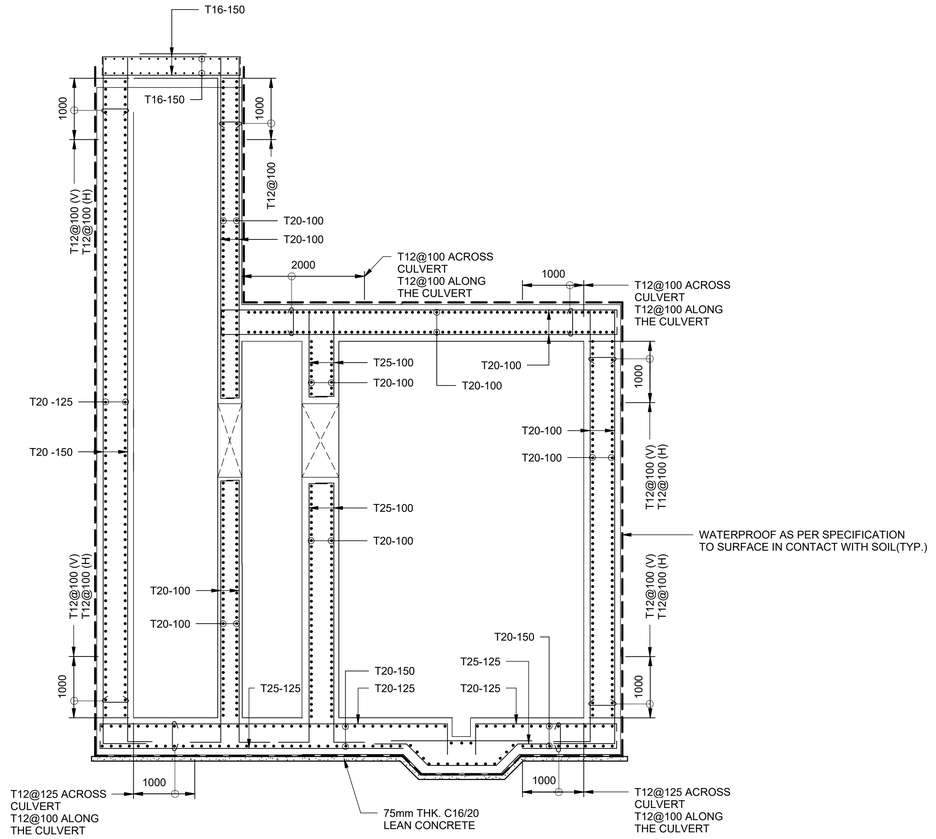

B
-
SECTION-B
1 : 50

KEY PLAN

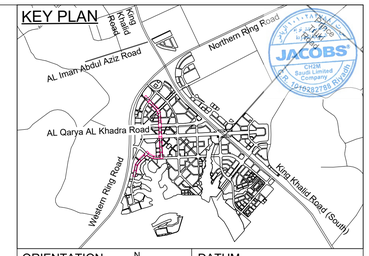

ORIENTATION

DATUM

GEODETIC DATUM: WGS-84
PROJECT SYSTEM: UTM
ZONE: 38N

GENERAL NOTES:

1. ALL LEVELS ARE IN METERS AND ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS SHALL BE CHECKED AND VERIFIED ON SITE BY THE SUB-CONTRACTOR/CONSTRUCTION CONTRACTOR AND ANY DISCREPANCIES SHALL BE REPORTED TO SITE-IN- CHARGE.
3. SAFE BEARING CAPACITY CONSIDERED IN DESIGN AS 700kN/m² AS PER GEOTECHNICAL DOCUMENT NO: IP-INF-053-0000-JCB-RPT-GE-000001.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER PROJECT ENGINEERING DOCUMENTS.
5. ALL REINFORCING STEEL WILL BE OF GRADE 60 .THE MINIMUM TENSILE YIELD STRENGTH FOR ALL REINFORCING STEEL BARS WILL BE 420 N/mm2 WITH A MINIMUM MODULUS OF ELASTICITY OF 200 KN/mm². STAINLESS STEEL DOWEL BARS SHALL BE OF GRADE 1.4401 (316) OR EQUIVALENT.
6. CONCRETE GRADE SHALL BE C35/45 WITH 28 DAYS CUBE STRENGTH AS 45N/mm2 AND MAXIMUM AGGREGATE SIZE AS 20mm.
7. MINIMUM CLEAR COVER TO REINFORCEMENT
   ALL CONCRETE ELEMENTS
   IN CONTACT WITH SOIL : 75mm
   FOR CONCRETE ELEMENTS NOT IN
   CONTACT WITH SOIL
   TOP SLAB : 40 mm
   COLUMN : 50mm
   BEAM : 50mm
8. MINIMUM LAP LENGTH SHALL BE 50 DIAMETER OF BAR.
9. FOR WALL CUTOUT SIZE AND LOCATION DETAILS REFER ELECTRICAL DRAWINGS PRIOR TO CONSTRUCTION.
10. FOR DETAILS OF DRAINAGE IN PLOT CONNECTION REFER DRAWING NUMBER IP-INF-054-0000-JCB-DWG-DR-400-3000003.
11. FOR OPENINGS EQUAL TO OR SMALLER THAN 200 MM REFER RELEVANT HVAC / IC / DRAINAGE / ELECTRICAL INFRA / ELECTRICALMEP / FLS DRAWING.

ABBREVIATION:

PC - PLOT CONNECTION

PROJECT STAGE: ISSUED FOR CONSTRUCTION

THE USE OF THIS DOCUMENT FOR CONSTRUCTION PURPOSES IS SUBJECT TO AND CONDITIONAL UPON RECEIPT OF THE APPROPRIATE STATUTORY AUTHORITY APPROVAL

DESCRIPTION	REV	DATE	AUTHORISED
ISSUED FOR CONSTRUCTION	01	10/04/2025	AAJ
ISSUED FOR CONSTRUCTION (CONDITIONAL)	00	10/02/2025	AAJ

PROJECT:

DIRIYAH GATE PHASE II & KING KHALID ROAD INFRASTRUCTURE DESIGN KINGDOM OF SAUDI ARABIA

CLIENT:

DIRIYAH COMPANY
8500 Prince Sattam Ibn Abdulaziz
Al Shohda Dist. AD DIRIYAH 12572 - 4000
Kingdom Of Saudi Arabia

LEAD CONSULTANT:

Jacobs
P.O. Box 360, Dubai U.A.E.
www.jacobs.com

SUBCONSULTANT:

PACKAGE:

DG II - INFRA PACKAGE - 1
DD-2023-118

DRAWING TITLE:

MV CULVERT
PC-03
PLOT TO PLOT CONNECTION DETAILS

DRAWN	CHECKED	VERIFIED	APPROVED	SIZE
MG	AD/SS	AS/VB	AAJ	A1
DATE: 10/04/2025	DATE: 10/04/2025	DATE: 10/04/2025	DATE: 10/04/2025	SCALE 1:50

DRAWING NUMBER: IP-INF-054-0000-JCB-DWG-ST-400-2000463 — **Rev** 01

FILE PATH: Autodesk Docs://0053_Infrastructure_KKR_Design/IP-INF-054-0000-JCB-DOE-ST-A00-1324664_(FC-)MVA.rvt