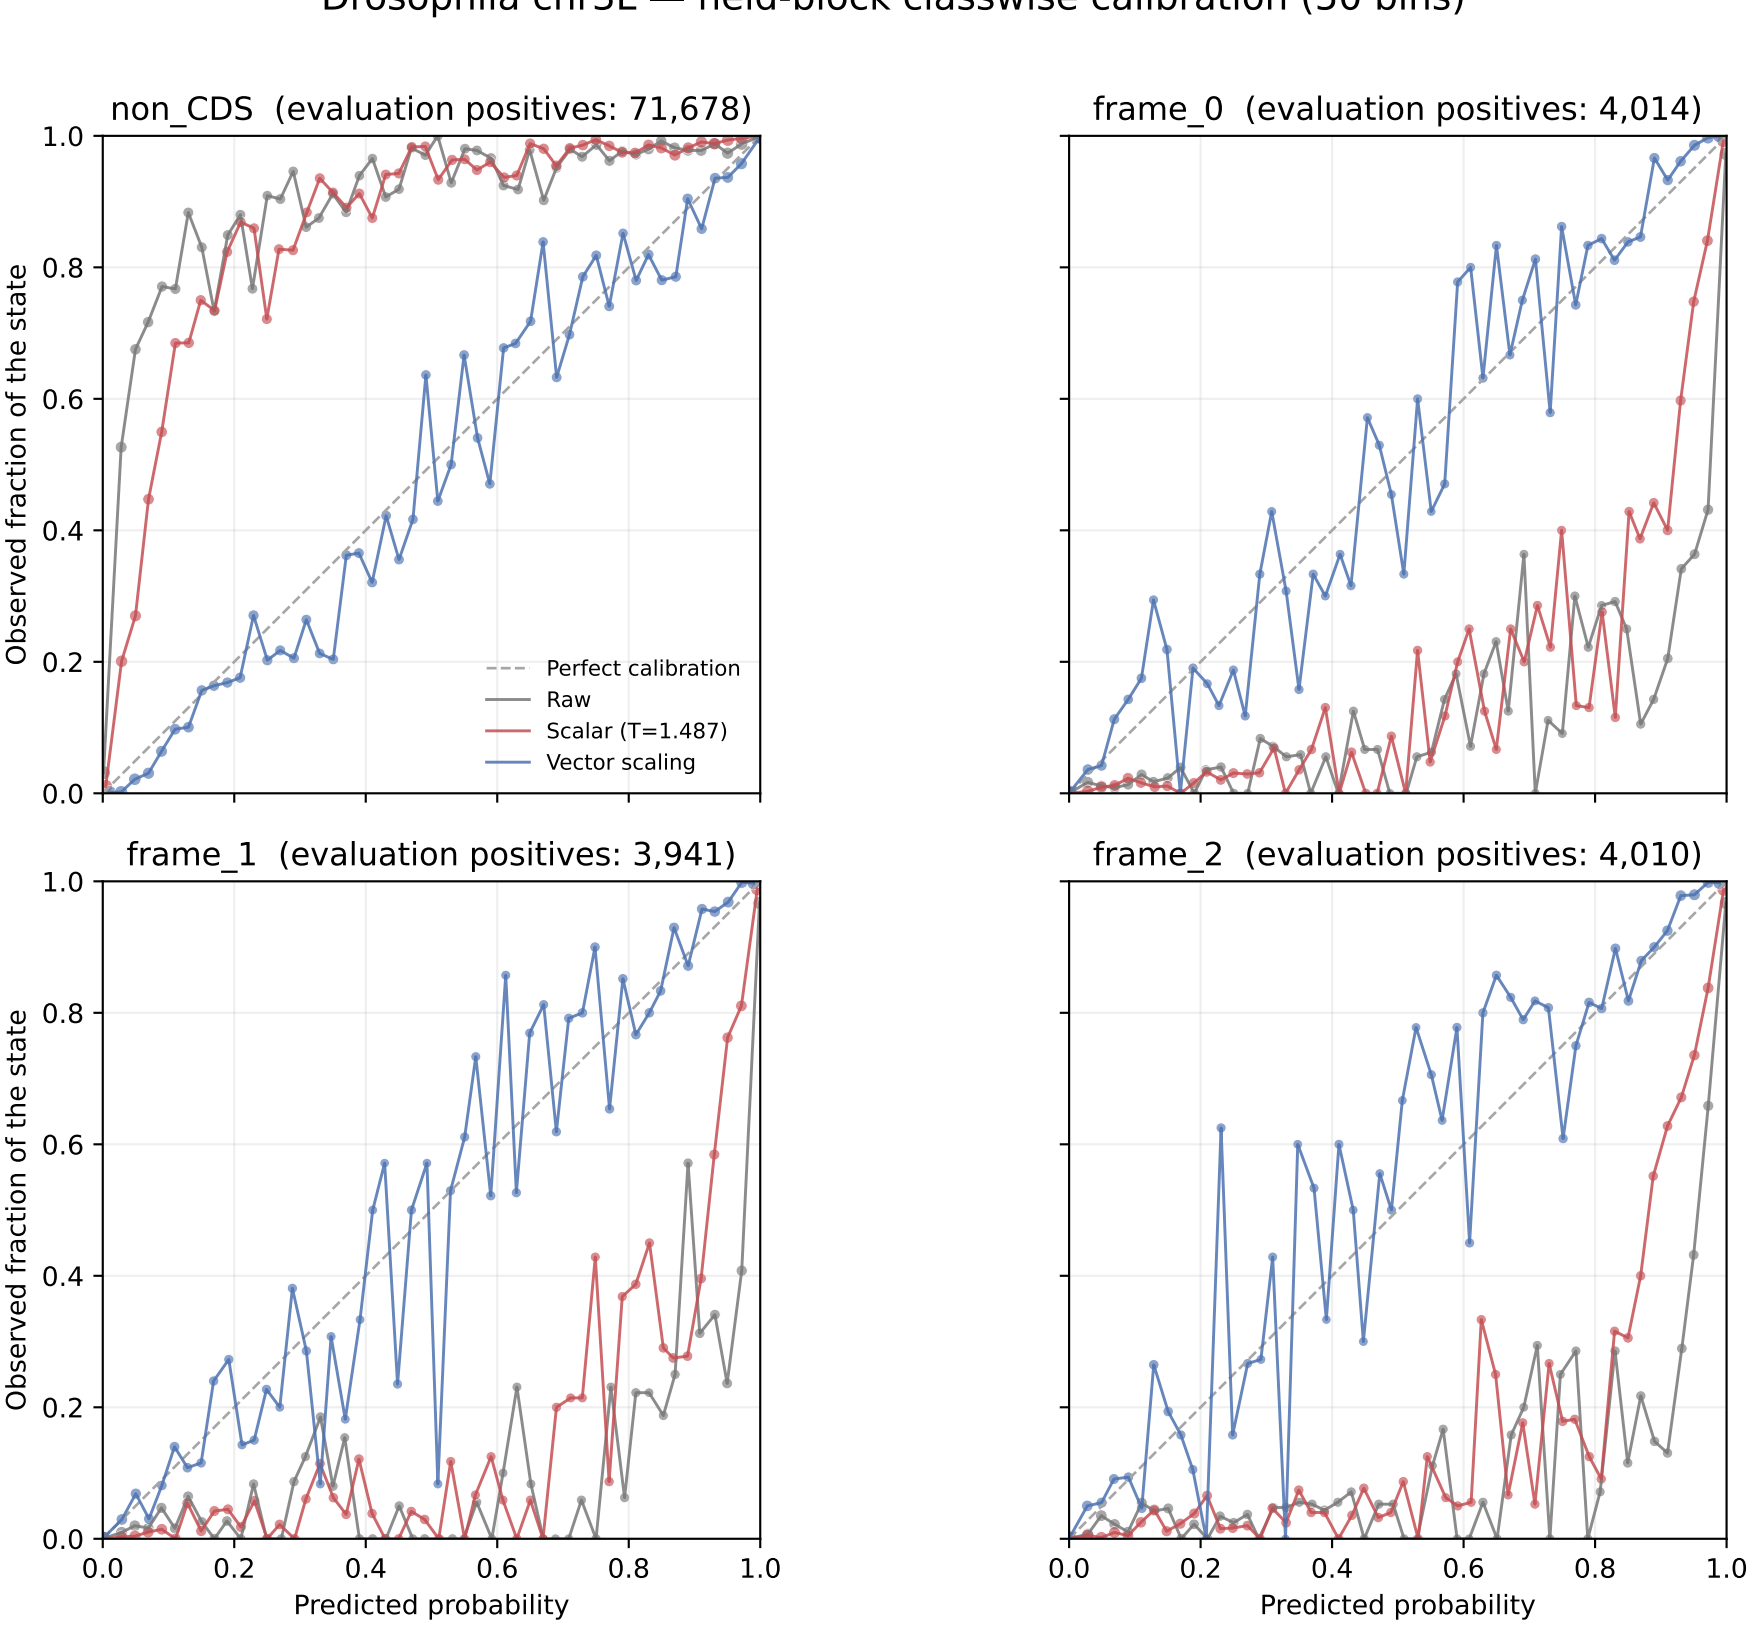

Drosophila chr3L — held-block classwise calibration (50 bins)
non_CDS (evaluation positives: 71,678)
frame_0 (evaluation positives: 4,014)
frame_1 (evaluation positives: 3,941)
frame_2 (evaluation positives: 4,010)
Observed fraction of the state
Predicted probability
Perfect calibration
Raw
Scalar (T=1.487)
Vector scaling
0.0
0.2
0.4
0.6
0.8
1.0
Calibration parameters fit on even 2-Mb blocks; curves use odd 2-Mb blocks only.