

Numerical investigation of low-load operation of a subcritical power boiler using CFD and process modelling

B.T. Rawlins, R. Laubscher, P. Rousseau

Department of Mechanical Engineering, Applied Thermal-Fluid Process Modeling Research Unit, University of Cape Town, Library Rd, Rondebosch, Cape Town, 7701, South Africa

** Department of Mechanical Engineering, Stellenbosch University, Stellenbosch Central, Stellenbosch, 7599, South-Africa*

Abstract

This paper uses co-simulation techniques which incorporate a computational fluid dynamic (CFD) model together with a process level model to investigate the low-load operation of a 620 *MWe* sub-critical boiler. A 1D discretized two-phase model of the water/steam circuit of the furnace, the radiant superheaters (SH) and the convective/back pass heat-exchangers was developed. This was coupled with a detailed CFD model incorporating the furnace and radiant superheaters using an Eulerian-Eulerian reference frame. The coupled model is used to investigate the combustion stability, the water/steam side effects and the radiant heat-exchanger operational limits for six burner firing arrangements for a minimal boiler load of 32 %. The results show that certain firing arrangements can lead to a high possibility of fire-side corrosion and the over-heating of heat exchanging components. Based on the numerical simulations carried out in terms of obtaining combustion stability, a favourable boiler utilization efficiency and the safe operation of heat exchanging components, a mixed firing arrangement accompanied with a higher secondary air (SA) mass flow-rate for non-firing burners was selected as the best case for the boiler under investigation.

*Corresponding author

Keywords: CFD, Boiler, Low-load operation, Co-simulation

Nomenclature

Symbols

\dot{Q}_{conv}	Convective heat transfer rate	W
\dot{Q}_{rad}	Radiative heat transfer rate	W
\dot{Q}_w	Wall heat transfer rate	W
A	Area	m^2
A_p	Particle surface area	m^2
A_c	Carbon pre-exponential factor	s^{-1}
A_{pn}	Projected particle surface area	m^2
A_{vol}	Volatile pre-exponential factor	s^{-1}
d_p	Particle diameter	m
E	Fluid total energy	J/kg
E_p	Particle emission power	W/m^3
$E_{a,c}$	Carbon activation energy	$J/kmol$
$E_{a,vol}$	Volatile activation energy	$J/kmol$
f_{heat}	Near surface char oxidation fraction	—
f_p	Forward scattering factor	—
G	Incident radiation	W/m^2
g	Gravitational constant	m/s^2
h_M	Mixture enthalpy	J/kg
h_{fg}	Enthalpy of evaporation	J/kg
h_{rxn}	Enthalpy of reaction	J/kg
J_k	Species diffusion flux	m^2/s

$m_{0,vol}$	Original mass of volatiles	kg
m_{char}	Mass of carbon	kg
m_{evap}	Mass of moisture	kg
m_{vol}	Mass of volatiles	kg
N_p	Number of particles	—
P	Perimeter	m
p	Pressure	Pa
p_{O_2}	Partial pressure of O_2	Pa
R	Universal gas constant	$J/molK$
R_c	Carbon reaction rate	s^{-1}
R_{diff}	Diffusion reaction rate	s^{-1}
R_{vol}	Volatile reaction rate	s^{-1}
t	Time	s
T_g	Gas temperature	K
T_p	Particle temperature	K
u	Velocity	m/s
V	Volume	m^3
x	Quality	—
Y_k	Species mass fraction	kg/kg

Greek symbols

α_g	Gas absorption coefficient	m^{-1}
α_H	Mixture void fraction	—
α_p	Particle absorption coefficient	m^{-1}
ϵ_p	Particle emissivity	—

ϕ	Scalar variable	—
ρ	Gas density	kg/m^3
ρ_g	Gas density	kg/m^3
ρ_l	Liquid density	kg/m^3
ρ_M	Mixture density	kg/m^3
ρ_p	Particle density	kg/m^3
ρ_{eff}	Effective density	kg/m^3
σ_p	Particle scattering coefficient	m^{-1}
σ_{SB}	Stefan-Boltzmann constant	W/m^2K^4

Abbreviations

<i>AR</i>	As-received
<i>ATT</i>	Attemperator
<i>CFD</i>	Computational fluid dynamics
<i>CFPP</i>	Coal fired power plant
<i>DAF</i>	Dry ash free
<i>EC</i>	Economiser
<i>EE</i>	Eulerian-Eulerian
<i>HHV</i>	Higher heating value
<i>MCR</i>	Maximum continuous rating
<i>PA</i>	Primary air
<i>RH</i>	Reheater
<i>RTE</i>	Radiative transport equation
<i>SA</i>	Secondary air
<i>SA – AH</i>	Secondary air - air heater
<i>SH</i>	Superheater
<i>WSGGM</i>	Weighted sum of gray gas model

1. Introduction

The use of coal-fired power plants (CFPP) to provide electricity generation is intended to be phased out in order to mitigate the ingress of climate change. However, the switch to sustainable generation sources poses great challenges for developing countries due to the long transition times and costs involved [?]. Due to the abundance of coal resource present in Southern Africa, CFPPs are the dominant power generation source, with approximately 80 % of the energy needs being met using CFPPs [?]. The promising integration of renewable energy and the decommissioning of old CFPPs in Southern Africa, will push these plants from a primarily base load operation to a mid-merit/flexible operating protocol. The switch to flexible operation will inherently mean CFPPs will need to operate at low-loads for continuous time periods.

Mathematical models that can accurately capture the thermal response of boilers at varying loads can be used to determine the safe and efficient operating limits [?]. Since, the long term deviation from design conditions can lead to operational inefficiencies affecting combustion stability [?], an increase in harmful emissions [?] and the localised overheating of heat-exchangers due to insufficient cooling being provided by the internal working fluid [?].

The full scale testing or experimentation of CFPPs is deemed to expensive to pursue, thus the use of computational fluid dynamics (CFD) allows for the modelling of a full-scale CFPPs, at steady-state, to be investigated at various loads circumventing the use of time-consuming and costly field tests. CFD simulations have been successfully used to model a variety of CFPP boiler types ([?], [?]) and cover various aspects such as pollution control ([?],[?]), gas-solid flow effects ([?]) and boiler retrofitting ([?], [?]).

Recent CFD studies investigating low-load operation of CFPP boilers have focused on the combustion stability, harmful emissions and the gas flow-solid flow interactions [?]. The works of Belosevic et al [?] found that the low-load operation of boiler considerably affect the flow and temperature fields, the flame geometry, chemical reactions and concentrations of combustion products.

Hernik et al [?] investigated the effects of using different mill system configurations at a minimum boiler load of 40 %. The most favourable mill system configuration was selected based on the case that exhibited suitable combustion stability and emission of harmful substances. Similarly, Chang et al [?] investigated the various firing arrangements of a 630 *MWe* tangentially fired boiler. A burner angle of -15 ° was found to be the optimal arrangement resulting in the best compromise in combustion stability and lower emissions. The aforementioned research specifically investigated combustion and gas-side effects. However, to the best of the authors' knowledge, no integration of 1-D process model has been used to investigate the steam side operational performance of a CFPP boiler at low-load.

The use of a 1-D process modelling approach have been used by researchers to investigate the water and gas side heat transfer interactions. These studies are usually used to investigate a transient event, such as a sudden disturbance, start-up or boiler load ramping [?]. Due to the non-uniformities found in CFPP furnaces which are composed of complex combustion dynamics, gas-solid interactions and radiation heat transfer phenomena, 1-D process models can not resolve the fireside with sufficient accuracy, but can adequately resolve the waterside energy and momentum transport in a computationally inexpensive manner.

The use of coupled simulations has proven to solve the deficiencies of a full 1-D process model by coupling the fireside CFD results to a 1-D water side model. Some recent papers that investigated boiler operations using a co-simulation approach are: Laubscher and Rousseau [?] conducted a comprehensive numerical study on the impact of particle radiation properties for high ash coals using ANSYS Fluent v19.2[®] and Flownex SE[®]. Yu et al [?] used a coupled simulation methodology to estimate the superheater (SH) metal temperatures of a 660 *MWe* tangentially-fired coal boiler.

The goal of the current work is to investigate the effect of burner firing configuration on various process parameters such as steam temperatures, spray water flow-rates and metal temperatures. The current work proposes the use

of CFD modelling to investigate the low-load gas-side effects at various firing conditions for a 620 *MWe* two-pass sub-critical boiler. For the current work CFD gas-side results are coupled to a comprehensive process model of the case study boilers water side.

The model was simulated for a boiler load of 32 % with 6 various firing combinations. To establish the accuracy of the CFD modelling approach a validation study was conducted for 100 %, 80 % and 60 % maximum continuous rating (MCR) loads and compared to actual plant measurements to quantify the model accuracy, this is highlighted in section ?? prior to the results of the low-load study.

2. Mathematical model

In this section the modelling techniques used by the study are briefly discussed.

2.1. Computational fluid dynamics modelling

2.1.1. Fluid flow, turbulence and combustion modelling

The flue gas was modelled using a Eulerian framework. The species transport modelling approach was used to approximate the mixture of chemical species in the gas phase. This approach solves a species continuity equation for each constituent present in the mixture. To reduce the computational burden it was assumed that the various processes were in steady-state. The governing equations for the gas phase are written in their respective Reynolds averaged forms as follows;

Mass conservation:

$$\frac{\partial}{\partial x_i}(\rho \bar{u}_i) = S_m. \quad (1)$$

Momentum conservation:

$$\frac{\partial}{\partial x_i}(\rho_{eff} u_i u_j) + \frac{\partial \bar{p}}{\partial x_j} = \frac{\partial}{\partial x_i} \left[\mu \left\{ \frac{\partial u_j}{\partial x_i} + \frac{\partial u_i}{\partial x_j} - \frac{2}{3} \delta_{ij} \frac{\partial u_i}{\partial x_i} \right\} \right] + \frac{\partial}{\partial x_i}(-\rho \overline{u'_i u'_j}) + S_m \quad (2)$$

Energy conservation:

$$\frac{\partial}{\partial x_i}(u_i[\rho E + p]) = \frac{\partial}{\partial x_j} \left[\lambda \frac{\partial T_g}{\partial x_j} \right] + S_h \quad (3)$$

Species transport:

$$\frac{\partial}{\partial x_i}(\rho u_j Y_k) = -\frac{\partial}{\partial x_j}(\vec{J}_k) + \sum_r R_{j,r} + S_k \quad (4)$$

$$k = 1, 2, 3 \dots N$$

To correctly account for the particle inertial effects on the gas phase convection, the model makes use of an effective density which is defined as follows;

$$\rho_{eff} = \frac{\rho \rho_p (\phi_{mp} + 1)}{\rho \phi_{mp} + \rho_p} \quad (5)$$

In the present study the realizable k- ϵ turbulence model was utilized to address the turbulence closure problem. This model has been successfully used by researchers ([?],[?] and [?]), in modelling the effects of coal-fired swirl
80 burners. The model generally produces higher accuracy results, when compared to the standard k- ϵ model, for problems incorporating swirling and separating flows.

The process of coal combustion comprises of four sequential steps. Namely, inert heating and evaporation of moisture, devolatilization, char oxidation and gas phase reactions. Equations (??) and (??) show the single rate kinetic model utilized in this study, to model the devolatilization process.

$$\frac{dm_{vol}}{dt} = R_{vol}(m_{0,vol} - m_{vol}) \quad (6)$$

$$R_{vol} = A_{vol} \exp \left(\frac{E_{a,vol}}{RT_p} \right) \quad (7)$$

$$A_{vol} = 2 \times 10^5 [s^{-1}] \quad E_{a,vol} = 6.7 \times 10^7 [J/kmol]$$

A devolatilization temperature of 553 [K] [?] along with the kinetic parameters (equation ??) of Sheng et al [?] were utilized in the present study. The char oxidation process is modelled using the diffusion-kinetics limited model developed by Baum and Street [?], which is given in equation (??). The product

species of the char oxidation reaction was set to CO as shown in equation (??).

$$\frac{dm_{char}}{dt} = -A_p p_{O_2} \frac{R_{diff} R_c}{R_{diff} + R_c} \quad (8)$$



The diffusion and kinetic rates of equation (??) are defined in equations (??) and (??) with the kinetic parameters again taken from the works of Sheng et al [?].

$$R_{diff} = \frac{5 \times 10^{-12}}{d_p} \left(\frac{T_g + T_p}{2} \right)^{0.75} \quad (10)$$

$$R_c = A_c \exp \left(\frac{E_{a,c}}{RT_p} \right) \quad (11)$$

$$A_c = 0.0053 [kg/m^2 s Pa] \quad E_{a,c} = 8.37 \times 10^7 [J/kmol]$$

The turbulence-chemistry interactions of the gas phase reactions were approximated using the eddy-dissipation-finite rate model used in ANSYS Fluent v19.5[®] which calculates three rates, namely chemical reaction rate, turbulent production eddies dissipation rate and reaction eddies dissipation rate, and uses the minimum of the three for the source terms calculations. A description of the CFD gas phase reactions of the boiler under consideration, using the same coal, was previously published in the works of Laubscher and Rousseau [?].

2.1.2. Particle modelling

The particles are modelled using a Eulerian reference frame, similar to the studies of Knaus et al [?] and Benim et al [?], who both successfully used a Eulerian-Eulerian (EE) model to capture the characteristics of coal combustion and furnace heat transfer with adequate accuracy. The pseudo particle mass concentrations transported into the domain are modelled using the general scalar field transport equation with the necessary modifications to account for heat and mass transport [?]. The pseudo-particles scalar fields are used to define the fuel characteristics based on the proximate analysis composition, namely consisting of moisture, volatile matter, fixed carbon and ash. Each of the scalar field equations are given in Table ??.

Table 1: Scalar field equation descriptions

Variable	Description	Transport equation
ϕ_{mp0}	Original/initial mass of particles	$\frac{\partial}{\partial x_i}(\rho u_i \phi_{mp0}) = 0$
ϕ_M	Moisture present in particles	$\frac{\partial}{\partial x_i}(\rho u_i \phi_M) = \frac{1}{V} \frac{dm_{evap}}{dt}$
ϕ_{VM}	Volatile matter present in particles	$\frac{\partial}{\partial x_i}(\rho u_i \phi_{VM}) = \frac{1}{V} \frac{dm_{vol}}{dt}$
ϕ_{FC}	Fixed carbon present in particles	$\frac{\partial}{\partial x_i}(\rho u_i \phi_{FC}) = \frac{1}{V} \frac{dm_c}{dt}$
ϕ_{ASH}	Ash present in particles	$\frac{\partial}{\partial x_i}(\rho u_i \phi_{ASH}) = 0$
ϕ_{hp}	Enthalpy of particle	Equation (??)

The energy transport of the pseudo particle phase, is transported by defining a particle phase energy equation, which in turn uses the particle enthalpy.

$$\frac{\partial}{\partial x_i}(\rho u_i \phi_{hp}) = \left(f_{heat} \frac{dm_c}{dt} h_{rxn} + \dot{Q}_{rad} + \dot{Q}_{conv} - \frac{dm_{evap}}{dt} h_{fg} \right) \frac{1}{V} \quad (12)$$

The equation accounts for all the processes associated with energy transport to the particle, namely convection (\dot{Q}_{conv}), radiation (\dot{Q}_{rad}), latent heat transport ($\frac{dm_{evap}}{dt} h_{fg}$) and near surface char oxidation ($f_{heat} \frac{dm_c}{dt} h_{rxn}$). This gives the model the ability to track the particle temperature in the domain, moving
105 the model away from the thermal equilibrium approach incorporated by previous studies using an EE approach ([?], [?] and [?]). The particle temperature is important in describing the sequential steps found in modelling combustion processes, especially at low boiler loads where mixing and ignition become problematic. To solve the additional transport equations and their source terms, C
110 programs were developed.

2.2. Heat transfer modelling modelling

Radiation heat transfer is the dominant form of heat transfer found in industrial furnaces [?] and is solved by applying the gray-participating-gas and particle medium configuration of the radiation transport equation (RTE) [?] shown in equation (??).

$$\frac{dI(\vec{r}, \hat{s})}{ds} = \alpha_g \frac{\sigma_{SB} T_g^4}{\pi} - (\alpha_g + \alpha_p + \sigma_p) I(\vec{r}, \hat{s}) + \frac{\sigma_p}{4\pi} \int_{4\pi} I(\vec{r}, \hat{s}) \Phi d\Omega \quad (13)$$

In the present work the RTE is solved using the P1 model. Ranade and Gupta [?] illustrated minimal differences between the two common radiation models (namely the P1 and discrete ordinates (DO)) for the resultant wall heat transfer rate values when modelling a 210 *MWe* CFPP boiler. The P1 radiation model can include the effects of particle absorption (α_p) and scattering (σ_p) as well as gas mixture absorption (α_g). The P1 model transport variable is the incident radiation flux (G), and can be written for a particle laden domain as:

$$\frac{\partial}{\partial x_i} \left(\Gamma \frac{\partial G}{\partial x_i} \right) = (\alpha_g + \alpha_p) G - 4 (\alpha_g \sigma_{SB} T_g^4 - \pi E_p) \quad (14)$$

$$\Gamma = \frac{1}{\alpha_g + \alpha_p + \sigma_p}$$

The flue gas absorptivity was calculated using the domain based weighted sum of gray gas model (WSGGM) using the coefficients determined by Smith et al [?]. The WSGGM accounts for the radiation emitted by tri-atomic gases, namely CO_2 , H_2O and SO_2 present in the flue gas stream. The Eulerian description of the terms α_p , σ_p and E_b are determined using the effective number of particles ($N_p = \rho \phi_{mp0} V / (\rho_p \pi \bar{d}_p^3 / 6)$) present in a cell. The equations for the radiative properties are given in equations (??) through (??).

$$\alpha_p = \frac{\epsilon_p A_{pn} N_p}{V} \quad (15)$$

$$\sigma_p = \frac{(1 - \epsilon_p)(1 - f_p) A_{pn} N_p}{V} \quad (16)$$

$$E_p = \frac{\epsilon_p \sigma_{SB} T_p^4 A_{pn} N_p}{V} \quad (17)$$

It is important to note that variable properties for (ϵ_p) and (f_p) were used, that are based on the correlations of Lockwood et al [?] and Yin [?] respectively.

115 2.3. Process simulation model

A 1D discretized model of the furnace evaporator, platen SH, final SH, and subsequent down stream heat-exchangers was developed using Flownex SE[®] 2021. The model simulates the internal convection heat transfer inside the tubes and the conduction through the tube walls. The model is able to simulate the

attenuation flows and momentum transport through the steam/water circuit. The heat-exchangers were modelled using a two-phase mixture approach, this assumes that the fluid properties, phase velocities and temperatures are uniform per cross-sectional area. The homogeneous mixture fraction and mixture density are defined in equations (??) and (??) respectively.

$$\alpha_H = \frac{\rho_l x}{\rho_l x + \rho_g(1 - x)} \quad (18)$$

$$\rho_M = (1 - \alpha_H)\rho_l + \alpha_H\rho_g \quad (19)$$

Applying the mixture density the following transport equations are solved per process model component;

$$\frac{\partial}{\partial t}(\rho_M A) + \frac{\partial}{\partial s}(\rho_M A u) = 0 \quad (20)$$

$$\frac{1}{A} \frac{\partial}{\partial t}(\rho_M A u) + \frac{1}{A} \frac{\partial}{\partial s}(\rho_M A u^2) = -\frac{\partial p}{\partial s} - \frac{\tau_w P}{A} - \rho_M g \frac{\partial z}{\partial s} \quad (21)$$

$$\begin{aligned} \frac{\partial}{\partial t}(\rho_M h_M) + \frac{1}{A} \frac{\partial}{\partial s}(\rho_M A u h_M) + \frac{1}{2} \frac{\partial}{\partial s}(\rho_M u^2) + \frac{1}{2A} \frac{\partial}{\partial s}(\rho_M A u^3) = \\ \frac{\partial p}{\partial t} + \frac{\dot{Q}_w}{V} - g \rho_M u \frac{\partial z}{\partial s} \end{aligned} \quad (22)$$

The process model is used to determine the required attenuation flow rates in order to achieve the exit steam conditions, the boiler efficiency, and the steam generated for each case. The results of this model aid in determining the best firing combination of burner rows for continuous low-load operation, and the effects the various Cases have on the water-side of the boiler system.

3. Case study boiler description & set-up

In this section the numerical model configuration, for both the CFD and process model, will be explained, covering the boiler geometry, the process model set-up, the various modelling inputs (i.e. fuel characteristics and boundary conditions) and the numerical solution strategy.

3.1. Geometry & process model set-up

The modelled boiler is a two-pass sub-critical power boiler with a furnace
 130 depth of 13.77 [m], a width of 14.01 [m] and a height of 64 [m]. The CFD
 geometric model (of Figure ??) makes use of a symmetry plane at half the
 width of the furnace. This was done to reduce the cell count of the numerical
 mesh. Both the platen and final SH are modelled as walls, with transverse
 pitches of 1.143 [m] and 0.8 [m] respectively. There are three levels of burners
 135 located on both the front and rear walls at heights of 11.9 [m], 19.3 [m] and 26
 [m]. Figure ?? shows the modelled half of the furnace along with the locations of
 the platen SH, final SH, boundary walls (front, rear and side) and the domains
 outlet and inlets.

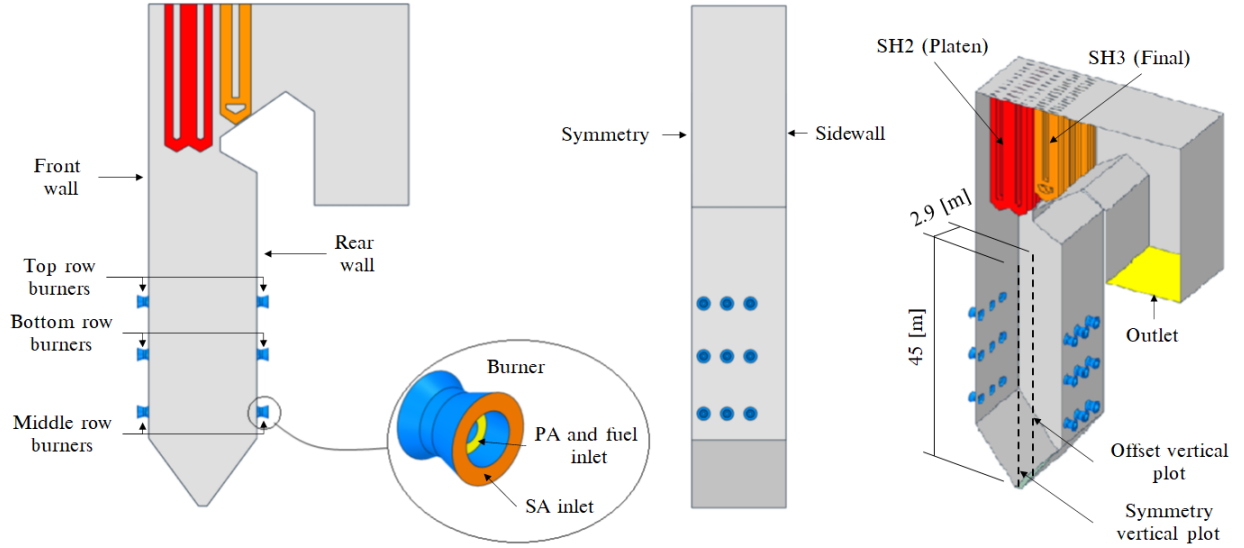


Figure 1: Boiler geometry and layout

140 The boiler furnace is fed by 6 mills, each supplying pulverised fuel and
 primary air (PA) mixture to a burner row consisting of 6 burners. This mixture
 is injected through the inner burner annulus while the secondary air (SA) is fed
 through the outer annulus as seen Figure ??.

The process model of the boiler configuration is shown in Figure ?? . The
145 process model includes all the heat-exchangers up to and downstream of the final
SH, which include the secondary reheater (RH2), primary SH (SH1), primary
reheater (RH1), economiser (EC) and the SA air heaters (SA-AH). The model
includes all the relevant attenuators (ATT1, ATT2 and ATT-RH), inlets and
outlets. The process model is used to determine the required attenuation
150 flow-rates and water/steam side thermal response. The furnace water-walls are
represented by a single lumped pipe flow component and forms part of the
natural circulation system which include the downcomers and steam drum. As
with the furnace walls, the platen and final SHs are similarly represented by a
single lumped parameter pipe flow component, interconnected with nodes that
155 introduce the attenuation flows to the water/steam side.

The coupling interface between the simulation models are the heat-exchanger
external tube surfaces, namely the furnace, platen and final SH walls. The CFD
heat loads are used as energy sources for these components as indicated in Figure
??. The furnace heat load to the evaporator walls determines the circulation
160 rate through the evaporator. The steam drum separates the gas from the liquid,
with the liquid water being recirculated through the evaporator and the gas
(steam), with a quality greater than 1, being sent through the main steam line
for superheating. Thus the steam generation is calculated. Furthermore, the
CFD flue-gas results (i.e. composition, mass flow and temperature) exiting the
165 final SH are used as boundary inputs for the heat-exchangers downstream of
the final SH (SH3), as shown in Figure ??. The steam flow boundary values for
the RH and EC sections are fixed mass inlet flows and temperatures with the
corresponding outlets set to a fixed pressure.

Figure ?? illustrates the heat-exchanger process model component. This
170 component is used for the heat exchangers downstream of SH3 (refer to Figure
??. The component model is able sufficiently account for the radiative (gas and
direct), convective and conduction heat transfer mechanisms to and from the two
control volumes. The total heat transferred to the water-side CV can be written
as the sum of the absorbed direct radiation and the combined convective and gas

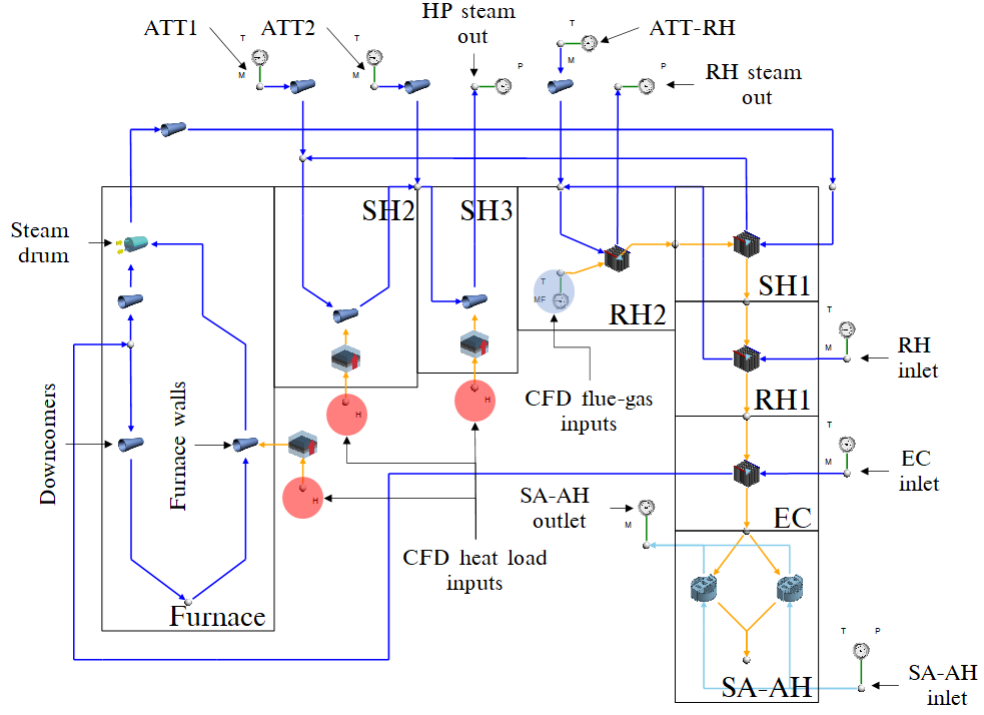


Figure 2: Process model of boiler set-up including the downstream convective components using Flownex SE 2021

radiation (i.e. $\dot{Q}_{steam} = \dot{Q}_{abs} + \dot{Q}_{cr}$). The external heat transfer coefficient, from
the flue-gas to the heat-exchanger walls makes use of the Gnielinski correlation
[?] for the various heat-exchanger tube arrangements. Figure ?? incorporates
the direct radiative interactions in each heat-exchanger, highlighting that the
portion of direct radiation not absorbed by the heat exchanger is joined by
the bypass radiation (\dot{Q}_{bypass}) of the flue-gas control volume which together
contribute to the downstream components input direct radiation. The use of
this component proved extremely valuable in capturing the thermal response of
the boiler at low-load.

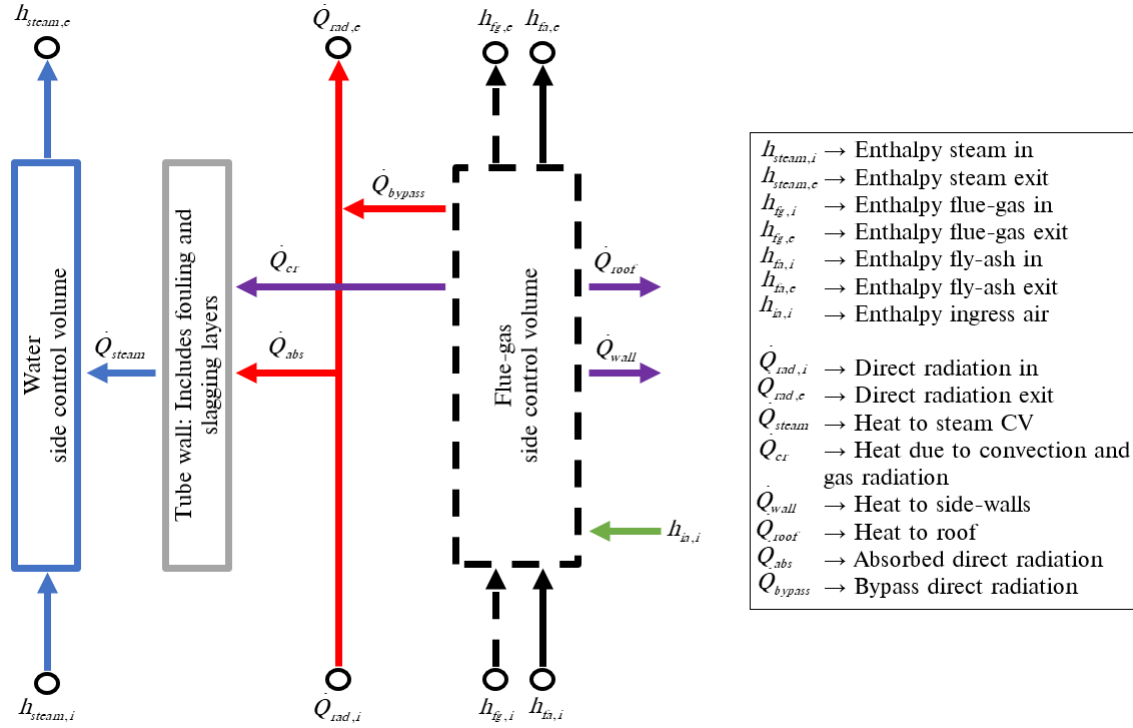


Figure 3: Heat-exchanger component model

3.2. Model inputs

185 Table ?? presents the coal characteristics utilized in the current study along with the fuels higher heating value (HHV).

For a 32 % boiler load the current operational protocol is the to use the bottom front and rear burner rows to meet the low-load demand during start-up. For this study six Cases are simulated in total with the following three
190 burner firing configurations being investigated:

1. Bottom front and rear row burners are fired (Case 1 & Case 4)
2. Middle front and rear row burners are fired (Case 2 & Case 5)
3. Bottom front and middle rear row burners are fired (Case 3 & Case 6)

195 Typically 5 [kg/s] of air is fed through the non-firing burners, to ensure

Table 2: Utility boiler fuel characteristics

Fuel constituent	Fraction	Unit
<i>Ultimate analysis - (DAF)</i>	-	-
Carbon	0.7753	kg/kg_{fuel}
Hydrogen	0.0415	kg/kg_{fuel}
Nitrogen	0.0181	kg/kg_{fuel}
Oxygen	0.1474	kg/kg_{fuel}
Sulphur	0.0175	kg/kg_{fuel}
<i>Proximate analysis - (AR)</i>	-	-
Fixed carbon	0.340	kg/kg_{fuel}
Volatile matter	0.196	kg/kg_{fuel}
Ash	0.4090	kg/kg_{fuel}
Moisture	0.0550	kg/kg_{fuel}
Energy content - (DAF)	Value	
Higher heating value	15070	kJ/kg_{fuel}

sufficient cooling of the burner and mixing of fuel and air in the combustion chamber. The result is a high air-fuel ratio in the furnace which leads to higher dry gas losses. to lower this loss, this study will investigate the affect of reducing the air-fuel ratio by lowering the non-firing burner SA flow-rate from 5 to 2.5 $[kg/s]$. Two permutations of the SA flow rate, at the non-firing burners, are used for each of the firing configurations mentioned above. Table ?? shows the input conditions for Cases 1 to 6. The data is the result of a boilers mass and energy balance calculation.

3.3. Numerical solution strategy

The CFD simulations were performed using ANSYS Fluent v19.5[®] pressure-based solver. The pressure-momentum coupling utilised the SIMPLE method. Second-order upwinding was used to discretize the momentum, energy and species equations, whereas PRESTO! was used to discretize the pressure equa-

Table 3: Case 1 to 6 model inputs on a per burner basis.

Active burners	Cases 1 - 3	Cases 4 - 6
Fuel flow-rate [kg/s]	3.14	3.14
PA flow-rate [kg/s]	4.95	4.95
SA flow-rate [kg/s]	14.85	14.85
Non firing burners		
SA flow-rate [kg/s]	5.0	2.5
Input air temperatures		
PA [K]	373	373
SA [K]	520	510

tion. The scalar field equations used a second-order upwind scheme.

210 The spatial discretization for all fields (except pressure) was set to first-order upwind for the first 1000 iterations to ensure a stable solution, after which the discretization order was increased to the above mentioned criteria. For all Cases the maximum mass imbalance was 0.024 [kg/s] for a total gas flow-rate of 190 [kg/s] and a heat imbalance of 1770 [kW] for a total heat input of 283 [MW].

215 The remaining fields were solved till convergence.

4. Results & discussion

4.1. Model validation

The validation of the proposed model was conducted for three steady-state MCR loads of 100 %, 80 % and 60 %, where actual plant measurements are

220 used to calculate the thermal heat loads of the three heat-exchangers, namely the furnace, platen and final SH, to quantify the accuracy. The model inputs and boundary conditions can be obtained from the study conducted by Laubscher and Rousseau [?], where using the same boiler of the present study, they evaluated the thermal performance of the heat exchanging components at full

225 and reduced boiler loads.

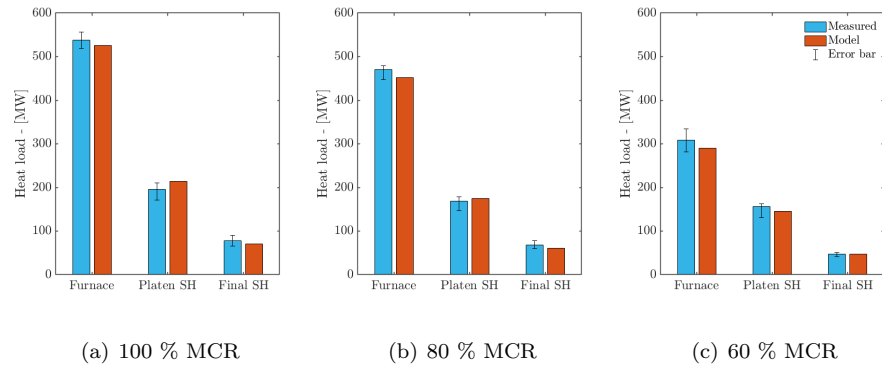


Figure 4: Comparison of experimentally calculated and model heat loads for the furnace, platen SH and final SH

In Figure ?? it is shown that the overall heat loads are in good agreement with the calculated results. For the simulated validation loads the proposed model results are within the associated error band, the general trend is an under prediction on the furnace heat loads, with a maximum percentage error of 2 %, and an over prediction on the platen SH, with a maximum percentage error of 7 % . The pendant SH illustrate the best comparable results for all load Cases.

The CFD model was further validated by comparing the CO_{ppm} and X_{O_2} measurements against the CFD results. The probe measurements were taken at a furnace height of 37.5 [m] near the center of the boiler during a full load (100% MCR) operating conditions. The probe is inserted from the side walls to a depth of 4.5 [m], measurements were taken every 0.5 [m].

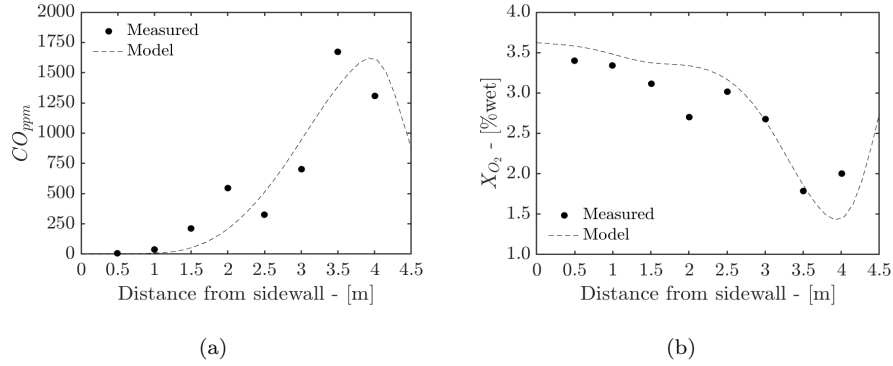


Figure 5: Experimentally calculated CO_{ppm} (a) and X_{O_2} (b) concentration predictions

Figure ?? shows the averaged measurement values compared to the CFD predictions. It can be seen that the CFD model can sufficiently resolve the CO_{ppm} and X_{O_2} concentrations at the given probe location.

4.2. Simulation results for various burner firing arrangements at 32% MCR

The temperature and velocity profiles for the various firing arrangements are shown in Figures ?? and ?? respectively. When the middle burner rows firing (Cases 2 and 5) a substantial cold region is formed in the lower half the furnace, resulting in the lowest heat uptake. This is further exacerbated when considering Table ?? where it is illustrated that the mid-firing arrangements produce the lowest steam flow rates resulting in the lowest boiler efficiencies. The bottom firing arrangement (Cases 1 and 4) results in a high temperature zone located in the bottom half on the burner, while the mixed firing arrangement (Cases 3 and 6) results in an even distribution of high temperature gases across the furnace domain (Figure ??). This leads to the highest steam generation rate in the furnace and boiler efficiency as shown in Table ??.

Table 4: Process model control parameters

	Cases					
	1	2	3	4	5	6
Main steam flow-rate [kg/s]	175.8	172.9	180.5	180.2	179.1	184.1
Main steam exit temp [$^{\circ}C$]	535	535	535	535	535	535
RH steam flow rate [kg/s]	158.2	155.6	162.5	162.2	161.2	165.6
RH steam exit temp [$^{\circ}C$]	524	527	531	512	510	520
Boiler efficiency [%]	85.3	84.1	87.9	87.2	85.9	89.1
ATT1 [kg/s]	10.4	16.9	13.9	7.9	5.5	10.9
ATT2 [kg/s]	1.7	3.8	4.2	3.8	3.6	4.2
ATT-RH [kg/s]	0.0	0.0	0.0	0.0	0.0	0.0

Figure ?? illustrates the heat flux profiles for the simulated cases. Both cases 1 and 4 highlight high heat flux zones near the burner inlets which, in the presence of high temperatures and incomplete combustion near these regions, can lead to high-temperature corrosion [?]. An even distribution of unit heat

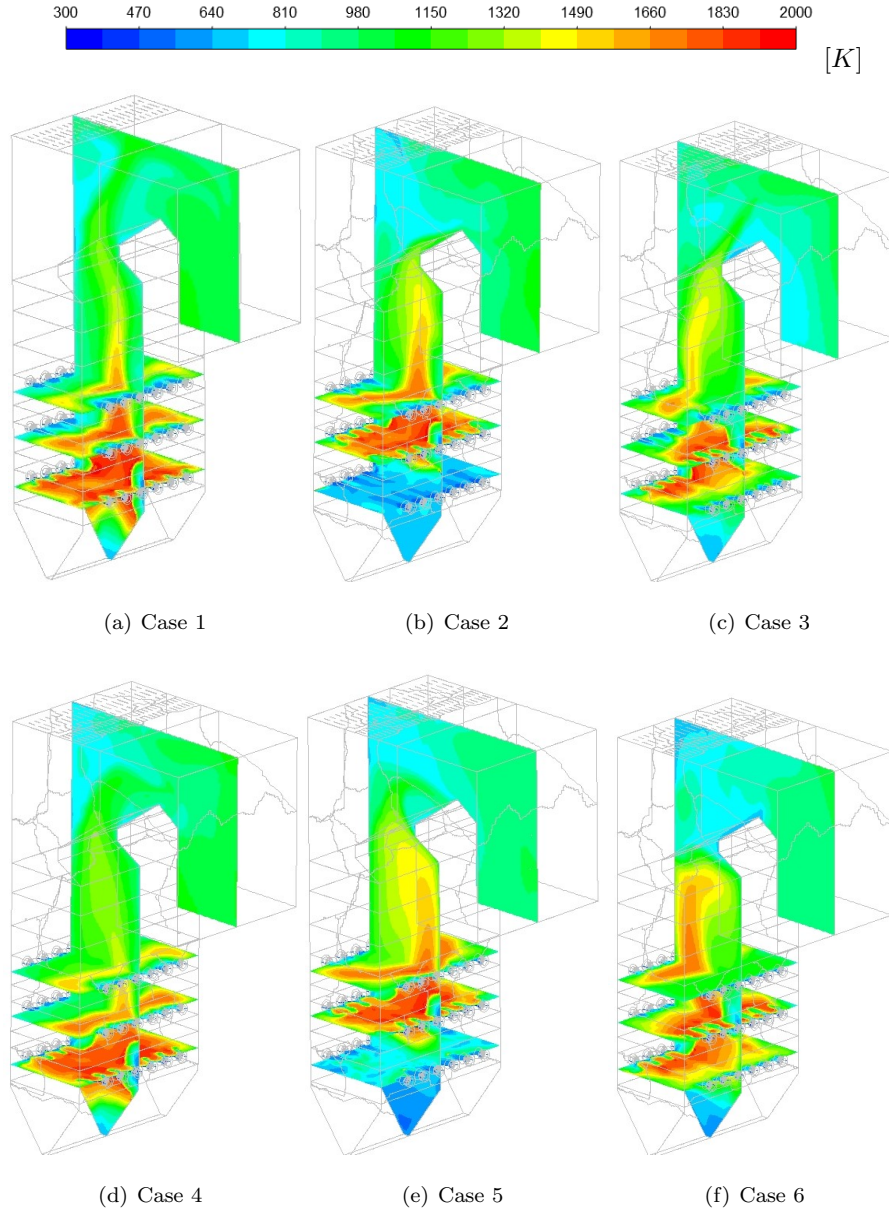


Figure 6: Temperature fields for Cases 1 through 6 [(a)-(f)]

fluxes is seen in Cases 3 and 6 with minimal localised heat flux concentrations being observed. Cases 2 and 5 show that most of the unit heat fluxes are absorbed in the upper half of the boiler with case 5 showing a higher heat flux

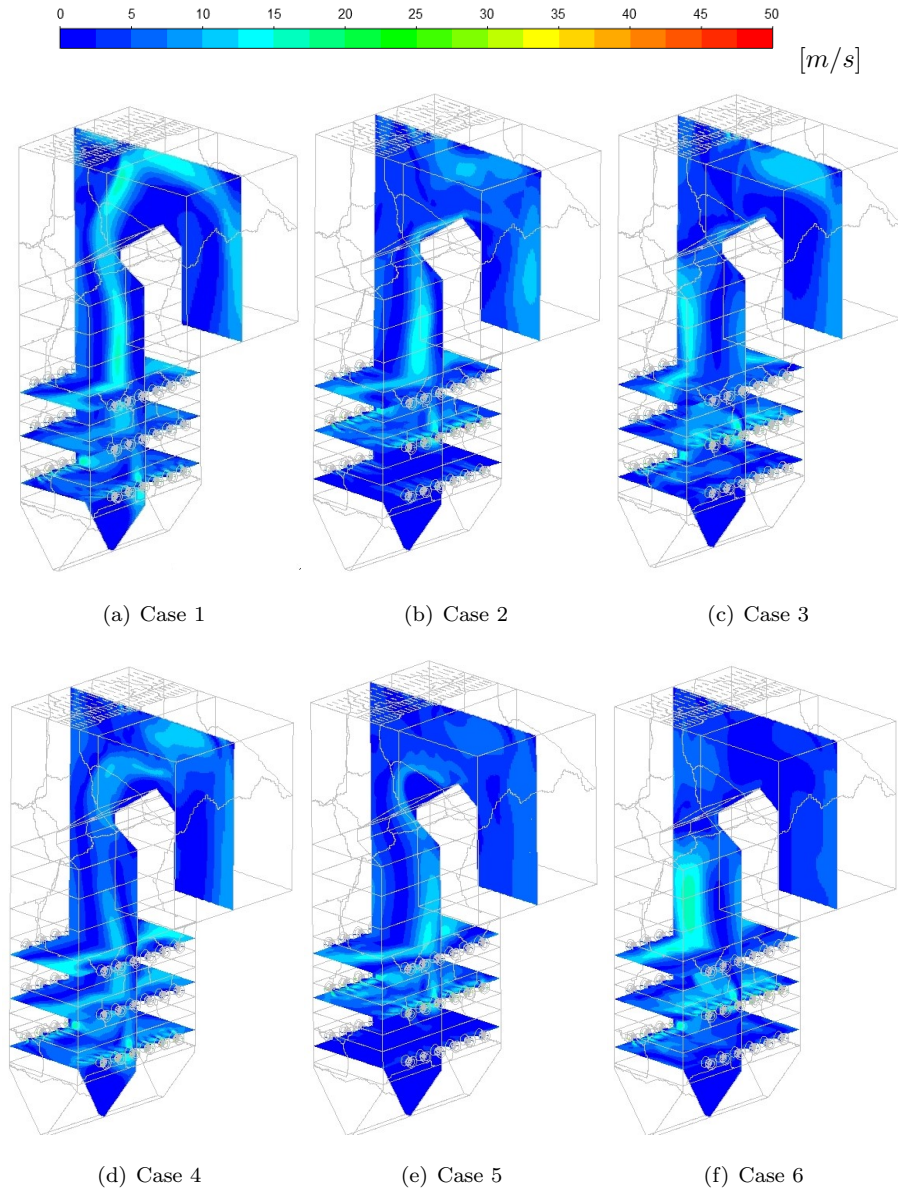


Figure 7: Velocity fields for Cases 1 through 6 [(a)-(f)]

on the rear wall. This could be due the use of a lower SA flow-rate leading to higher velocity profiles developing closer to the rear wall, as seen in Figure ??.

With this is mind a lower SA flow-rate, in general leads to hot gases and velocity

profiles impinging closer to the furnace walls, which can be seen in Cases 4, 5
 and 6 of Figures ?? and ?? respectively. With high gas temperatures and high
 velocity impingement, Cases 4, 5 and 6 (of Figure ??) experience concentrated
 heat fluxes around the burner inlets in comparison to corresponding Cases 1, 2
 and 3.

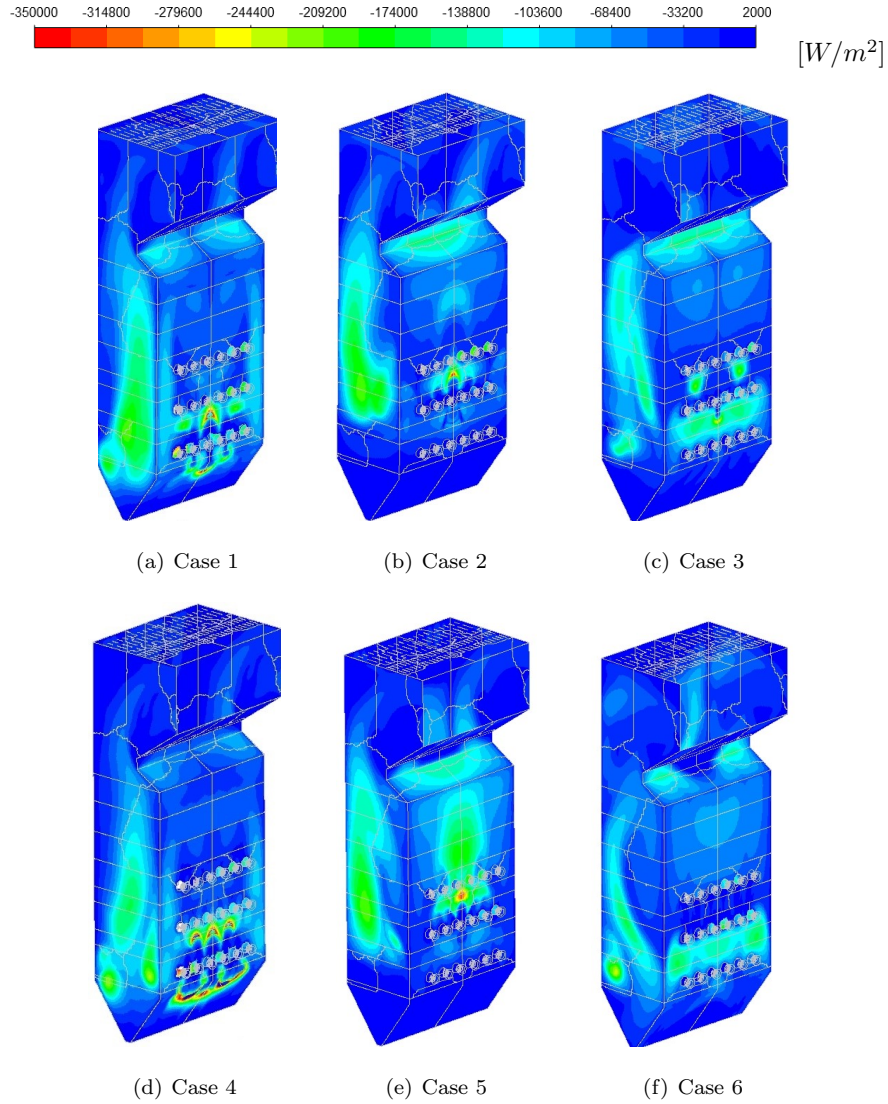


Figure 8: Heat fluxes profiles for Cases 1 through 6 [(a)-(f)]

The works of Dugum et al [?] , highlights the issue of high-temperature
corrosion caused by significant levels of CO (X_{CO} 0.01 - 0.1) and no-free O_2
near regions of high wall temperatures. For low-load operation this phenom-
ena becomes important to avoid since combustion instability can lead to these
non-ideal circumstances. Figure ?? shows the CO molar concentration in the
domain located on an iso-surface set 1600 [K]. The figures generally highlight
the location and distribution of the flame core for each case. Cases 1 and 4 il-
lustrate the highest likelihood of high-temperature corrosion occurring near the
furnace hopper, due to the high concentration and temperatures in that region.

Investigating the combustion stability for all the Cases, the symmetry and
offset vertical probe plots (as highlighted in Figure ??) are given in Figure ??.
Cases 2 and 5 illustrates the highest X_{O_2} concentration in the lower half of
the burner since there is minimal combustion occurring. The unburnt carbon
content and exit flue-gas temperatures for each case are reported in Table ??.
With the use of the middle burners (Cases 2 and 5) the highest exit temperature
and unburnt carbon content is observed, since the flame core is located in the
upper half of the furnace leading to the least possibility of complete combustion
due to the shorter residence time. Cases 3 and 6 exhibit the best characteristics
with the least amount of unburnt carbon content being observed. It is important
to note the effects of a lower SA mass flow rate has on the furnace exit conditions
for non-firing burners which generally leads to a hotter exit gas temperature as
seen with Cases 4 to 6.



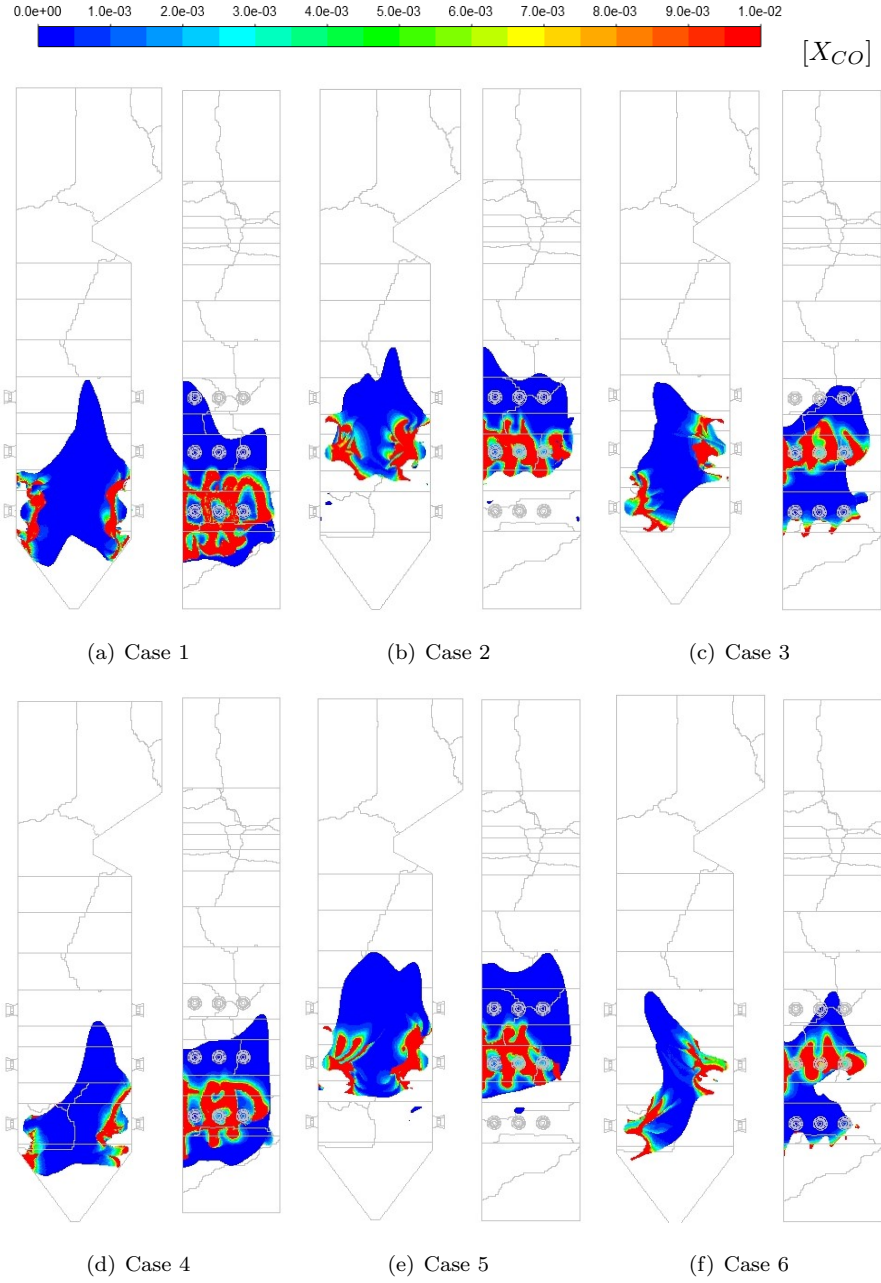



Figure 9: CO molar fraction (X_{CO}) concentrations for Cases 1 through 6 [(a)-(f)] on a temperature iso-surface of 1600 [K]

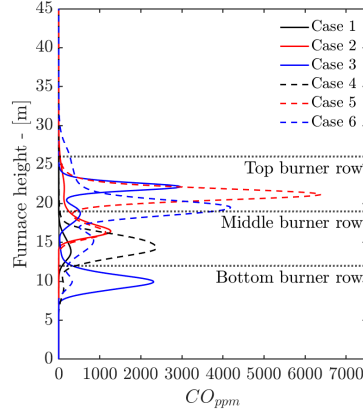


(a) Symmetry vertical plot

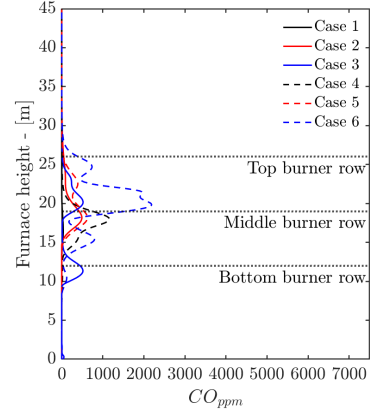

(b) Offset vertical plot

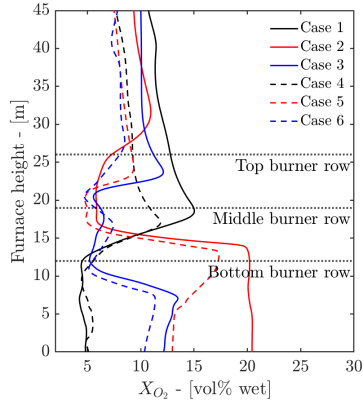

(c) Symmetry vertical plot

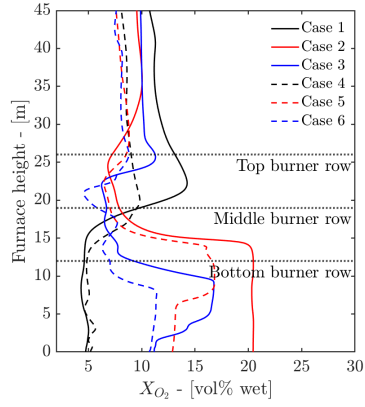

(d) Offset vertical plot

Figure 10: CO_{PPM} [(a) and (b)] and X_{O_2} [(c) and (d)] line plots on symmetry and offset vertical probe lines

Table 5: Furnace exit conditions and SH wall temperatures

	Cases					
	1	2	3	4	5	6
<i>Furnace exit</i>						
Exit temperature [K]	1168	1230	1215	1208	1306	1298
Unburnt carbon [$(\times 10^{-3})\%$]	1.83	1.94	1.54	1.81	1.89	1.62
<i>Platen SH</i>						
Max wall temperature [$^{\circ}C$]	477	492	481	480	493	490
Mean wall temperature [$^{\circ}C$]	439	453	446	454	442	451
<i>Final SH</i>						
Max wall temperature [$^{\circ}C$]	602	624	608	595	626	612
Mean wall temperature [$^{\circ}C$]	520	523	517	512	520	511

The external tube metal temperatures, of Table ??, were calculated using equation ??, which takes into account the temperature drop due to the ash deposit present on platen and final SH. Fouling thermal resistances of 0.0067 and 0.015 [m^2K/W] were used for the platen and final SH respectively.

$$T_{metal} = T_{wall} - \left(\frac{\dot{q}_{SH} t_{ASH}}{\lambda_{ASH}} \right) \quad (23)$$

For the platen and final SH the maximum surface temperature are observed for Cases 2 and 5. For comparison at 100 % MCR load the maximum and mean temperatures reported for the platen and final SH are 500 & 446 [$^{\circ}C$] and 623 & 531 [$^{\circ}C$] respectively, with the final SH operating in the materials creep range [?]. Thus, continued operation using the firing arrangement of Cases 2 and 5, could lead to SH failure.

Using the process model of Figure ?? and the results of the CFD simulations the important process control parameters were determined. Table ?? summarizes the results with the highest boiler efficiencies observed for Cases 3 and 6. With a lower SA flow-rate Cases 4 to 6 exhibit a higher boiler efficiency due

to the decrease in dry gas losses, when compared to Cases 1 to 3. All Cases exhibit adequate control of the main steam exit temperature by use of ATT1 and ATT2. The exit temperature of the reheaters, for all Cases, are determined to within the 20 [°C] tolerance for the intermediate turbine inlet conditions, as stipulated in the design C-schedules for the plant. However, with the lack of ATT-RH control, a sudden decreases in steam generation can lead to RH overheating and possible RH failure. Considering all of the above, Cases 3 and 6 are seen as the best firing arrangements for continuous low-load operation at a load 32 % MCR.

Table ?? shows the radiative heat percentage of the total heat input into each heat-exchanger for Cases 3 and 6. It can be seen that heat transfer to the furnace and radiant SHs are dominated by radiation, with approximately ± 10 % being transferred to convection at low-load. Considering the convective pass heat-exchangers (RH2 through to the EC, refer to Figure ??) the convective heat transfer becomes more apparent as seen with the reduction in radiative heat transfer percentage. Case 6 tends to exhibit less convective heat transfer for the said heat-exchangers, due to the fact of a lower SA flow-rate for non-firing burners. This will reduce the total amount of flue-gas flowing through the boiler, for the same cross flow-area and similar density the velocity would be expected to drop, reducing the convective heat transfer.

Table 6: Radiative heat transfer percentage for Cases 3 and 6

	Case 3	Case 6
Furnace [%]	89.2	88.9
Platen SH (SH2) [%]	92.5	93.4
Final SH (SH3) [%]	93.5	94.0
RH2 [%]	47.6	52.2
SH1 [%]	37.2	40.7
RH1 [%]	18.7	21.5
EC [%]	5.4	6.5

5. Conclusions

The present study demonstrates the use of a coupled simulation used to study the effects of burner configuration at a boiler load of 32 % MCR. A validation case was performed for the developed CFD model which showed adequate results for heat fluxes to the walls, with a general tendency of the model to under-predict the heat fluxes to the furnace. The model also showed sufficient accuracy in determining the combustion characteristics at the 100 % MCR load.

The results show that using a burner arrangement that raises the position of the flame core (Cases 2 and 5) increases the exit flue-gas temperature and runs the risk of final SH failure due to overheating. Subsequently, this firing arrangement also results in a higher unburnt carbon percentage at the exit flue-gas stream potentially leading to economic losses, regarding the efficient combustion of the fuel and the lowest boiler utilization efficiency.

Operation of the boiler using firing arrangements of Cases 1 and 4, in relation to Cases 3 and 6 results in lower boiler utilization efficiency and exit flue-gas temperature. Higher X_{CO} concentrations are observed near the bottom half of the furnace, along with high temperatures, which can lead to a high possibility of fire side corrosion occurring at continuous low-load operation using Cases 1 and 4.

The mixed firing arrangement, of case 3 and 6, exhibits the best boiler utilization efficiency overall. A 4.8 % decrease in unburnt carbon percentage is observed when operating using case 3 in relation to case 6. The predicted re-heater exit steam temperature of case 3 is substantially closer to the desired the temperature of 535 [$^{\circ}C$], allowing for better control.

Based on the current numerical study, carried out to determine the most favourable operating parameters and combustion stability, case 3 is seen as the optimal firing arrangement for the boiler under consideration.

Acknowledgements

The authors would like to thank the Eskom EPPEI program for financially
350 supporting the present study and acknowledge the computational resources provided by the Centre for High Performance Computing (CHPC), South Africa.

References

- [1] A. Dugum, K. Hanjalić, Numerical simulation of coal-air mixture flow in a real double-swirl burner and implications on combustion anomalies in a utility boiler, *Energy* 170 (2019) 942–953. doi:10.1016/j.energy.2018.12.121.
355
- [2] Eskom Power Generation (2017).
URL <http://www.eskom.co.za/Whatweredoing/ElectricityGeneration/Pages/Electricity{ }Generation.aspx>
- [3] R. Laubscher, P. Rousseau, CFD study of pulverized coal-fired boiler evaporator and radiant superheaters at varying loads, *Applied Thermal Engineering* 160. doi:10.1016/j.applthermaleng.2019.114057.
360
- [4] B. Hernik, W. Zablocki, Numerical research of combustion with a minimum boiler load, *Archives of Thermodynamics* 41 (4) (2020) 93–114. doi:10.24425/ather.2020.135855.
365
- [5] J. Chang, X. Wang, Z. Zhou, H. Chen, Y. Niu, CFD modeling of hydrodynamics, combustion and NOx emission in a tangentially fired pulverized-coal boiler at low load operating conditions, *Advanced Powder Technology* 32 (2) (2021) 290–303. doi:10.1016/j.apt.2020.12.008.
370 URL <https://doi.org/10.1016/j.apt.2020.12.008>
- [6] N. Modliński, K. Szczepanek, D. Nabagło, P. Madejski, Z. Modliński, Mathematical procedure for predicting tube metal temperature in the second stage reheater of the operating flexibly steam boiler, *Applied Ther-*

- mal Engineering 146 (October 2018) (2019) 854–865. doi:10.1016/j.applthermaleng.2018.10.063.
- [7] R. Laubscher, P. Rousseau, Numerical investigation into the effect of burner swirl direction on furnace and superheater heat absorption for a 620 MWe opposing wall-fired pulverized coal boiler, International Journal of Heat and Mass Transfer 137 (2019) 506–522. doi:10.1016/j.ijheatmasstransfer.2019.03.150.
- [8] J. Gu, Q. Liu, W. Zhong, A. Yu, Study on scale-up characteristics of oxy-fuel combustion in circulating fluidized bed boiler by 3D CFD simulation, Advanced Powder Technology 31 (5) (2020) 2136–2151. doi:10.1016/j.appt.2020.03.007.
- URL <https://doi.org/10.1016/j.appt.2020.03.007>
- [9] Y. Du, C. Wang, Q. Lv, D. Li, H. Liu, D. Che, CFD investigation on combustion and NOx emission characteristics in a 600 MW wall-fired boiler under high temperature and strong reducing atmosphere, Applied Thermal Engineering 126 (x) (2017) 407–418. doi:10.1016/j.applthermaleng.2017.07.147.
- URL <http://dx.doi.org/10.1016/j.applthermaleng.2017.07.147>
- [10] J. Fan, L. Qian, Y. Ma, P. Sun, K. Cen, Computational modeling of pulverized coal combustion processes in tangentially fired furnaces, Chemical Engineering Journal 81 (1-3) (2001) 261–269. doi:10.1016/S1385-8947(00)00212-6.
- [11] S. Chen, B. He, D. He, Y. Cao, G. Ding, X. Liu, Z. Duan, X. Zhang, J. Song, X. Li, Numerical investigations on different tangential arrangements of burners for a 600 MW utility boiler, Energy 122 (x) (2017) 287–300. doi:10.1016/j.energy.2017.01.093.
- [12] B. He, L. Zhu, J. Wang, S. Liu, B. Liu, Y. Cui, L. Wang, G. Wei, Computational fluid dynamics based retrofits to reheater panel overheating of

No. 3 boiler of Dagang Power Plant, *Computers and Fluids* 36 (2) (2007) 435–444. doi:10.1016/j.compfluid.2005.09.005.

405 [13] Y. Jiang, B.-H. Lee, D.-H. Oh, C.-H. Jeon, Optimization of operating conditions to achieve combustion stability and reduce NO_x emission at half-load for a 550-MW tangentially fired pulverized coal boiler, *Fuel* 306 (February) (2021) 121727. doi:10.1016/j.fuel.2021.121727.
URL <https://doi.org/10.1016/j.fuel.2021.121727>

410 [14] S. Belošević, I. Tomanović, N. Crnomarković, A. Milićević, Full-scale CFD investigation of gas-particle flow, interactions and combustion in tangentially fired pulverized coal furnace, *Energy* 179. doi:10.1016/j.energy.2019.05.066.

[15] F. Alobaid, N. Mertens, R. Starkloff, T. Lanz, C. Heinze, B. Epple, Progress in dynamic simulation of thermal power plants, *Progress in Energy and Combustion Science* 59 (2017) 79–162. doi:10.1016/j.pecs.2016.11.001.
415 URL <http://dx.doi.org/10.1016/j.pecs.2016.11.001>

[16] R. Laubscher, P. Rousseau, Numerical investigation on the impact of variable particle radiation properties on the heat transfer in high ash pulverized coal boiler through co-simulation, *Energy* 195 (2020) 117006. doi:10.1016/j.energy.2020.117006.
420 URL <https://doi.org/10.1016/j.energy.2020.117006>

[17] C. Yu, W. Xiong, H. Ma, J. Zhou, F. Si, X. Jiang, X. Fang, Numerical investigation of combustion optimization in a tangential firing boiler considering steam tube overheating, *Applied Thermal Engineering* 154 (2) (2019) 87–101. doi:10.1016/j.applthermaleng.2019.03.074.
425 URL <https://doi.org/10.1016/j.applthermaleng.2019.03.074>

[18] V. Ranade, D. Gupta, Computational modeling of pulverized coal fired boilers, 1st Edition, Taylor & Francis, Boca Raton, 2015.

- 430 [19] C. Sheng, B. Moghtaderi, R. Gupta, T. F. Wall, A computational fluid dynamics based study of the combustion characteristics of coal blends in pulverised coal-fired furnace, *Fuel* 83 (11-12) (2004) 1543–1552. doi:10.1016/j.fuel.2004.02.011.
- [20] M. Baum, P. Street, Predicting the combustion behaviour of coal particles, 435 *Combustion science and Technology* 3 (43) (1971) 231.
- [21] H. Knaus, U. Schnell, R. Klaus, On the modelling of coal combustion in a 550MWe coal fired utility boiler, *Progress in Computational Fluid Dynamics* 1 (2001) 194–207.
- 440 [22] A. C. Benim, B. Epple, B. Krohmer, Modelling of pulverised coal combustion by a Eulerian-Eulerian two-phase flow formulation, *Progress in Computational Fluid Dynamics* 5 (6) (2005) 345–361. doi:10.1504/PCFD.2005.007067.
- [23] H. Versteeg, W. Malalasekera, Introduction to Computational Fluid Dynamics, The finite volume method, 2nd Edition, Pearson Prentice Hall, 445 2007. doi:10.1002/9781119369189.
- [24] W. Vicente, S. Ochoa, J. Aguilón, E. Barrios, An Eulerian model for the simulation of an entrained flow coal gasifier, *Applied Thermal Engineering* 23 (15) (2003) 1993–2008. doi:10.1016/S1359-4311(03)00149-2.
- 450 [25] J. Cai, M. Handa, M. F. Modest, Eulerian-Eulerian multi-fluid methods for pulverized coal flames with nongray radiation, *Combustion and Flame* 162 (4) (2015) 1550–1565. doi:10.1016/j.combustflame.2014.11.023. URL <http://dx.doi.org/10.1016/j.combustflame.2014.11.023>
- [26] P. Basu, C. Kefa, L. Jestin, Boilers and burners: Design and theory, 1st Edition, Springer, New York, 2000.
- 455 [27] M. F. Modest, Radiative Heat Transfer, 3rd Edition, Academic Press, Kidlington, Oxford, U.K., 2013. doi:10.1016/j.neuroscience.2014.03.010.

- [28] T. Smith, Z. Shen, J. Friedman, Evaluation of Coefficients for the Weighted Sum of Gray Gases Model, *Journal of Heat transfer* 104 (1982) 602–608.
- 460 [29] F. Lockwood, S. Rizvi, N. Shah, Comparative predictive experience of coal firing, *Proceedings of the Institution of Mechanical Engineers* 200 (1986) 79–87. doi:10.1243/PIME.
- [30] C. Yin, On gas and particle radiation in pulverized fuel combustion furnaces, *Applied Energy* 157 (2015) 554–561. doi:10.1016/j.apenergy.2015.01.142.
- 465 URL <http://dx.doi.org/10.1016/j.apenergy.2015.01.142>
- [31] V. Gnielinski, Heat transfer in cross-flow around single rows of tubes and through tube bundles, in: *VDI Heat Atlas*, Springer-Verlag, Berlin, 2016, pp. 756–760.