Token-by-Token Perplexity: 60-clean-v0 vs 60-obf-v0 (Obf/Clean Ratio (AOI): 1.39x)
Perplexity (log scale)
Token Position
60-clean-v0
60-obf-v0
Clean AOI
Obfuscated AOI
Clean: Overall=14.05, Mean=2402.08, Max=52019.56, Overall(AOI)=1.98, Mean(AOI)=2.92, Max(AOI)=8.74
Obf: Overall=27.22, Mean=3201.85, Max=52019.56, Overall(AOI)=2.75, Mean(AOI)=4.22, Max(AOI)=7.42

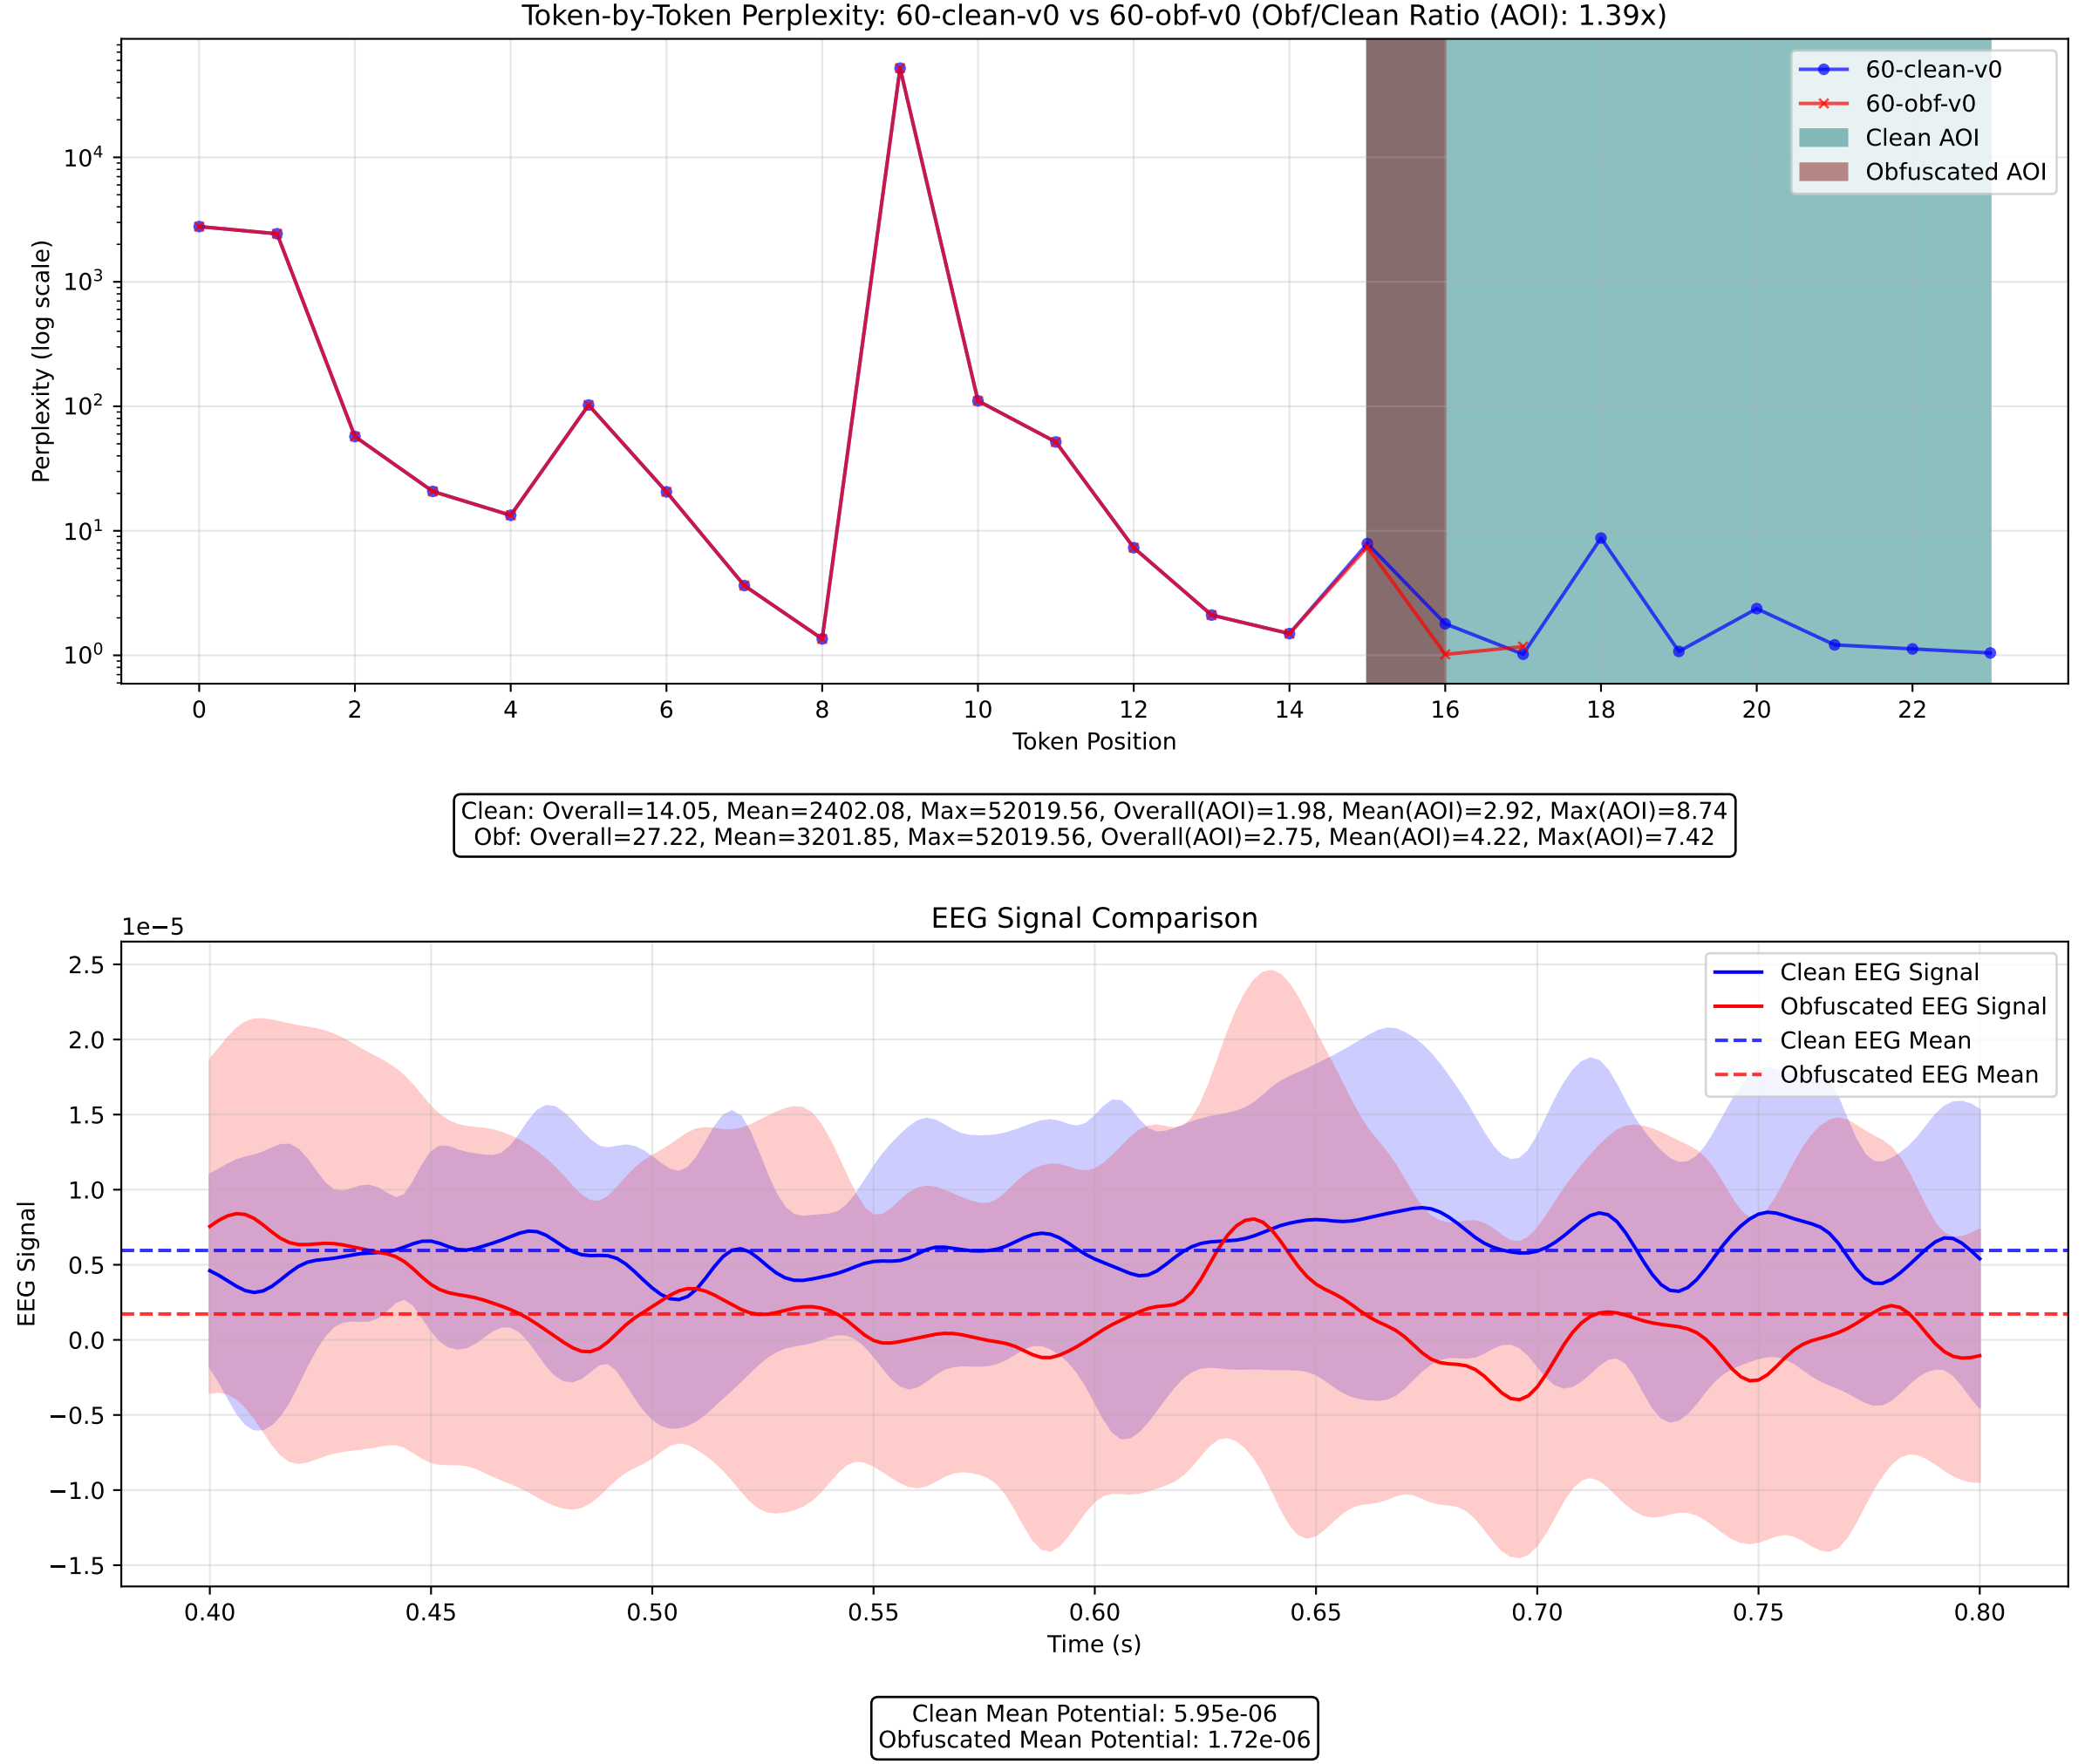
EEG Signal Comparison
1e−5
EEG Signal
Time (s)
Clean EEG Signal
Obfuscated EEG Signal
Clean EEG Mean
Obfuscated EEG Mean
Clean Mean Potential: 5.95e-06
Obfuscated Mean Potential: 1.72e-06