Token-by-Token Perplexity: 57-clean-v1 vs 57-obf-v1 (Obf/Clean Ratio (AOI): 9.43x)
Perplexity (log scale)
Token Position
57-clean-v1
57-obf-v1
Clean AOI
Obfuscated AOI
Clean: Overall=9.05, Mean=226.04, Max=2294.53, Overall(AOI)=15.99, Mean(AOI)=64.32, Max(AOI)=233.49
Obf: Overall=10.54, Mean=249.90, Max=2294.53, Overall(AOI)=150.75, Mean(AOI)=181.16, Max(AOI)=281.64

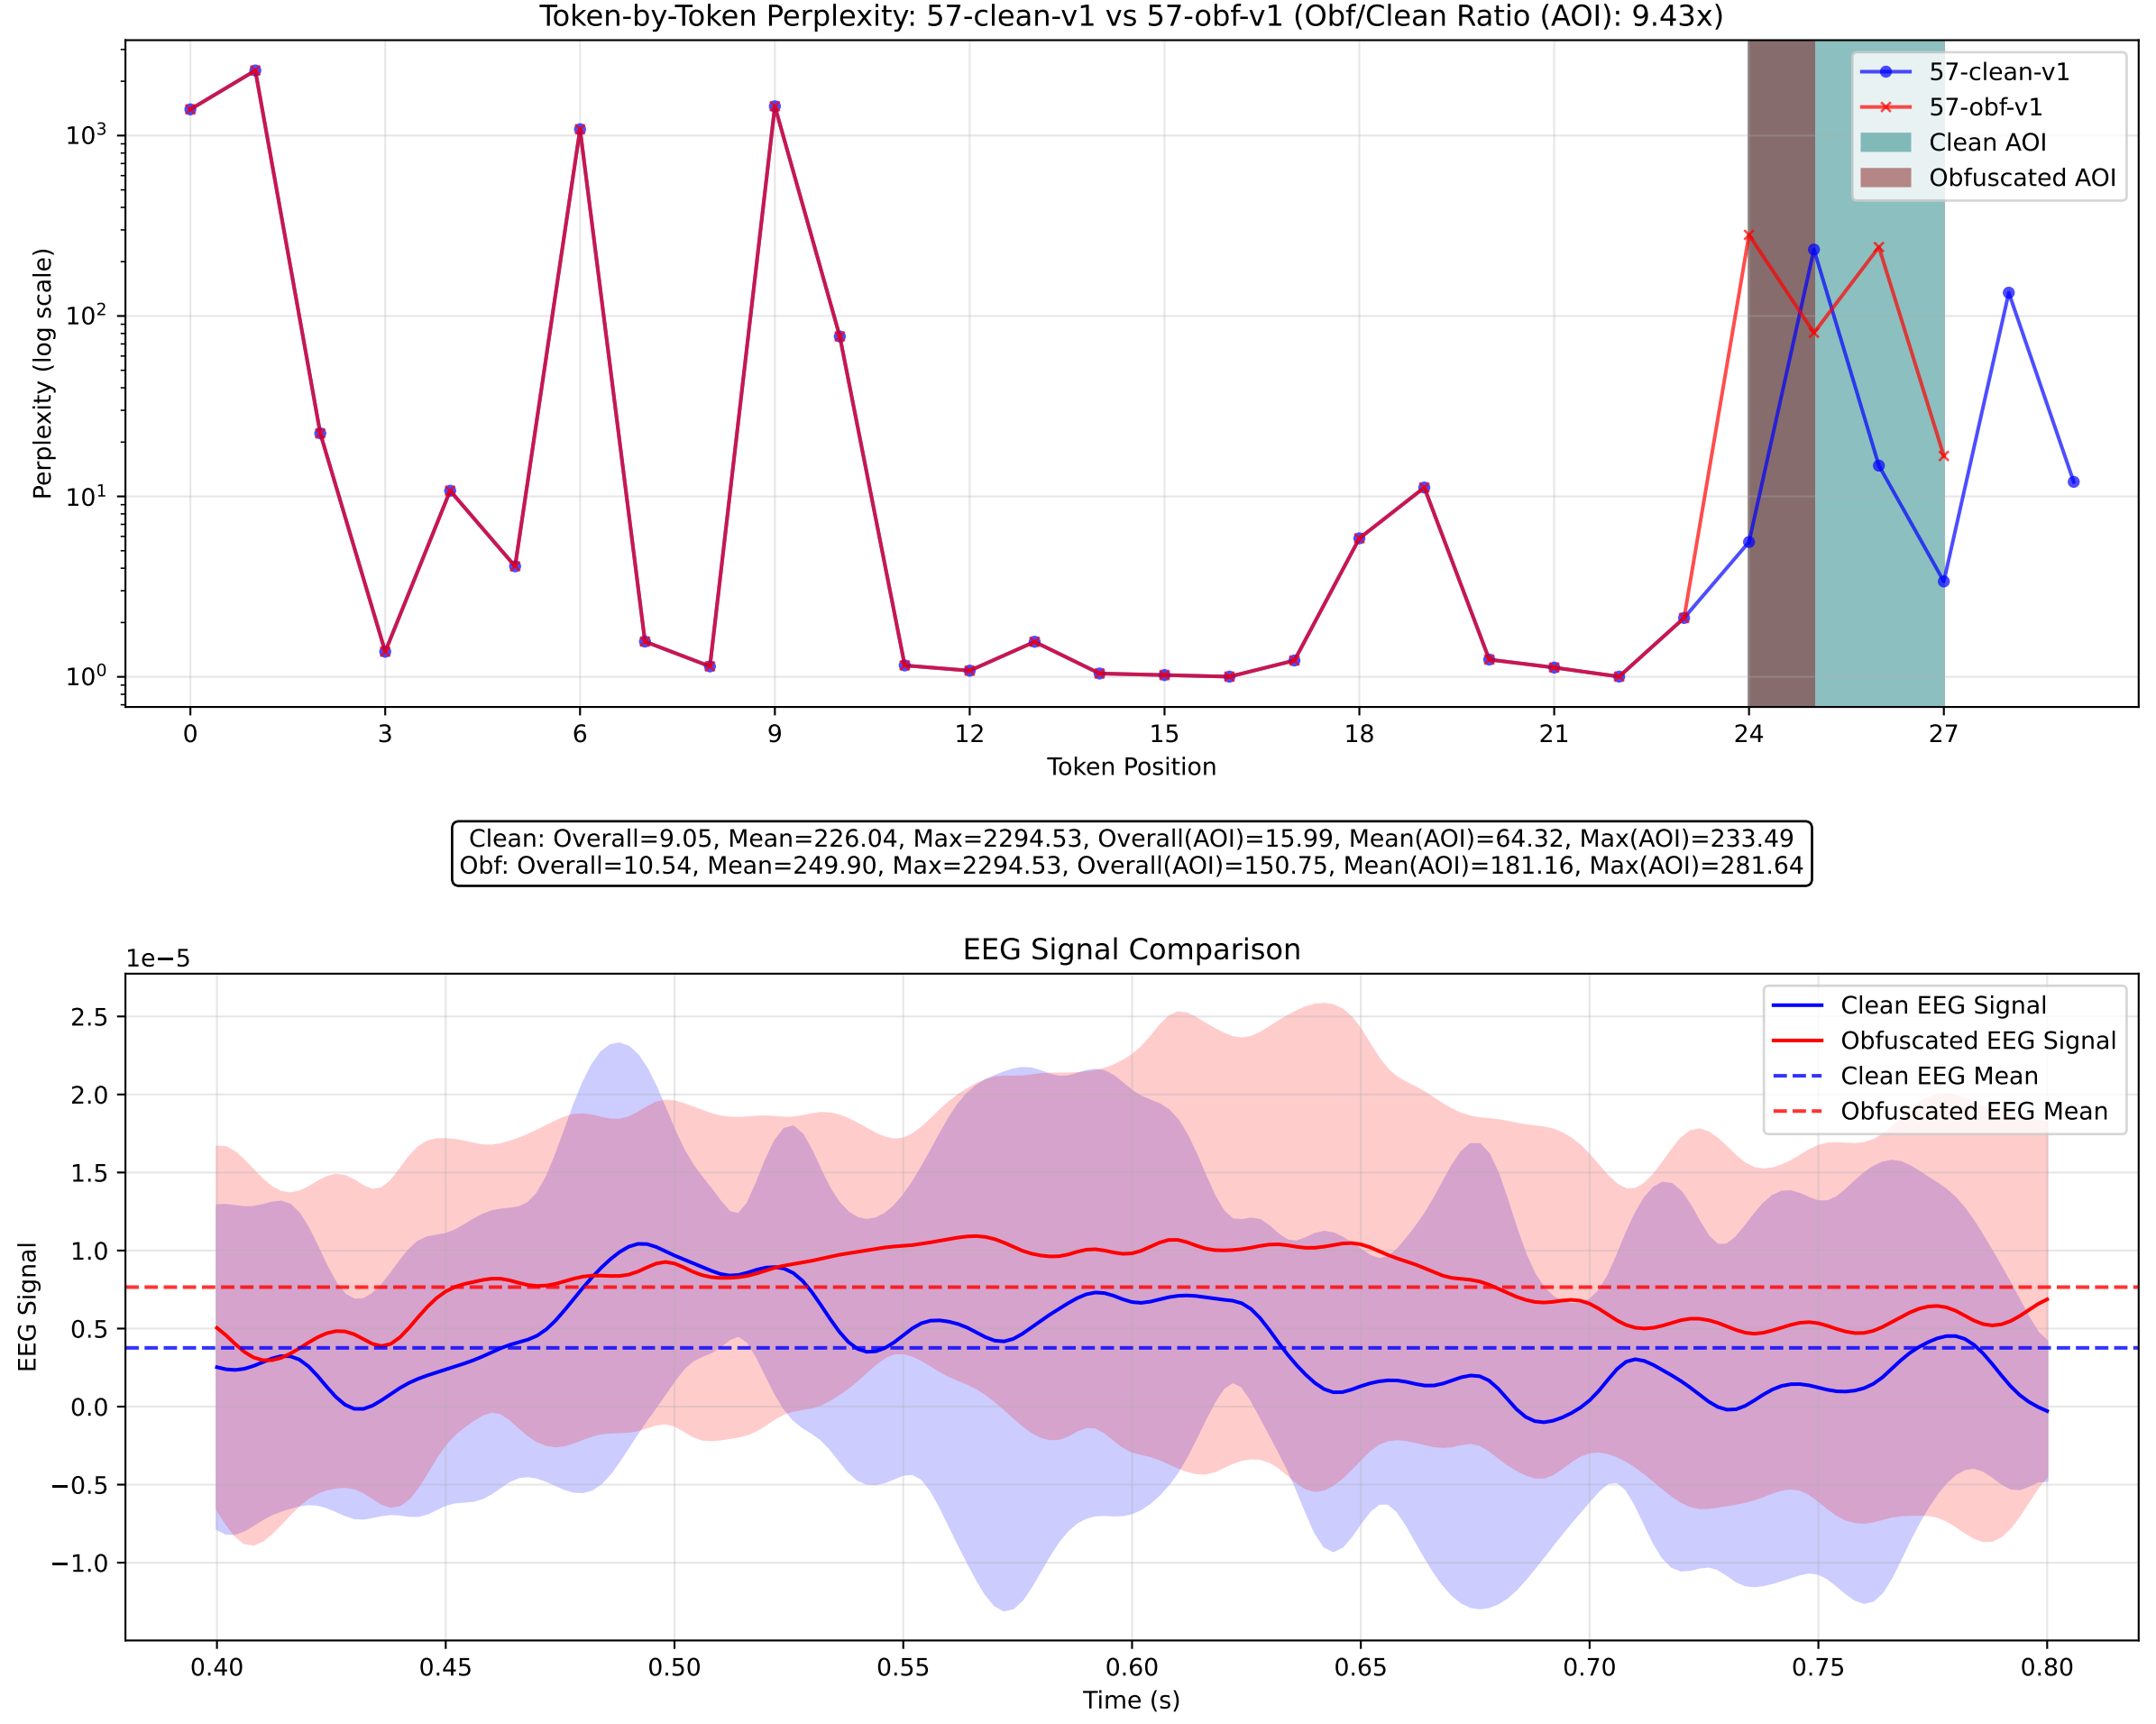
EEG Signal Comparison
1e−5
EEG Signal
Time (s)
Clean EEG Signal
Obfuscated EEG Signal
Clean EEG Mean
Obfuscated EEG Mean
Clean Mean Potential: 3.76e-06
Obfuscated Mean Potential: 7.66e-06