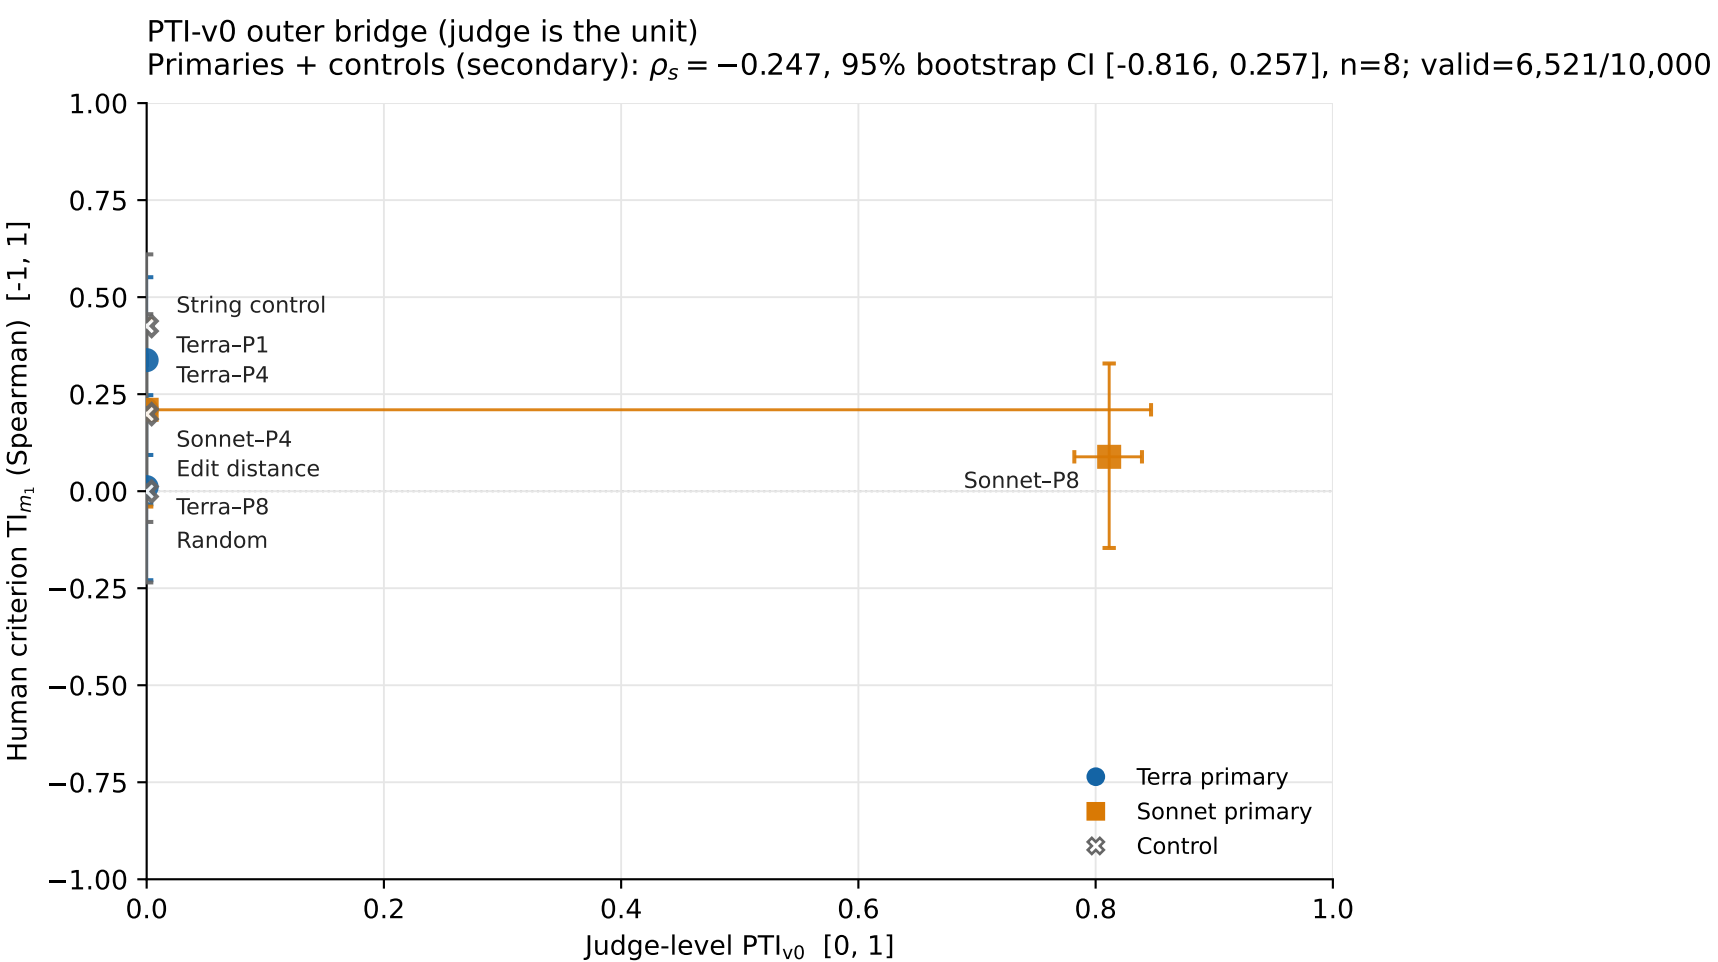
PTI-v0 outer bridge (judge is the unit)
Primaries + controls (secondary): $\rho_s = -0.247$, 95% bootstrap CI [-0.816, 0.257], n=8; valid=6,521/10,000
Human criterion TI_{m_1} (Spearman) [-1, 1]
Judge-level PTI_{v0} [0, 1]
1.00
0.75
0.50
0.25
0.00
−0.25
−0.50
−0.75
−1.00
0.0
0.2
0.4
0.6
0.8
1.0
String control
Terra–P1
Terra–P4
Sonnet–P4
Edit distance
Terra–P8
Random
Sonnet–P8
Terra primary
Sonnet primary
Control