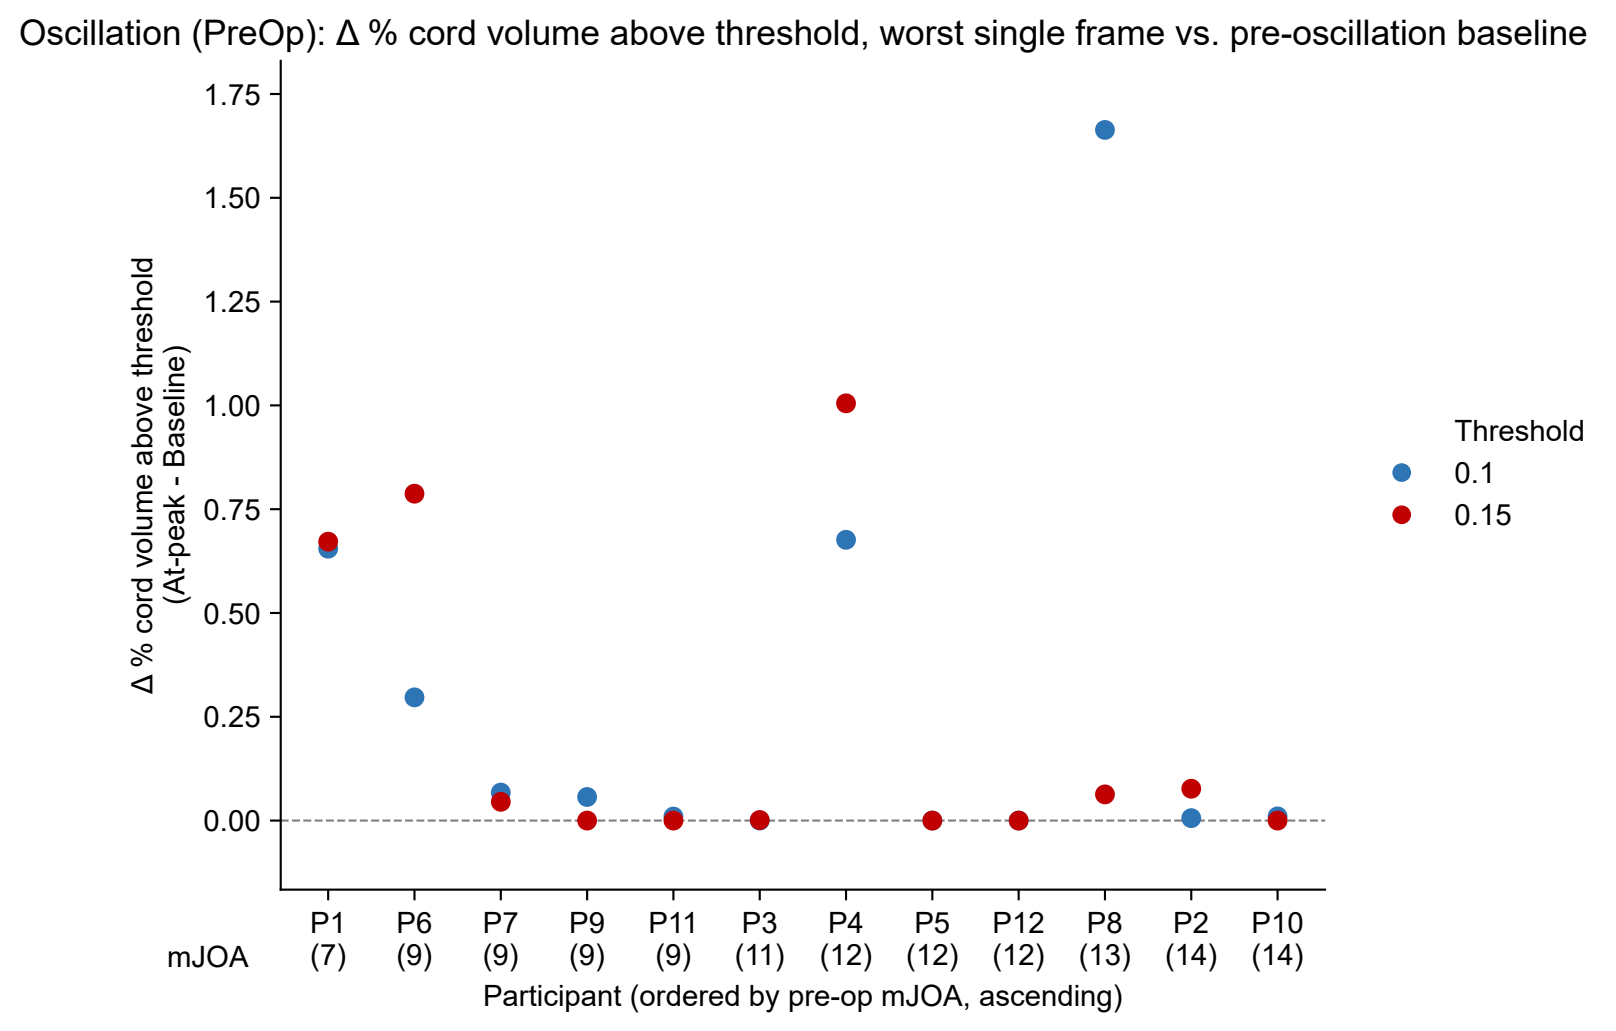
Oscillation (PreOp): Δ % cord volume above threshold, worst single frame vs. pre-oscillation baseline
Δ % cord volume above threshold (At-peak - Baseline)
1.75
1.50
1.25
1.00
0.75
0.50
0.25
0.00
Threshold
0.1
0.15
P1 (7)
P6 (9)
P7 (9)
P9 (9)
P11 (9)
P3 (11)
P4 (12)
P5 (12)
P12 (12)
P8 (13)
P2 (14)
P10 (14)
mJOA
Participant (ordered by pre-op mJOA, ascending)