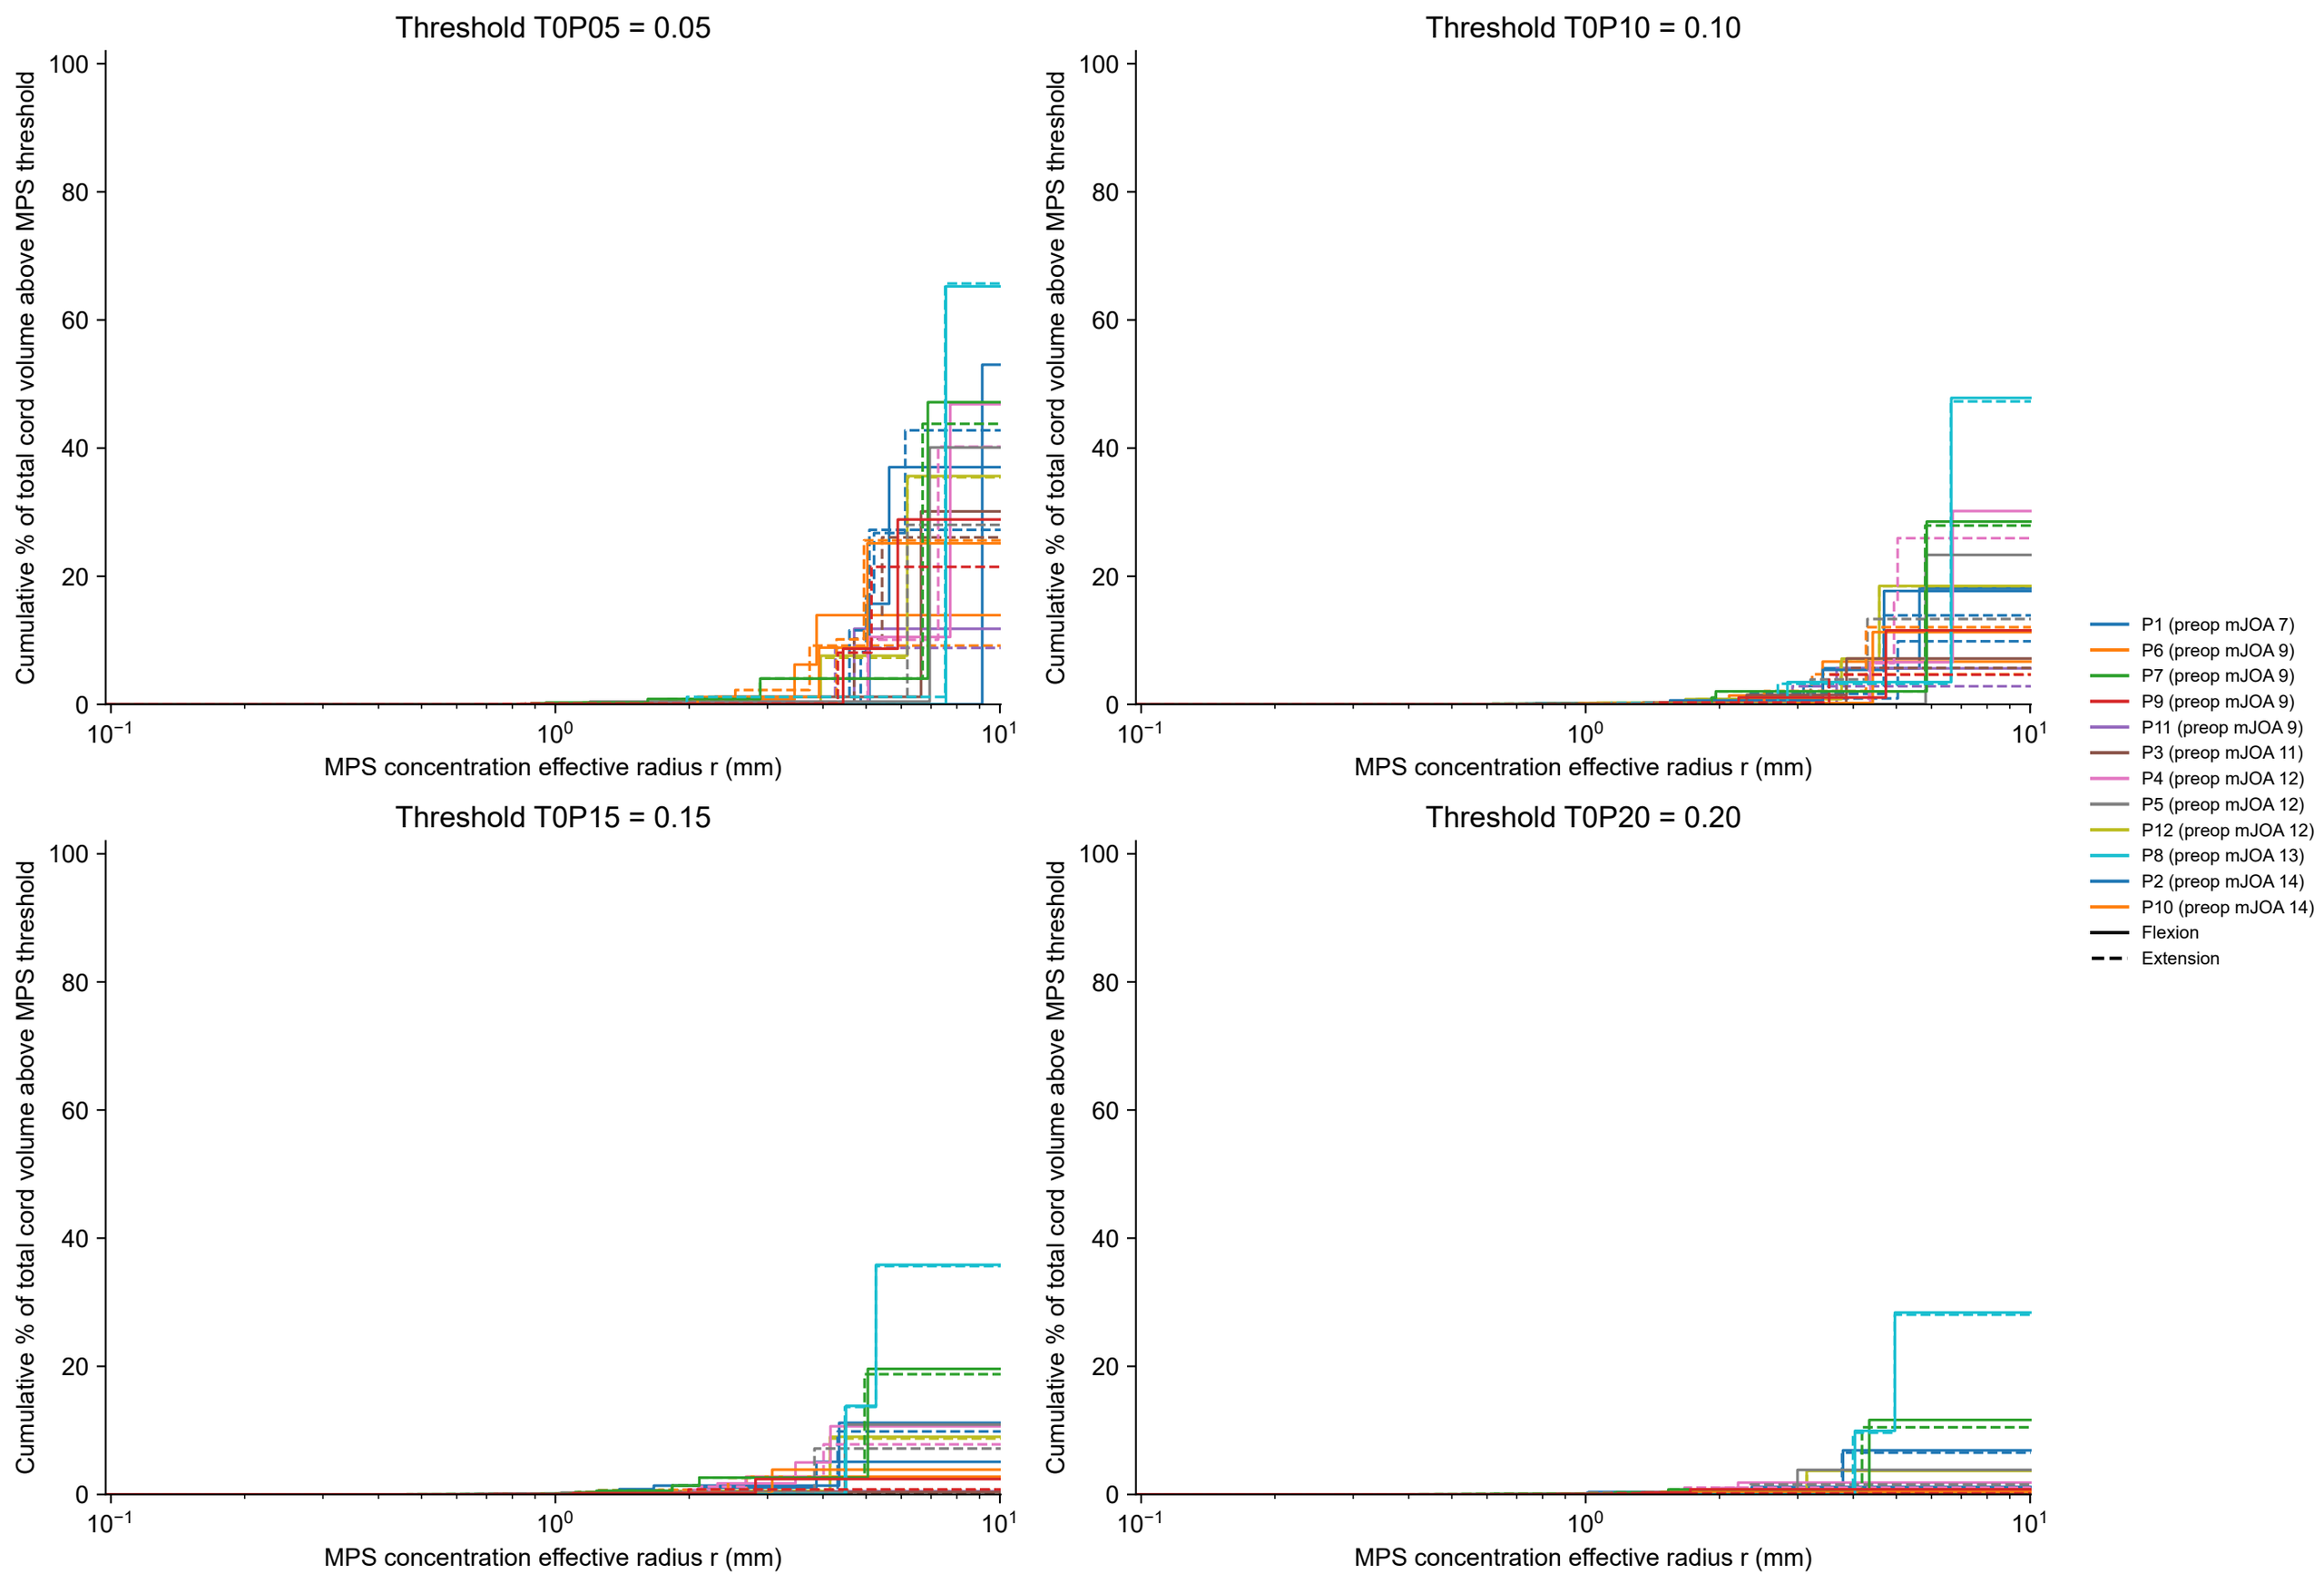
Threshold T0P05 = 0.05
Threshold T0P10 = 0.10
Threshold T0P15 = 0.15
Threshold T0P20 = 0.20
Cumulative % of total cord volume above MPS threshold
MPS concentration effective radius r (mm)
0
20
40
60
80
100
10^{-1}
10^{0}
10^{1}
P1 (preop mJOA 7)
P6 (preop mJOA 9)
P7 (preop mJOA 9)
P9 (preop mJOA 9)
P11 (preop mJOA 9)
P3 (preop mJOA 11)
P4 (preop mJOA 12)
P5 (preop mJOA 12)
P12 (preop mJOA 12)
P8 (preop mJOA 13)
P2 (preop mJOA 14)
P10 (preop mJOA 14)
Flexion
Extension