


Uspešno pogašen požar v kompenzacijski omarici trafo postaje TP5 - JULON, dne 17.05.2007



Stanje pred in po požaru

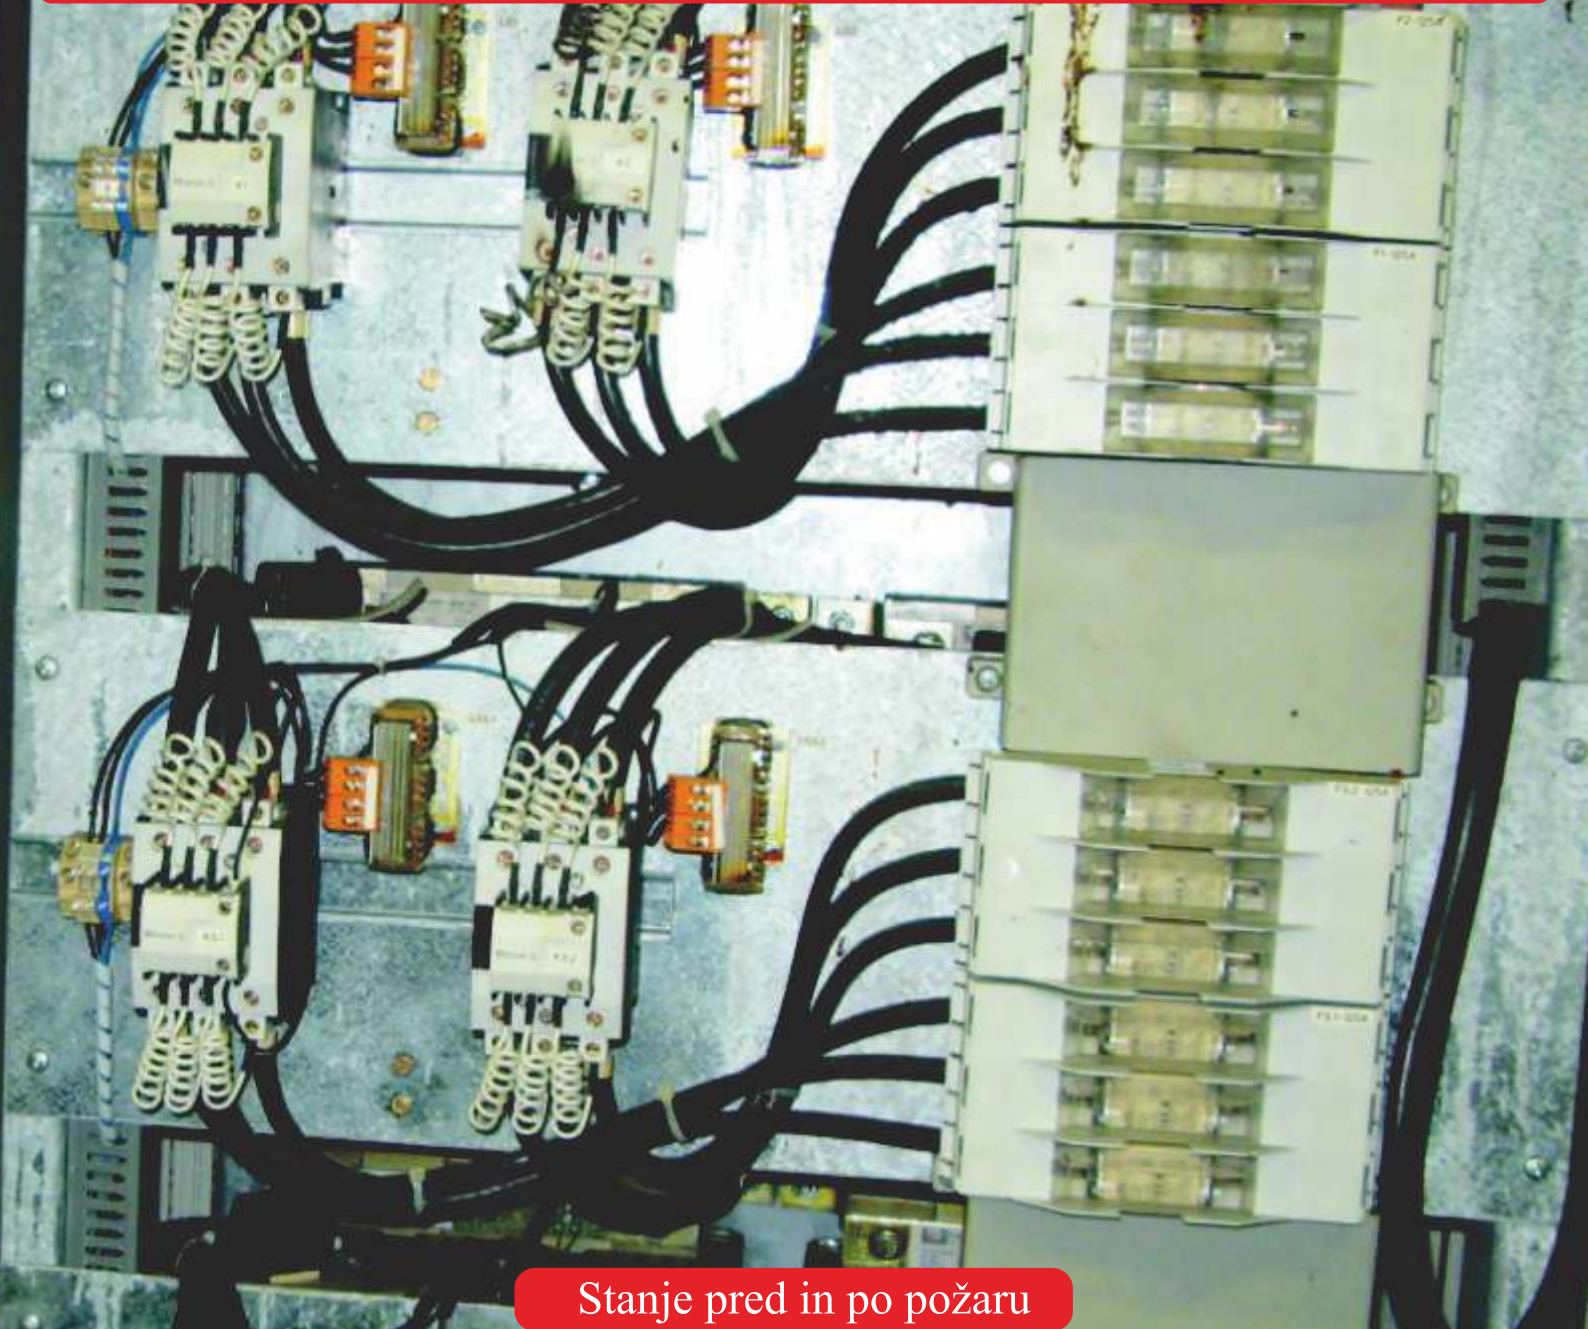

Podjetje / Company: Julon d.d.

Objekt / Building: Letališka 5, 1000 LJUBLJANA

REFERENCA O USPEŠNEM DELOVANJU GASILNE AMPULE BONPET

CONFIRMATION ABOUT THE SUCCESSFUL FIRE EXTINGUISHING WITH FIRE EXTINGUISHER BONPET

Opis dogodka: Požar v kompenzacijski omarici ki je v trafo postaji TP5- JULON 1

The event: The fire at armoire at trafo station TP5- JULON 1

OPIS DELOVANJA:

Gasilna ampula Bonpet je bila nameščena na vrhu kompenzacijske omare in se je aktivirala ob vžigu kompenzacijskih elementov - kondenzatorjev in kablov. Ob vžigu je nastala dovolj velika temperatura, da je prišlo do aktivacije ampule Bonpet. S svojim delovanjem je požarno škodo zelo minimalizirala, saj so ostali sestavni deli kompenzacijske omarice ostali povsem nedotaknjeni in nepoškodovani.

Iz priložene fotografije je razvidno, kako so bile ampule Bonpet nameščene pred aktivacijo.

Gasilna ampula Bonpet je uspešno opravila svoje delo in s tem preprečila širjenje ognja po ostalih elektro in kompenzacijskih omaricah.

DESCRIPTION OF THE OPERATION:

Extinguishing ampoule Bonpet was installed on the top of the armoire and has activated next to ignition of the elements-capacitors and cables. High temperature at the ignition caused the activation of the ampoule Bonpet. With its activity ampoule Bonpet caused the minimization of the fire damage and that is why component parts of the armoire stayed intact.

Enclosed photos shows how ampoules Bonpet were installed before the activation.

Ampoule Bonpet has successfully done it's work and prevent spreading the fire round other electrical armoires.

Priloga / Enclosed:

- fotografija / photo

Referenco potrjuje / Confirmed by:

Odgovorna oseba za varstvo okolja, požarno varnost in varstva pri delu


JULON d.d.
Ljubljana
Mladen Bozanic, univ. inž. inž. kem.
Letališka 15

Ljubljana, 17. 05. 2007