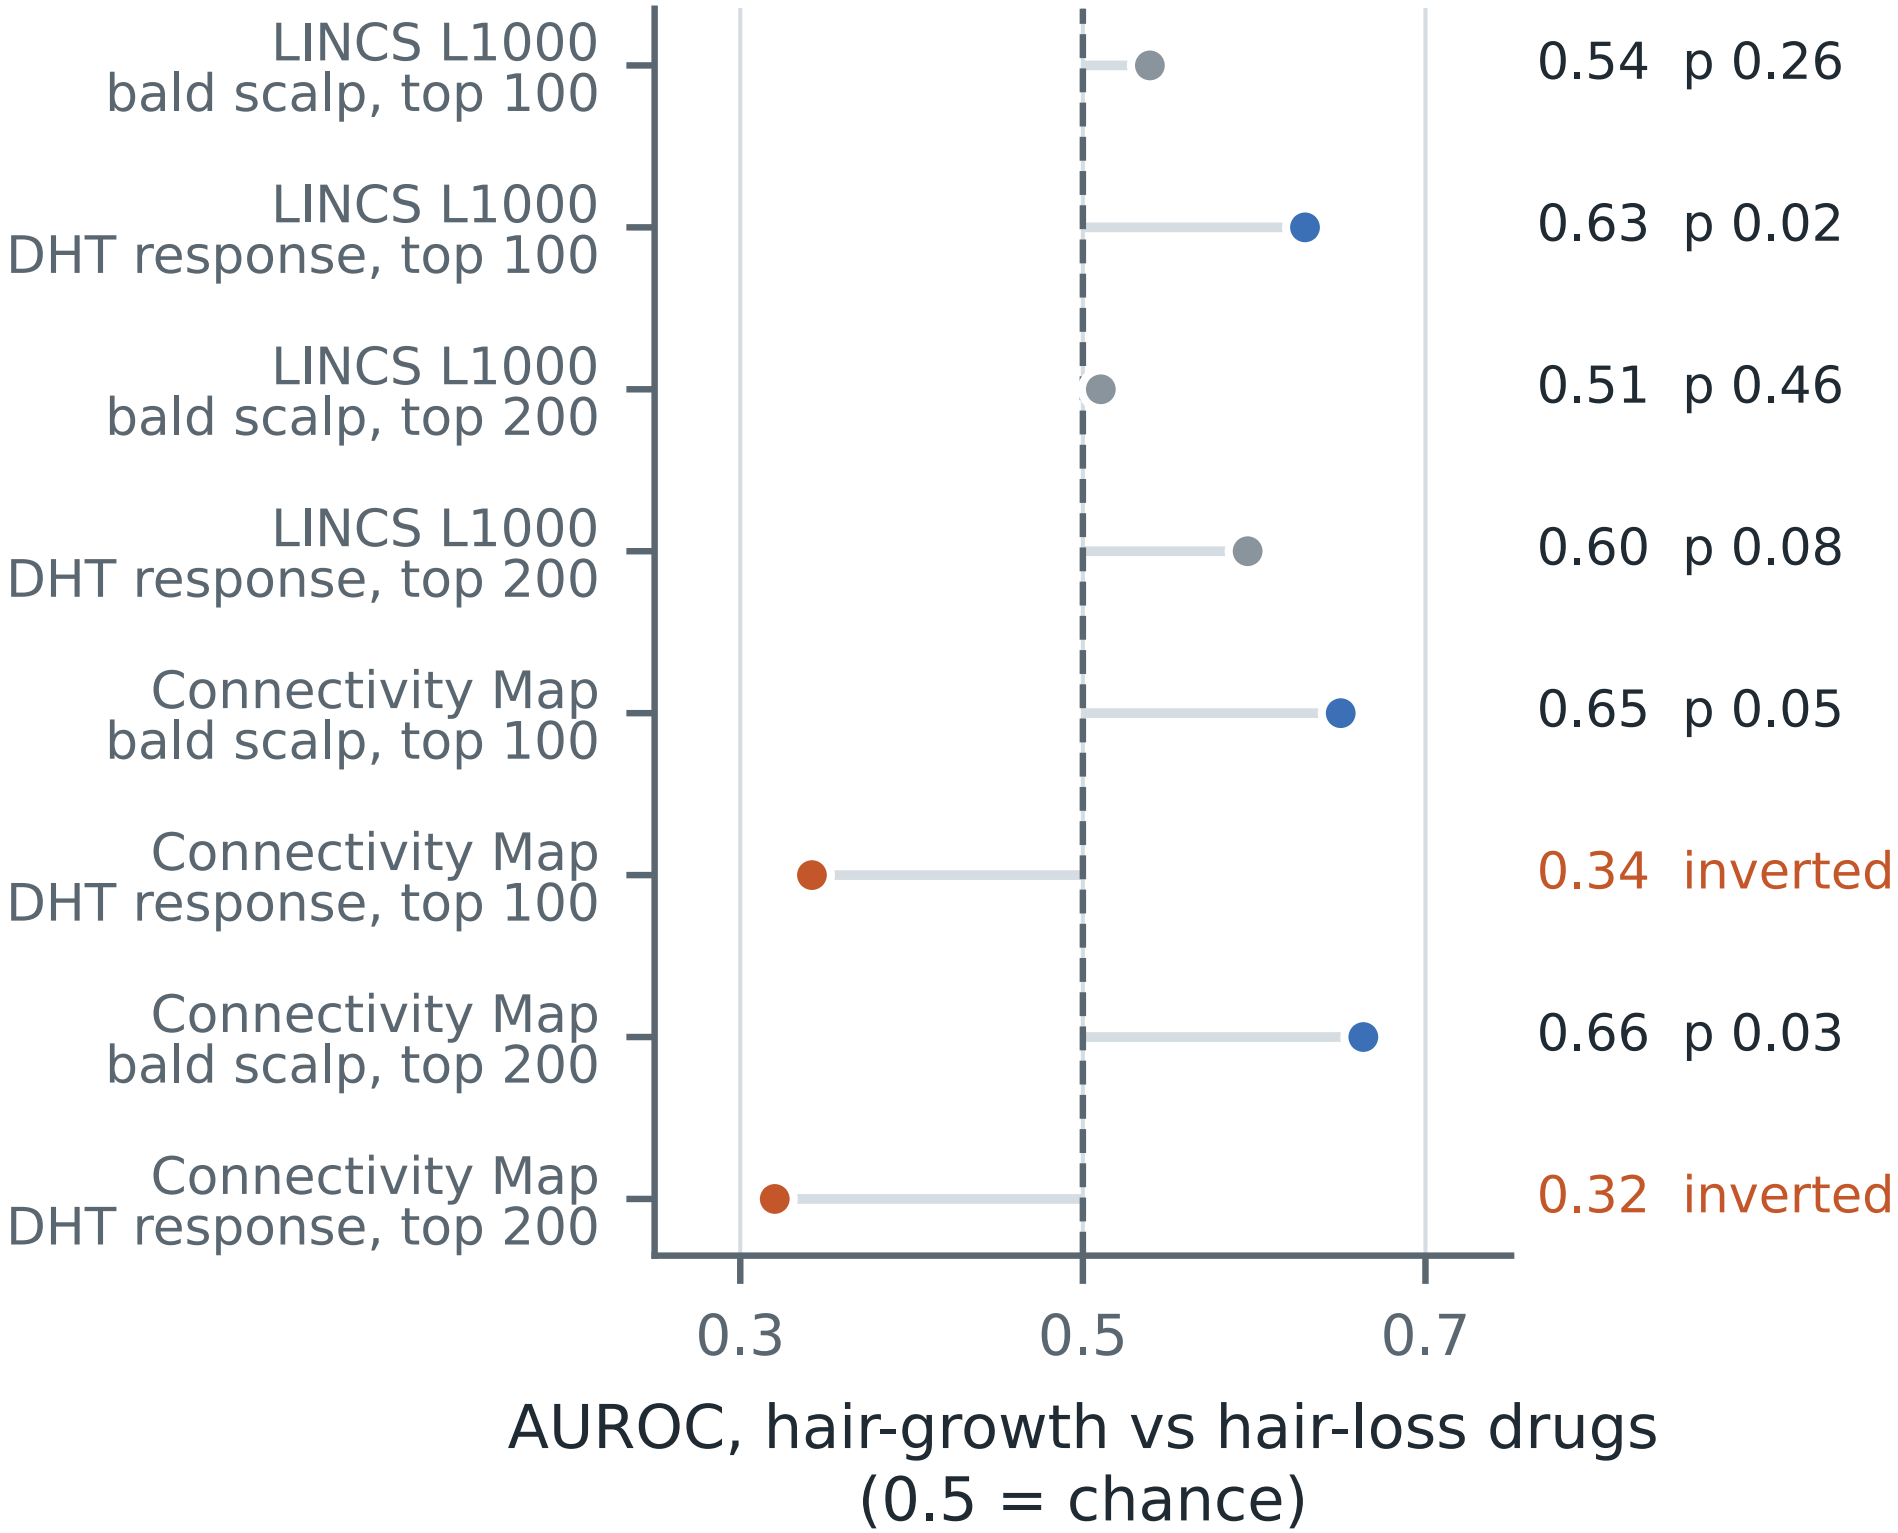Signature screening fails its own calibration