


Green Space Installation

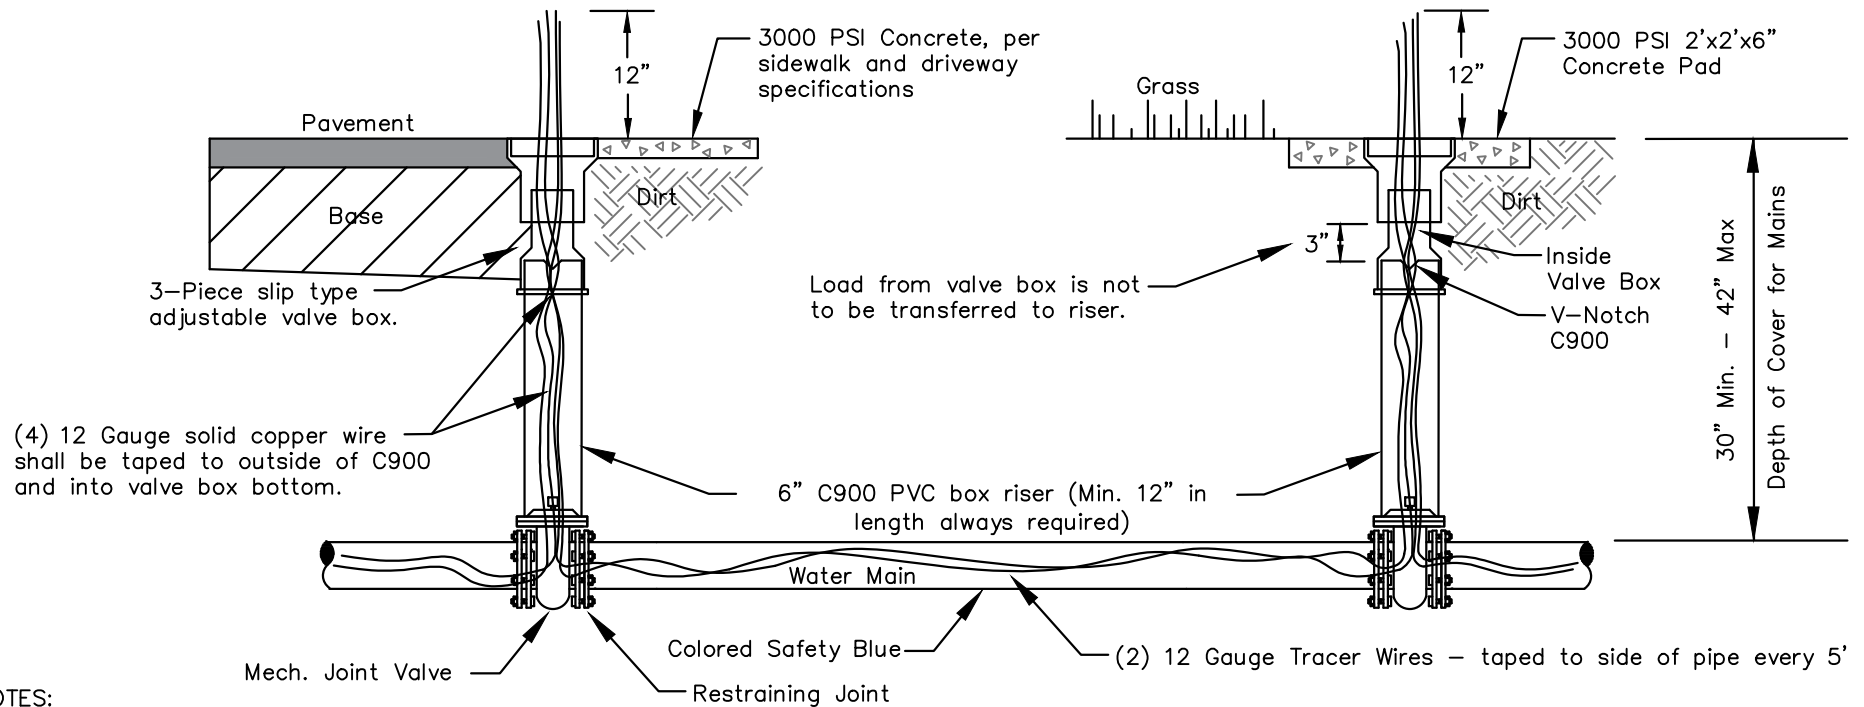

NOTES:

1. Must center operation nut in box.
2. C900 Riser to be one continuous section and color coded "Safety Blue."
3. Gate Valves shall be open left only.
4. Valve key extensions required on valves with operator nut over 3' deep.
5. Tracer Wire required in all applications including on D.I.P. and colored "Safety Blue."
6. See also City of Clearwater's Technical Specification Section IV.

SECTION VIEW

N.T.S.

| | | |
|------|----------------------|-----|
| | | |
| | | |
| DATE | REVISION DESCRIPTION | APP |

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
POTABLE WATER
DETAILS

TYPICAL VALVE AND BOX SETTING

| | |
|-----------------|------------|
| INDEX NO. | PAGE NO. |
| 402 | 1 OF 3 |
| LATEST REVISION | 10/21/2019 |