


SECTION A-A
N.T.S.

NOTES:

1. Storm Sewers and Manholes to be centered in Junction Box unless otherwise specified in Plans.
2. All Concrete to be 3000 P.S.I., with fiber mesh reinforcing.
3. Chamfer all exposed edges $\frac{3}{4}$ ".

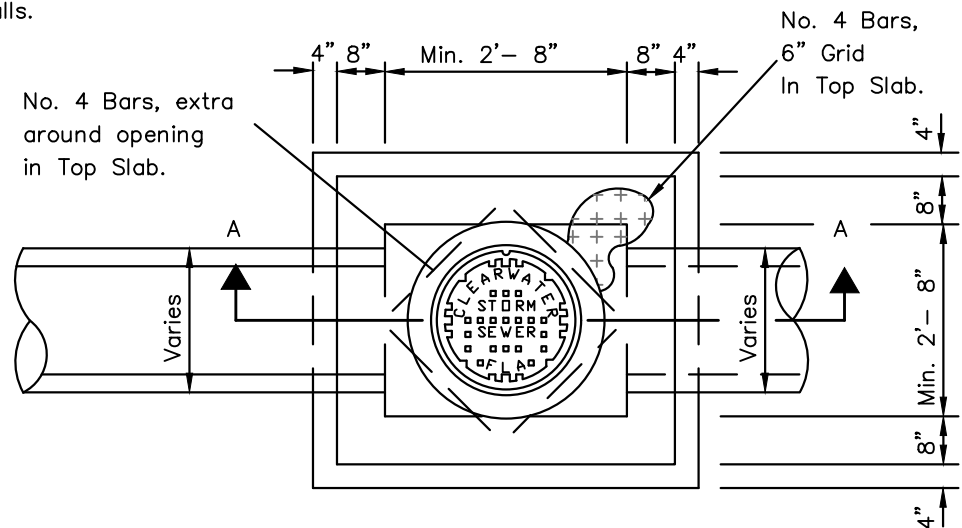

PLAN VIEW
N.T.S.

| | | |
|--------|----------------------|------|
| 6/3/15 | EDITED NOTES | S.R. |
| DATE | REVISION DESCRIPTION | APP |

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
STORM
DETAILS

JUNCTION BOX
NON-TRAFFIC TYPE

| | |
|-----------------|-----------|
| INDEX NO. | PAGE NO. |
| 206 | 1 OF 1 |
| LATEST REVISION | 2/22/2016 |