


**PLAN VIEW**

N.T.S.

NOTE:


Saw Cut Drive if Nearest Const. Joint Over 7' from Back of Curb.

\* Filter aggregate for underdrains shall be as specified in the FDOT Standard Specifications, Section 901 – Coarse Aggregate, and shall be either #6 or #57. If #57 is used, it must be washed and screened to remove fines. The aggregate may be stone, slag, or crushed gravel.

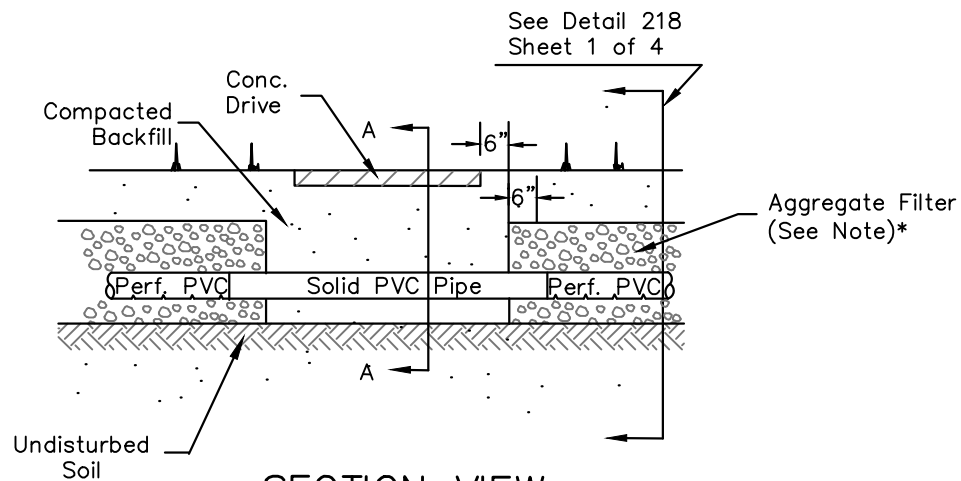

**SECTION VIEW**

N.T.S.

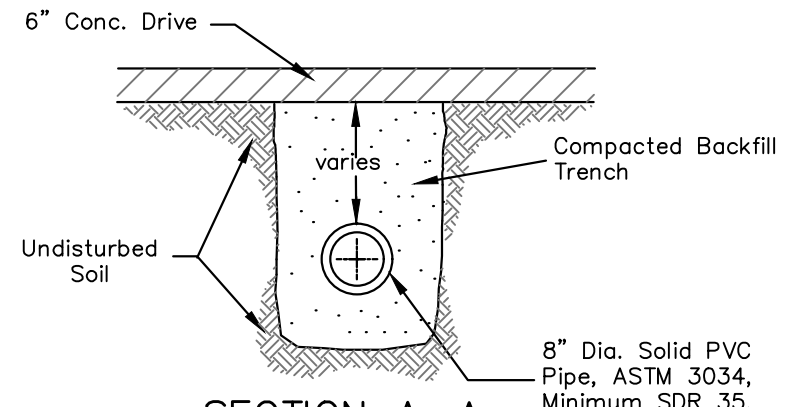

**SECTION A-A**

N.T.S.

6/3/15	CORRECTION TO NOTES	S.R.
DATE	REVISION DESCRIPTION	APP

**CITY OF CLEARWATER**  
ENGINEERING DEPARTMENT  
**STORM**  
**DETAILS**

**UNDERDRAIN AT DRIVEWAYS**

INDEX NO.	PAGE NO.
218	2 OF 4
LATEST REVISION	2/22/2016