


## Roadway/Sidewalk Installation

## Green Space Installation

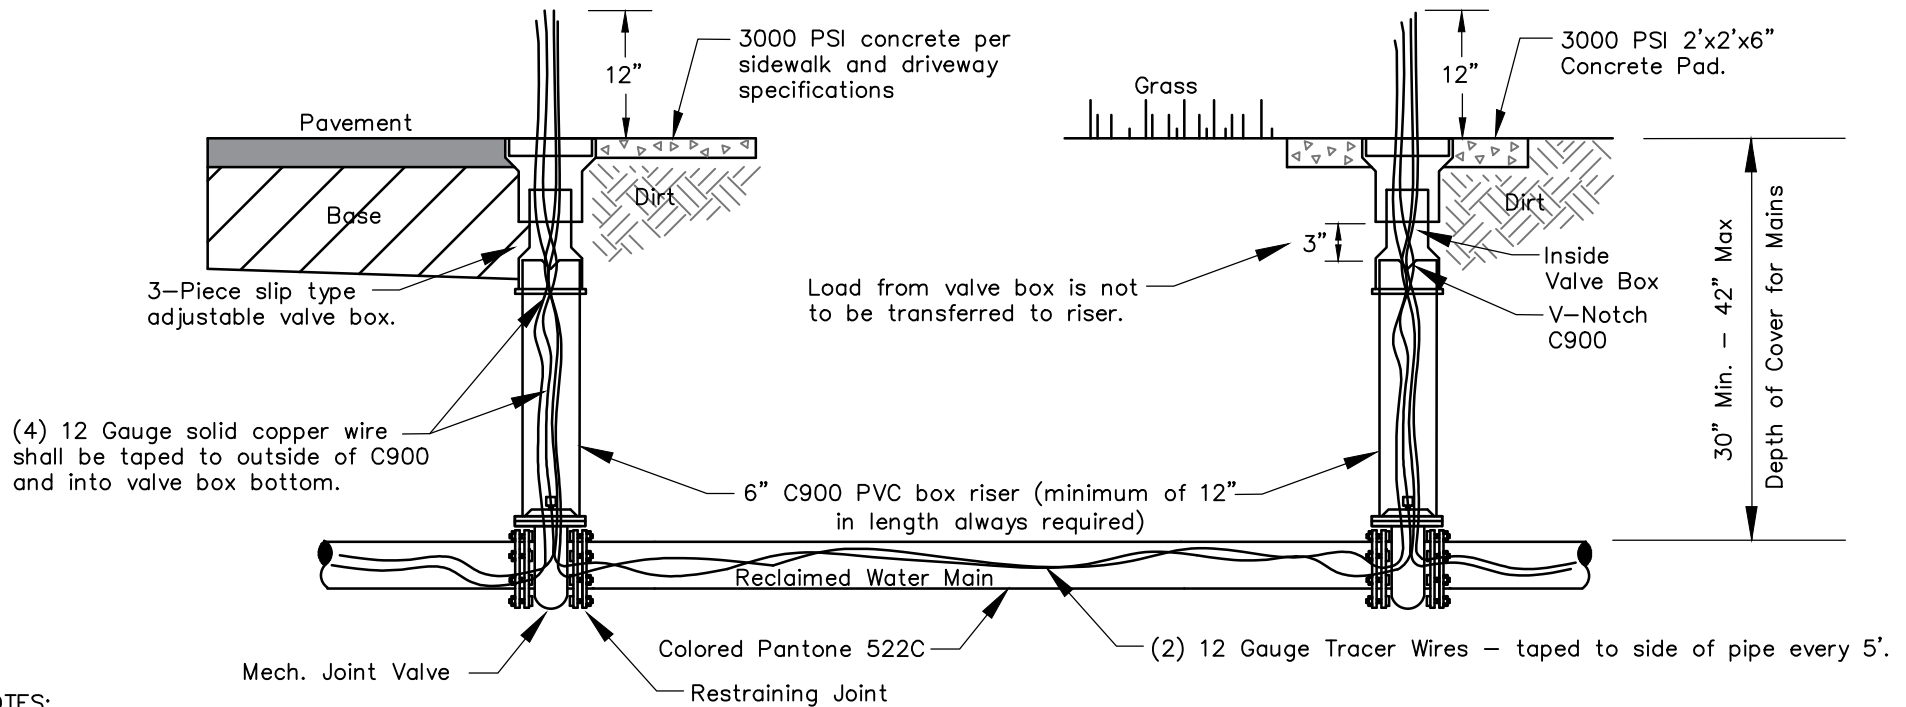

### NOTES:

1. Must center operation nut in box
2. C900 Riser to be one continuous section and color coded Pantone 522c.
3. Gate Valves shall be open left only.
4. Valve key extensions required on valves with operator nut over 3' deep.
5. Tracer Wire required in all applications including on D.I.P. and colored Pantone 522c.
6. See also City of Clearwater's Technical Specification Section IV.

## SECTION VIEW

N.T.S.

DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER  
ENGINEERING DEPARTMENT  
RECLAIMED WATER  
DETAILS

RECLAIMED WATER  
TYPICAL VALVE & BOX SETTINGS

INDEX NO.	PAGE NO.
502	1 OF 3
LATEST REVISION	10/21/2019