

KEY MAP
N.T.S.

Linetype Legend	
Right-of-Way Line	Project Limits
COMM	Ex. Telecommunication
E	Ex. Buried Electric Line
ROW	Ex. Water Main
SS	Ex. Recycled Water Main
FM	Ex. Sanitary Sewer
ST	Ex. Force Main
G	Ex. Storm Sewer
W	Ex. Gas Line
COMM	Ex. utilities to be demolished, abandoned, modified or relocated. Ref. to notes on the plans for more information.
E	Prop. Telecommunication
W	Prop. Buried Electric Line
ROW	Prop. Water Main
SS	Prop. Reclaimed Water Main
FM	Prop. Sanitary Sewer
ST	Prop. Force Main
G	Prop. Storm Sewer
W	Prop. Gas Line
/	Pipe & Structure to be Removed

NOTE: UTILITY ADJUSTMENT PLANS SHOULD BE PRINTED IN COLOR. EXISTING UTILITIES SHOWN IN COLOR INDICATE PROPOSED DEMOLITION, REMOVAL, MODIFICATION OR RELOCATION OF SAID UTILITIES.

UTILITY LEGEND	
① 12° - 90° BEND	⑨ 6° - 90° BEND
② 12° - 45° BEND	⑩ 6° - 45° BEND
③ 12° - 22.5° BEND	⑪ 6° - 22.5° BEND
④ 12° - 11.25° BEND	⑫ 6° - 11.25° BEND
⑤ 8° - 90° BEND	⑬ 4° - 90° BEND
⑥ 8° - 45° BEND	⑭ 4° - 45° BEND
⑦ 8° - 22.5° BEND	⑮ 4° - 22.5° BEND
⑧ 8° - 11.25° BEND	⑯ 4° - 11.25° BEND

- REF. NOTES:
- SEE DWG. NO. C-001 FOR GENERAL CONSTRUCTION NOTES.
 - SEE DWG. NO. C-300 FOR UTILITY NOTES.
 - SEE DWGs. C-201 THRU C-214 FOR GRADING AND DRAINAGE PLANS.
 - SEE DWGs. C-530 THRU C-533 FOR UTILITY DETAILS.

GENERAL NOTES:

THIS SHEET TO BE PRINTED IN COLOR

FIRE LINE NOTE:
THE WATER / PRIVATE FIRE SERVICE MAIN HEREON IS PART OF A FIRE PROTECTION SYSTEM. THE SIZE OF THE MAIN AND CONFIGURATION OF THE SYSTEM (I.E. LOOP, DEAD END, ETC.) IS SUBJECT TO DESIGN AND ADMINISTRATIVE CODES. THE SYSTEM WORKS AS SHOWN HEREON, FROM THE POINT OF CONNECTION (AS DEFINED IN SECTION 633.102(24) OF THE FLORIDA STATUTES), TO THE POINT OF TERMINATION AS SHOWN ON THESE PLANS. SHALL BE VERIFIED BY THE FIRE PROTECTION ENGINEER WHO WILL PREPARE THE FIRE PROTECTION ENGINEERING DOCUMENTS IN ACCORDANCE WITH CHAPTER 811-32-003 F.A.C. AND SUBMIT THEM TO THE AUTHORITY HAVING JURISDICTION FOR REVIEW AND APPROVAL AS PART OF THE BUILDING PERMITTING PROCESS. FIRE PROTECTION PIPING INSTALLATION MUST COMPLY WITH FLORIDA FIRE PREVENTION CODE, 6TH EDITION.

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.
The Copyrights to all designs and drawings are the property of Stantec. Production or use for any purpose other than that authorized by Stantec is forbidden.

CALL 811
ONE CALL
FLORIDA
www.callsunshine.com
(800) 432-4770
MIN. 48 HOURS
BEFORE YOU EXCAVATE

NOTICE BEFORE YOU EXCAVATE

DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.

The Copyrights to all designs and

drawings are the property of Stantec.

Production or use for any purpose

other than that authorized by

Stantec is forbidden.

**CITY OF CLEARWATER, FLORIDA
ENGINEERING DEPARTMENT
100 S. MYRTLE AVE.
CLEARWATER, FL 33756**

REVISION BY DATE



Stantec Consulting Services Inc.
777 S. Harbour Island Blvd Suite 600
Tampa, Florida 33602
Phone: (813) 223-5300
www.stantec.com
Fax: 813.223.0009
Certificate of Authorization #27013
FL Lic. # LC-C-000170
FL Lic. # AA-2600733 / # IB-2601747


Consultants
Sieben Associates, Inc.
Architectural Acoustics
Schuler Shook
Theatre Planners/Lighting
Designers
Martin Aquatics
Design & Engineering

Client/Project
**CITY OF CLEARWATER
CLEARWATER, FLORIDA**
IMAGINE CLEARWATER
CONSTRUCTION DOCUMENTS (60%) - ISSUED 01-29-2021
CITY PROJECT NO.: 17-0031-EN / CITY PLAN SET NO.: 2017026

Title
**CIVIL
UTILITY PLAN (4)**

Project No.
215614389
Scale
1" = 20'
Sheet
C-304
Revision
N / A

215614389-00C-300A,DWG

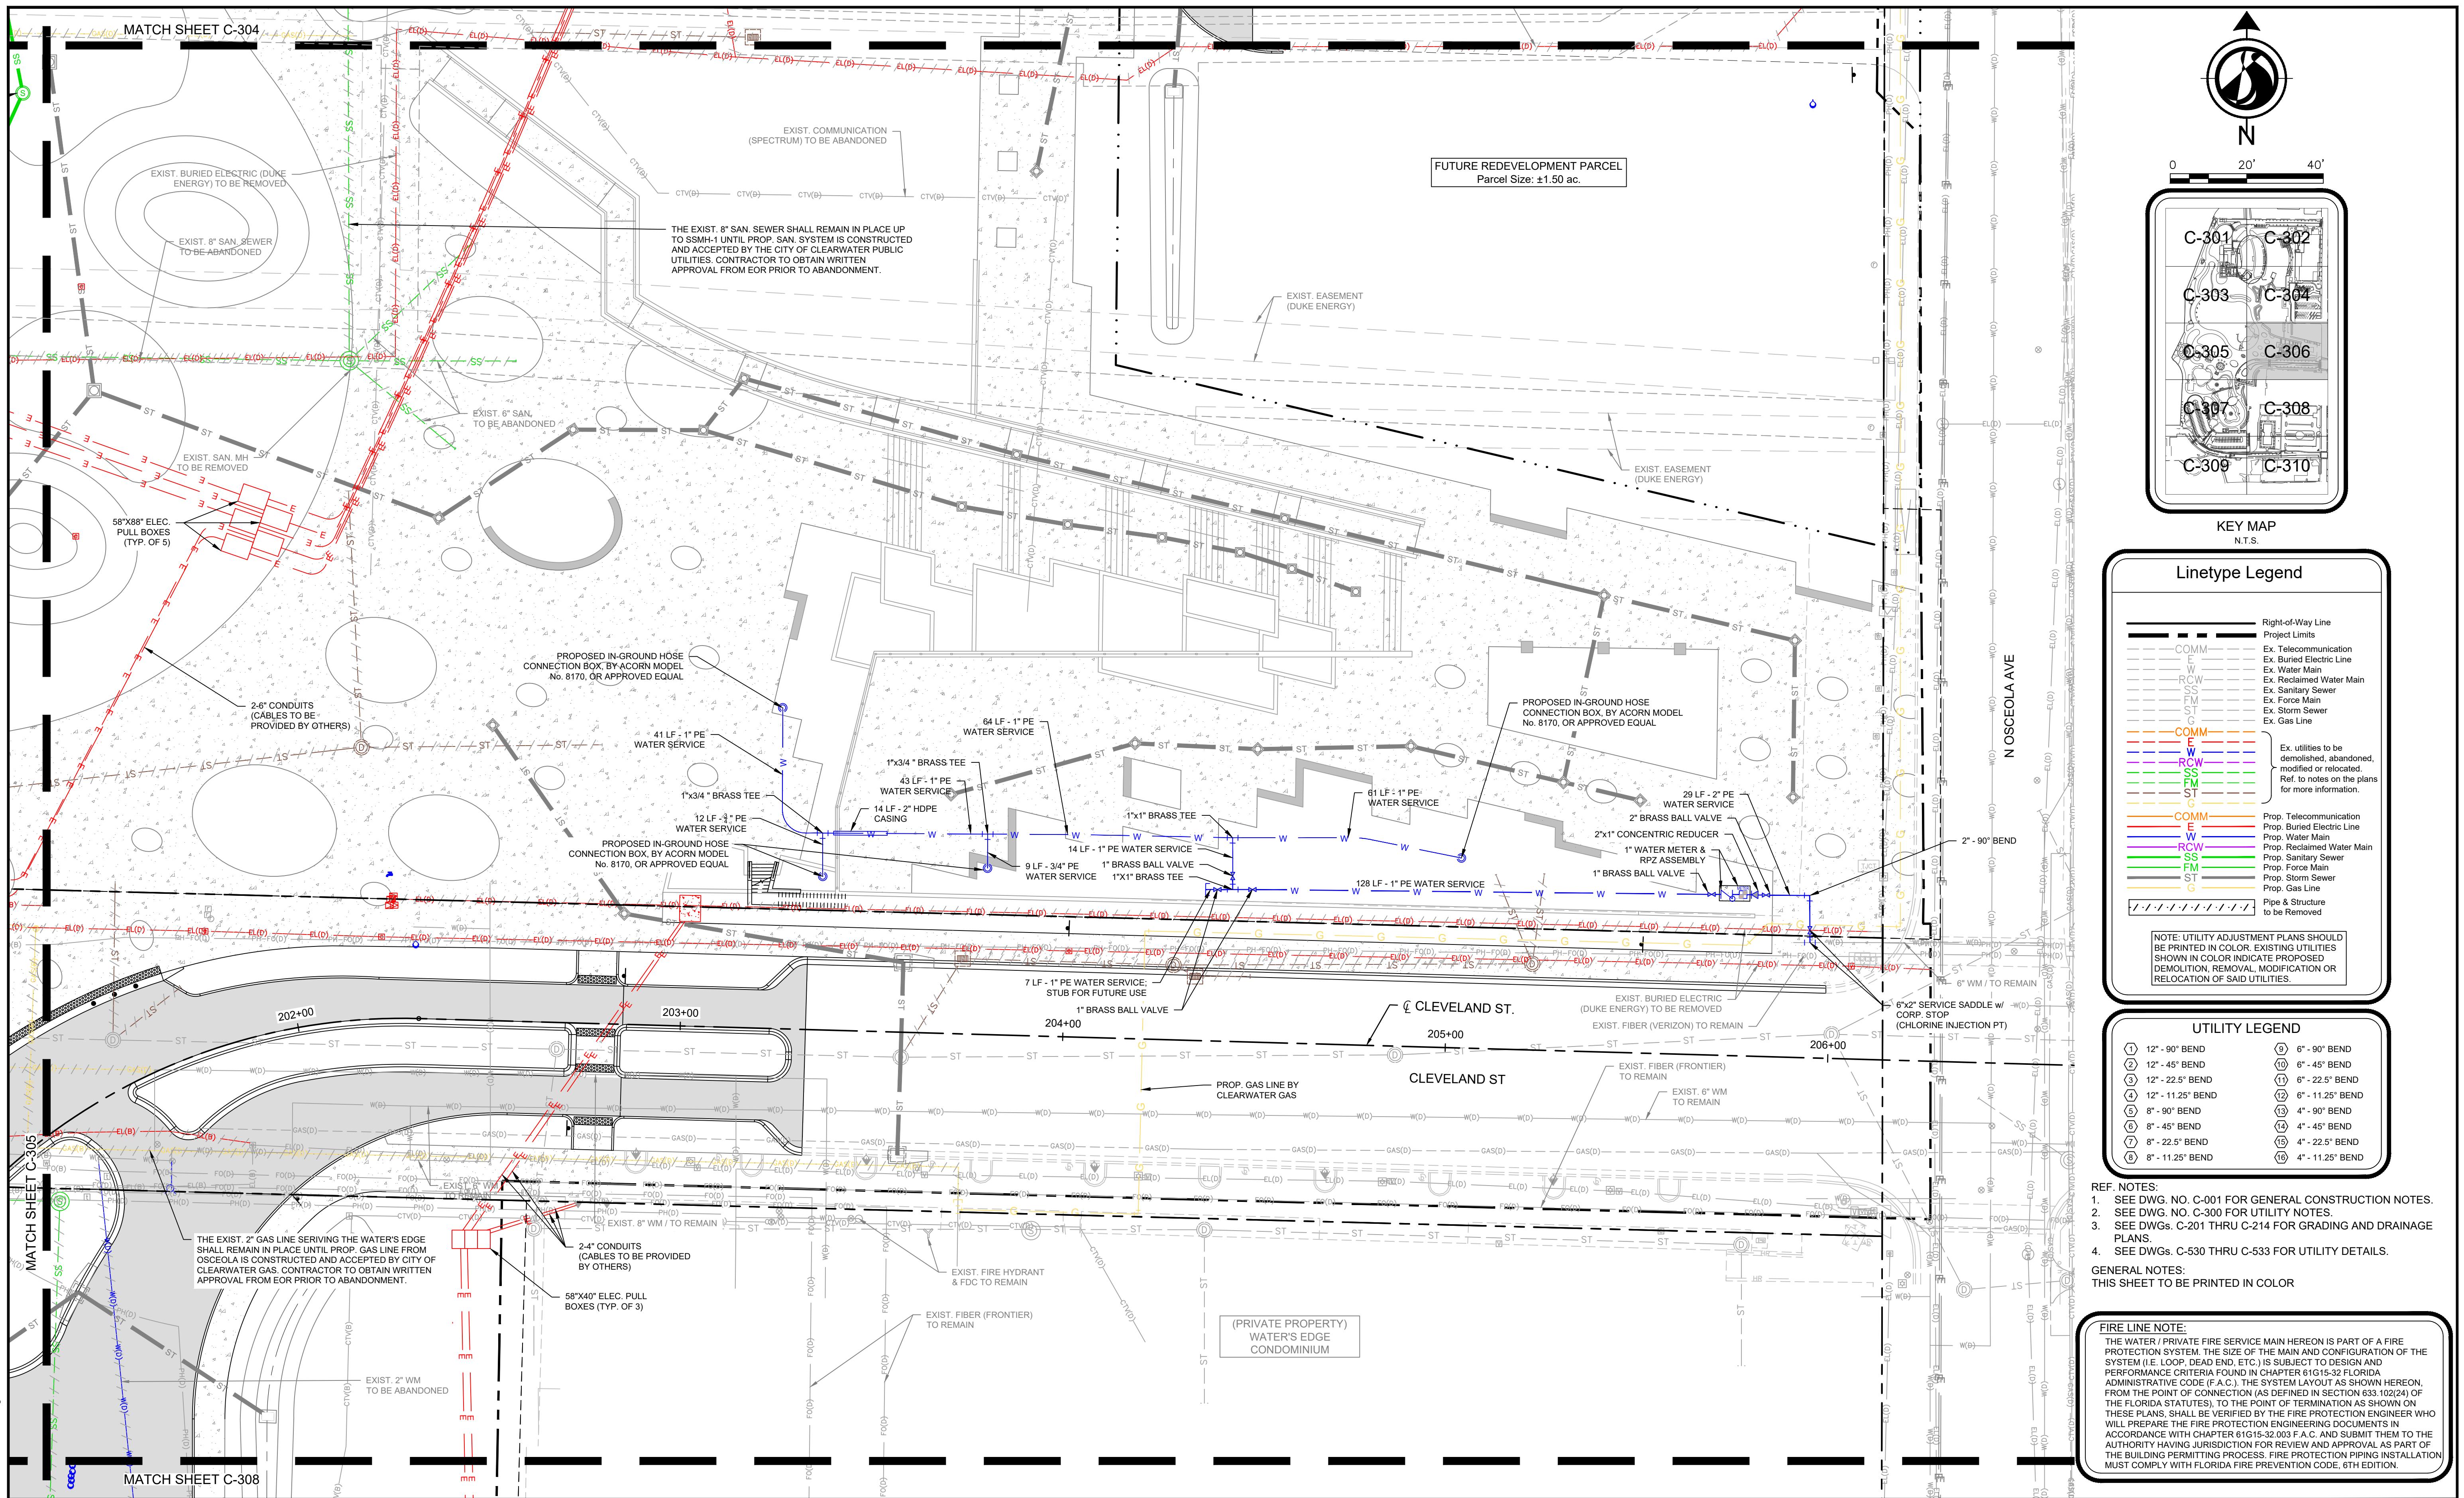

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.
The Copyrights to all designs and drawings are the property of Stantec. Production or use for any purpose other than that authorized by Stantec is forbidden.

CALL 811
SUNSHINE STATE
ONE CALL
FLORIDA
www.callsunshine.com
(800) 432-4770
MIN. 48 HOURS
BEFORE YOU EXCAVATE

NOTICE: BEFORE YOU EXCAVATE

DO NOT SCALE THE DRAWING - ANY ERRORS OR OMISSIONS SHALL BE REPORTED TO STANTEC WITHOUT DELAY.

THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF STANTEC. PRODUCTION OR USE FOR ANY PURPOSE OTHER THAN THAT AUTHORIZED BY STANTEC IS FORBIDDEN.

STANTEC CONSULTING SERVICES INC.

777 S. Harbour Island Blvd Suite 600

Hillsborough County, FL 33202

www.stantec.com

813.223.0009


Fax: 813.223.0009

Certificate of Authorization #27013

FL Lic. # LC-C000170

FL Lic. # AA-26000733 / # IB-2601747

CITY OF CLEARWATER, FLORIDA
ENGINEERING DEPARTMENT
100 S. MYRTLE AVE.
CLEARWATER, FL 33756

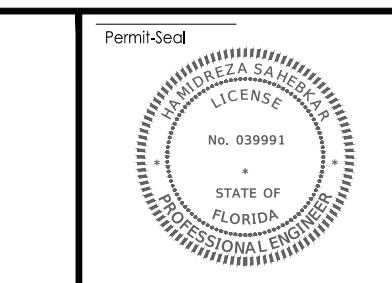

Stantec
Stantec Consulting Services Inc.
777 S. Harbour Island Blvd Suite 600
Hillsborough County, FL 33202
www.stantec.com
813.223.0009
Fax: 813.223.0009

Consultants
Sieben Associates, Inc.
Architectural Acoustics
Schuler Shook
Theatre Planners/Lighting
Designers
Martin Aquatics
Design & Engineering

Client/Project
CITY OF CLEARWATER
CLEARWATER, FLORIDA
IMAGINE CLEARWATER
CONSTRUCTION DOCUMENTS (60%) - ISSUED 01-29-2021
CITY PROJECT NO.: 17-0031-EN / CITY PLAN SET NO.: 2017026

Title
CIVIL
UTILITY PLAN (6)


Project No.
215614389



Scale
1" = 20'

Sheet
C-306

Revision
N / A

215614389-00C-300U.DWG

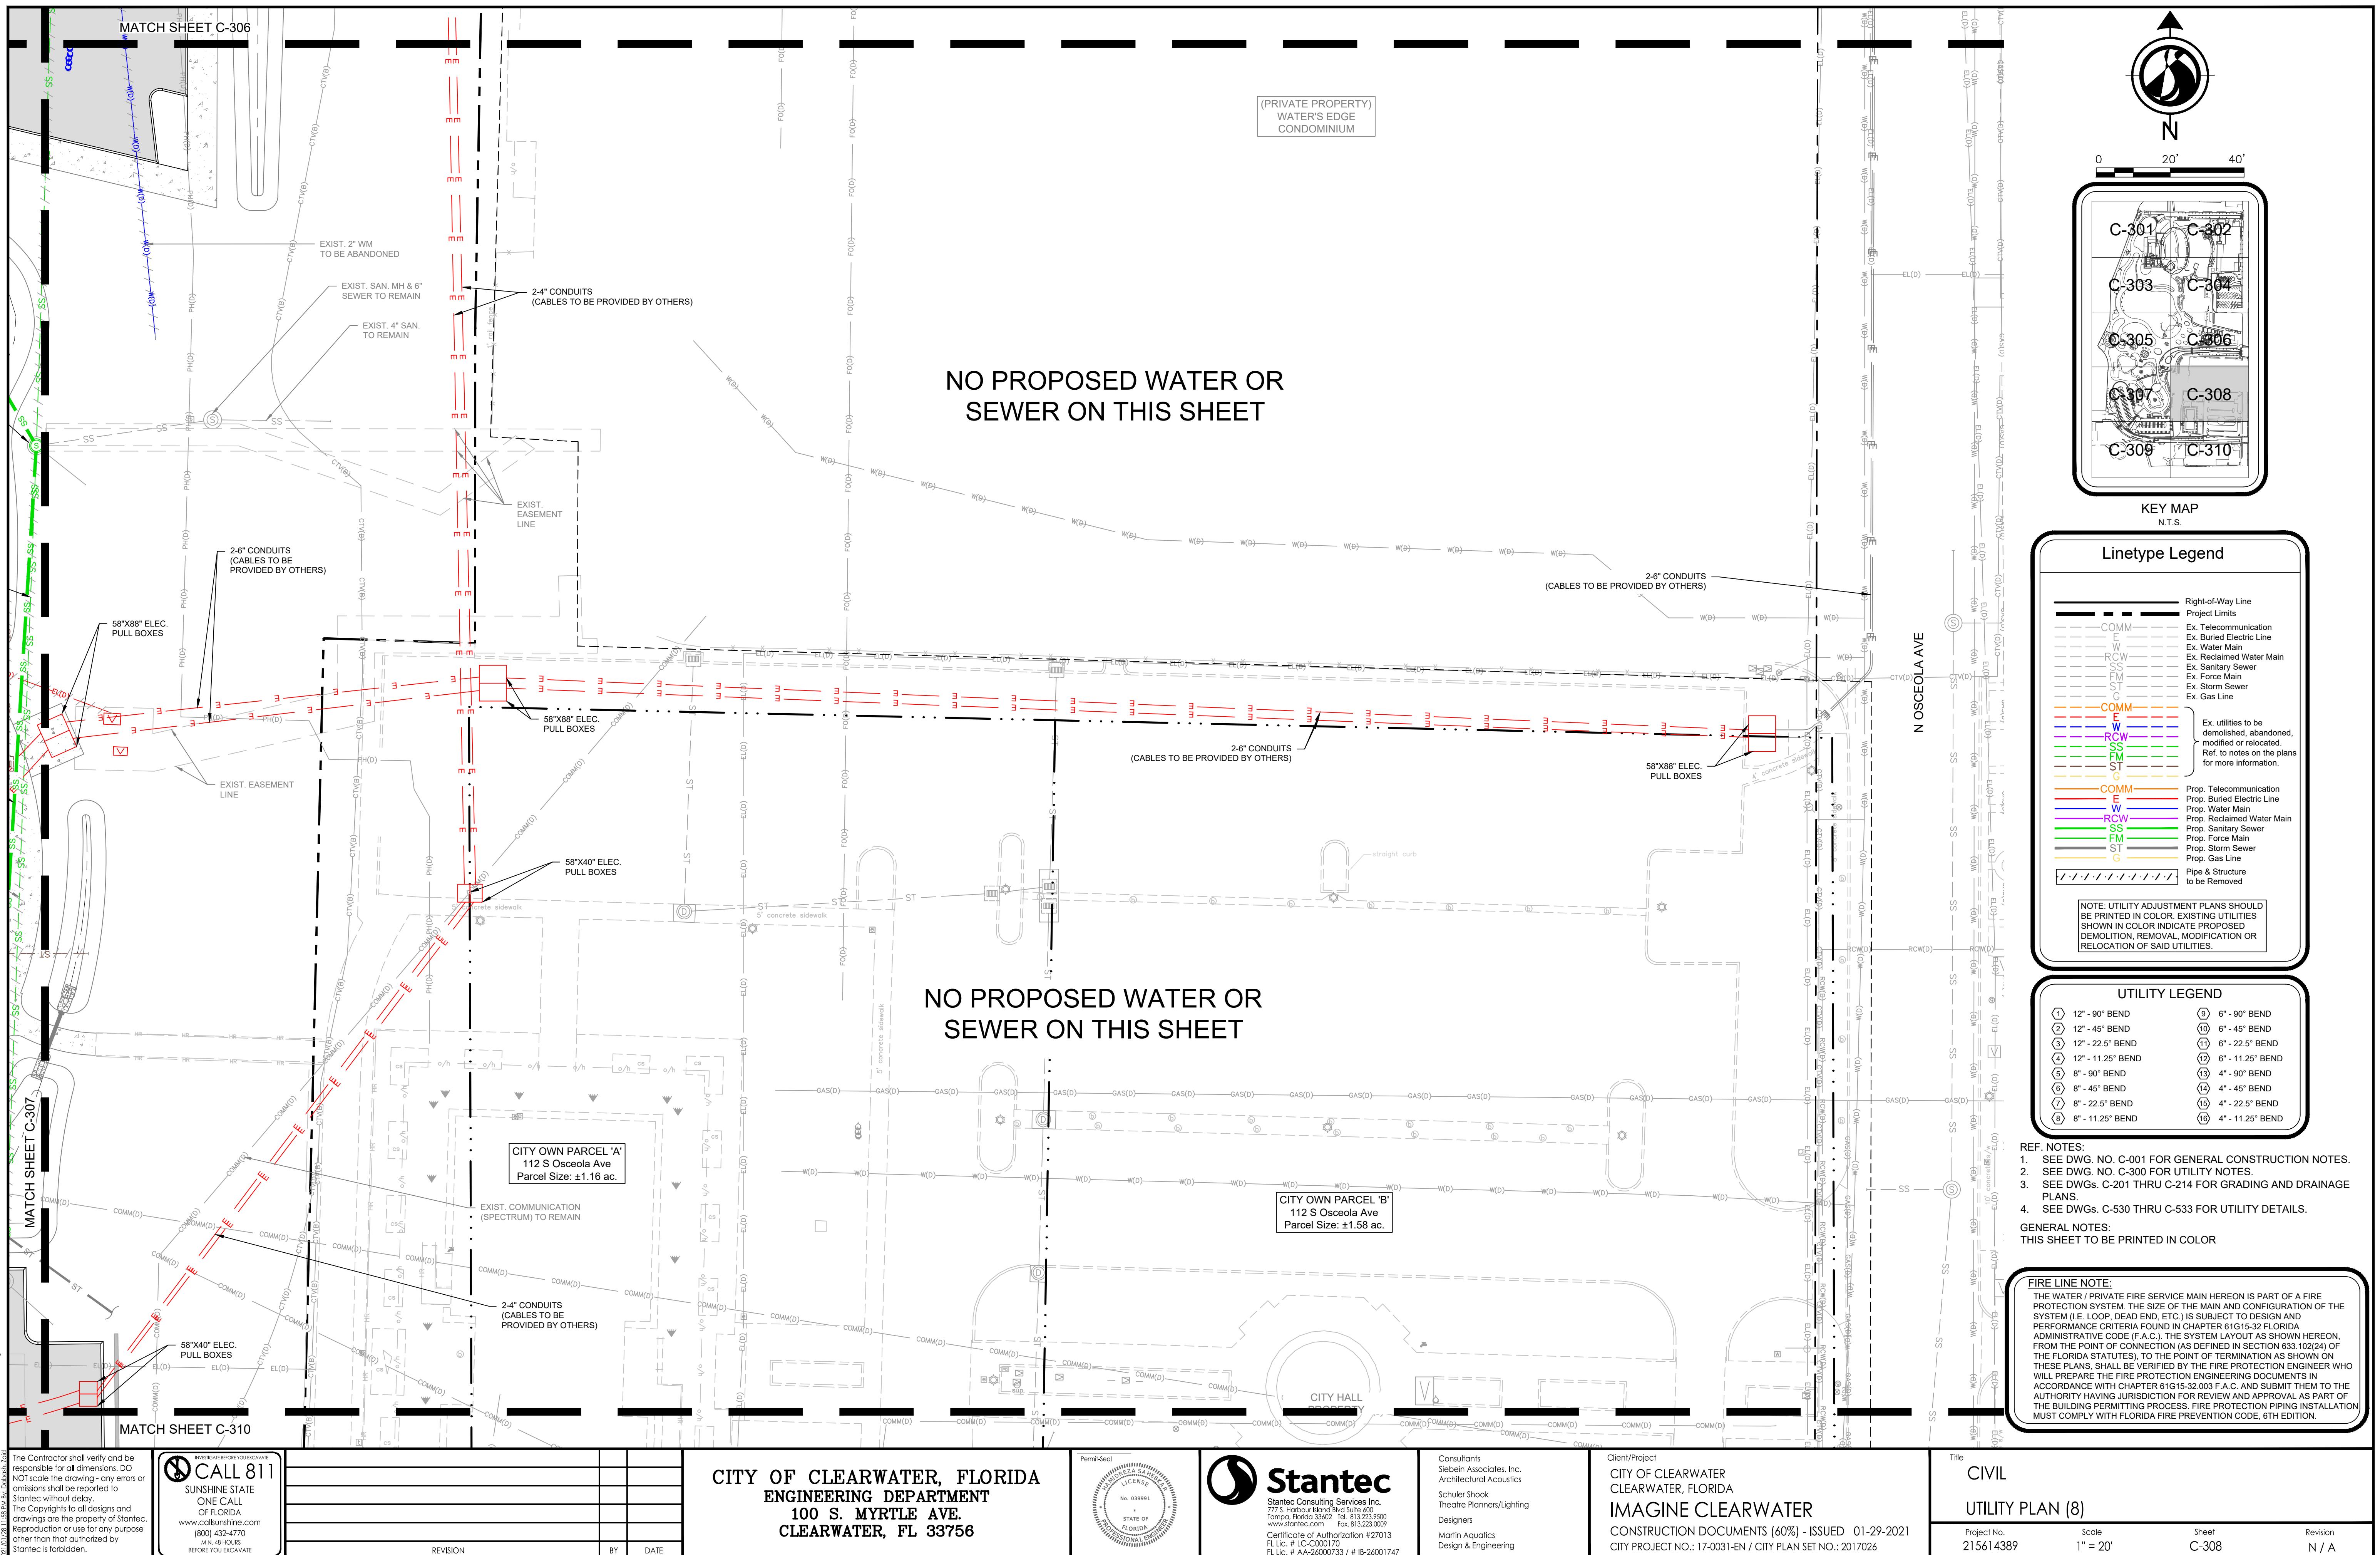

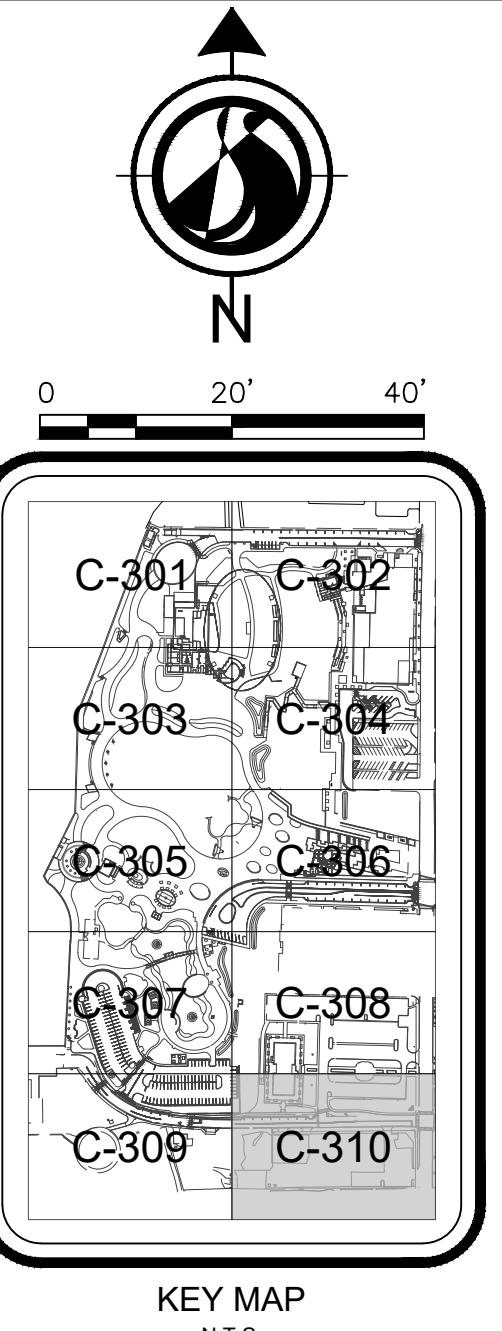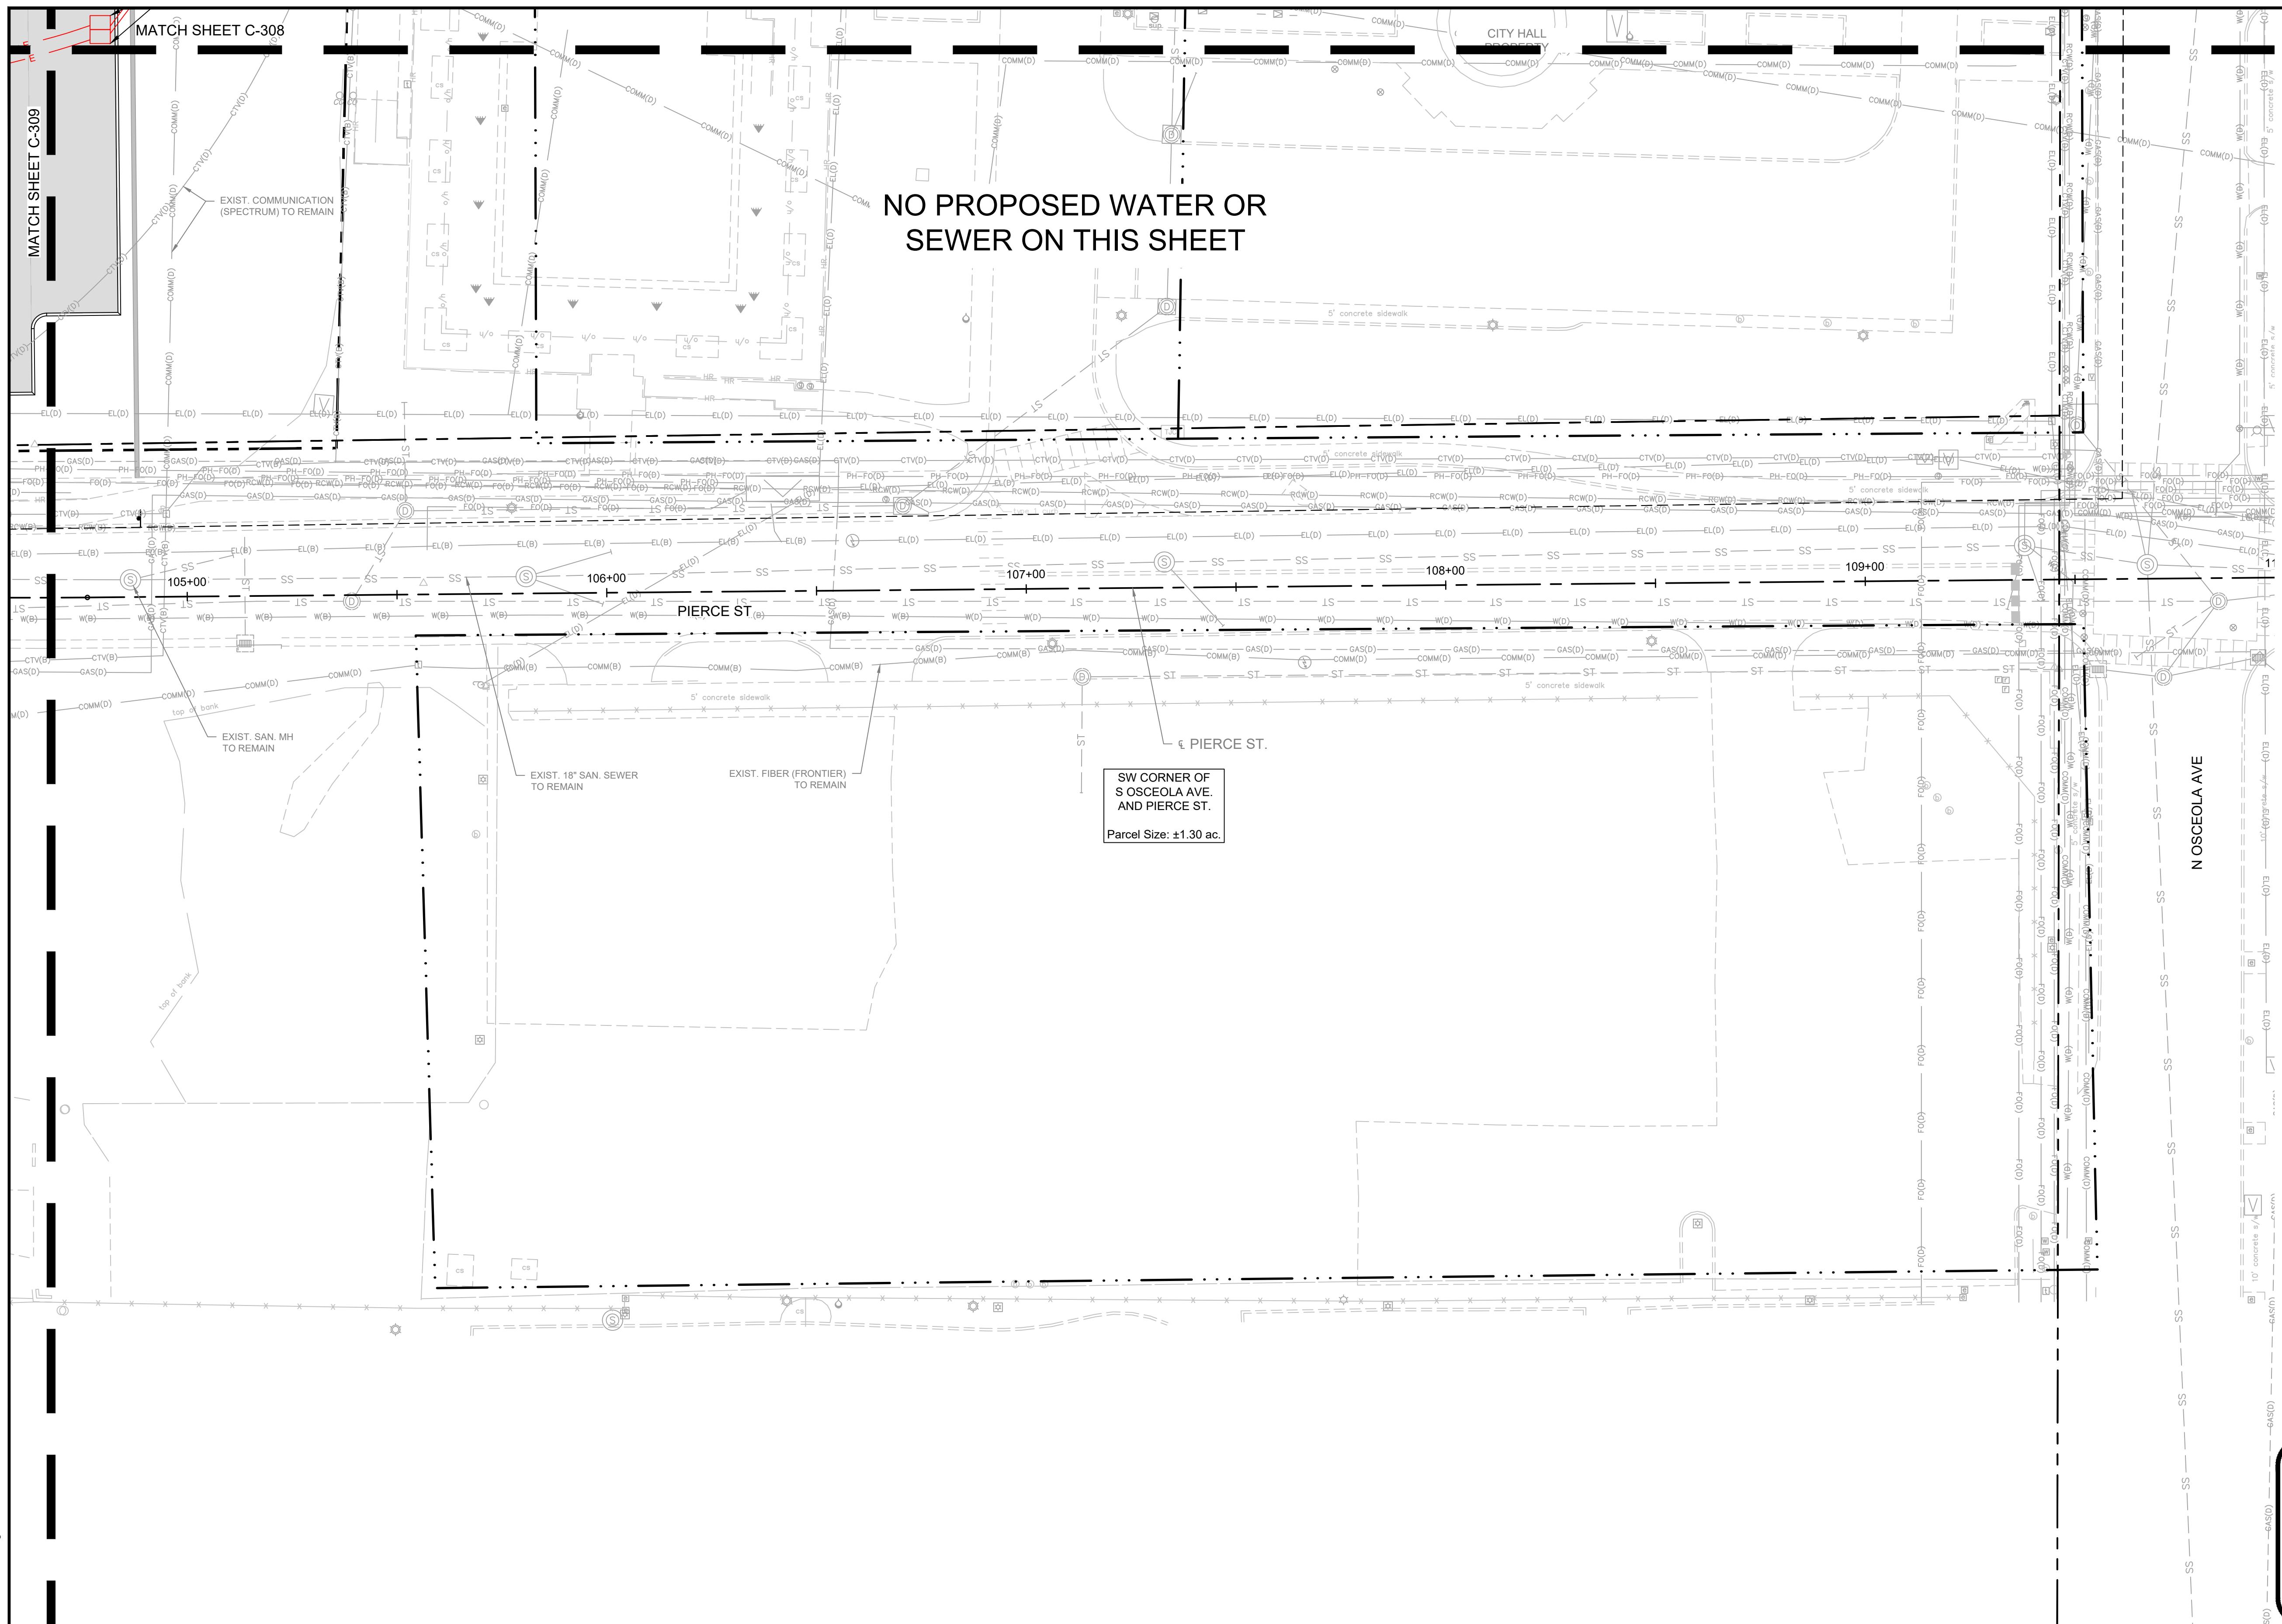

Linetype Legend

Right-of-Way Line
Project Limits
Ex. Telecommunication
Ex. Buried Electric Line
Ex. Water Main
Ex. Recycled Water Main
Ex. Sanitary Sewer
Ex. Force Main
Ex. Storm Sewer
Ex. Gas Line
Ex. utilities to be demolished, abandoned, modified or relocated. Ref. to notes on the plans for more information.
Prop. Telecommunication
Prop. Buried Electric Line
Prop. Water Main
Prop. Reclaimed Water Main
Prop. Force Main
Prop. Storm Sewer
Prop. Gas Line
Pipe & Structure to be Removed

NOTE: UTILITY ADJUSTMENT PLANS SHOULD BE PRINTED IN COLOR. EXISTING UTILITIES SHOWN IN COLOR INDICATE PROPOSED DEMOLITION, REMOVAL, MODIFICATION OR RELOCATION OF SAID UTILITIES.

① 12° - 90° BEND	⑨ 6° - 90° BEND
② 12° - 45° BEND	⑩ 6° - 45° BEND
③ 12° - 22.5° BEND	⑪ 6° - 22.5° BEND
④ 12° - 11.25° BEND	⑫ 6° - 11.25° BEND
⑤ 8° - 90° BEND	⑬ 4° - 90° BEND
⑥ 8° - 45° BEND	⑭ 4° - 45° BEND
⑦ 8° - 22.5° BEND	⑮ 4° - 22.5° BEND
⑧ 8° - 11.25° BEND	⑯ 4° - 11.25° BEND

- REF. NOTES:**
- SEE DWG. NO. C-001 FOR GENERAL CONSTRUCTION NOTES.
 - SEE DWG. NO. C-300 FOR UTILITY NOTES.
 - SEE DWGs. C-201 THRU C-214 FOR GRADING AND DRAINAGE PLANS.
 - SEE DWGs. C-530 THRU C-533 FOR UTILITY DETAILS.

GENERAL NOTES:

THIS SHEET TO BE PRINTED IN COLOR

FIRE LINE NOTE:
THE WATER / PRIVATE FIRE SERVICE MAIN HEREON IS PART OF A FIRE PROTECTION SYSTEM. THE SIZE OF THE MAIN AND CONFIGURATION OF THE SYSTEM (I.E. LOOP, DEAD END, ETC.) IS SUBJECT TO DESIGN AND PERFORMANCE CRITERIA FOUND IN CHAPTER 611 OF THE FLORIDA BUILDING CODE (FBC). THE SYSTEM LAYOUT AS SHOWN HEREON, FROM THE POINT OF CONNECTION (AS DEFINED IN SECTION 633.102(24) OF THE FLORIDA STATUTES), TO THE POINT OF TERMINATION AS SHOWN ON THESE PLANS, SHALL BE VERIFIED BY THE FIRE PROTECTION ENGINEER WHO WILL PREPARE THE FIRE PROTECTION ENGINEERING DOCUMENTS IN ACCORDANCE WITH CHAPTER 611-532.003 F.A.C. AND SUBMIT THEM TO THE AUTHORITY HAVING JURISDICTION FOR REVIEW AND APPROVAL AS PART OF THE BUILDING PERMITTING PROCESS. FIRE PROTECTION PIPING INSTALLATION MUST COMPLY WITH FLORIDA FIRE PREVENTION CODE, 6TH EDITION.