


# INSTALLATION


## NOTES:

- See also City of Clearwater's Technical Specification Section IV.

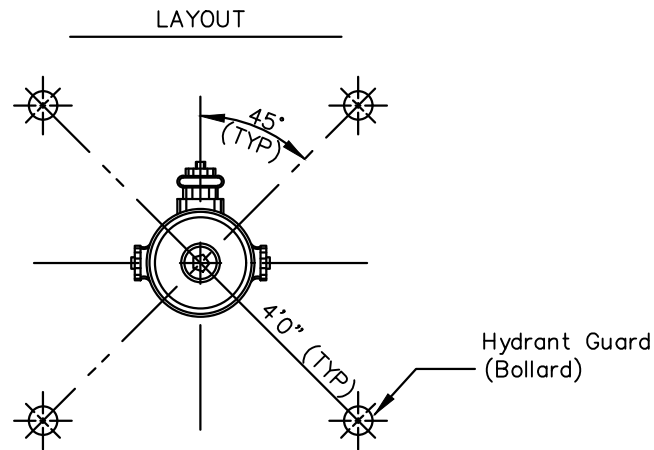

6" SCH. 40 steel pipe (OR D.I.P) filled with and set in concrete.

Two coats of paint (safety yellow) in accordance with specification ASTM D422-05

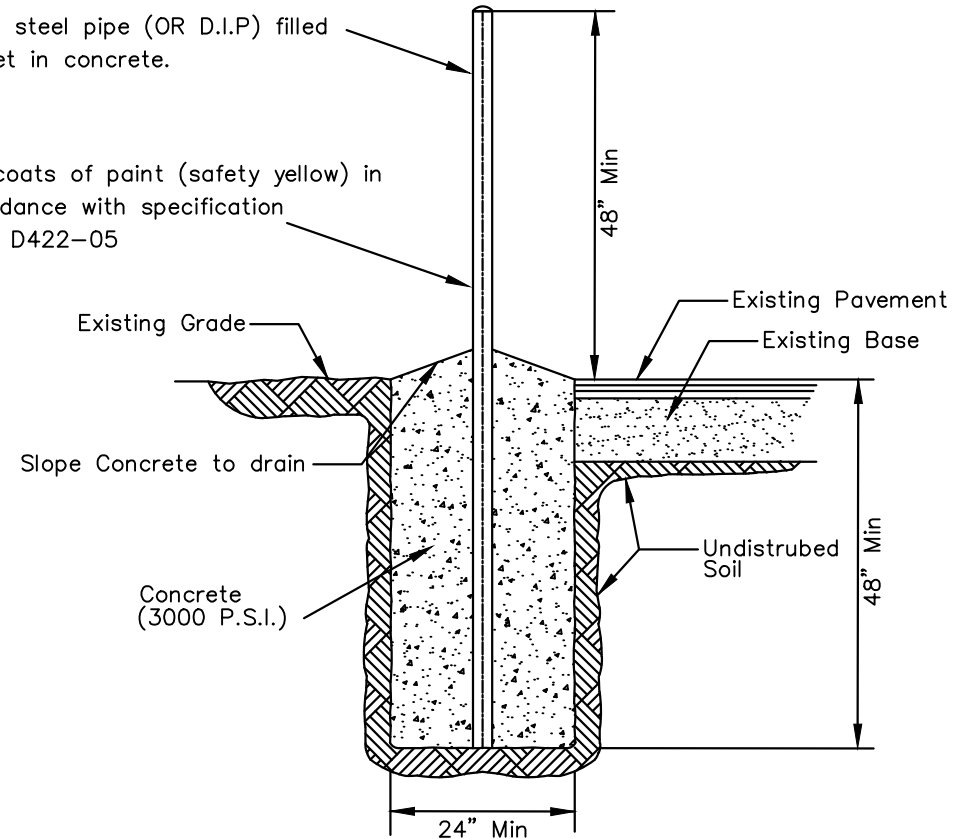

DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER  
ENGINEERING DEPARTMENT  
POTABLE WATER  
DETAILS

FIRE HYDRANT PROTECTION  
BOLLARD DETAIL

INDEX NO.	PAGE NO.
409	3 OF 3
LATEST REVISION	10/21/2019