



NOTES:

1. Extension on Valve Box shall be set so as to reserve 1/2 of the adjustment length for future use.
2. Valve key extension required on valves with operator nut over 3' deep.
3. Install 3" Brass Identification Disk in concrete, per detail below.
4. Terminate insulated, solid 12 gauge copper tracer wire at top w/ a minimum 12" of extra wire.
5. Reclaimed Water Valve Box lid openings are to be 9" x 9" square.
6. Tracer Wire Station — Installed where new construction tie-in to existing pipe. Wire brought up into valve pad on top of pipe.
7. Valve Box to be centered in concrete slab in green space only.
8. See also City of Clearwater's Technical Specification Section IV.

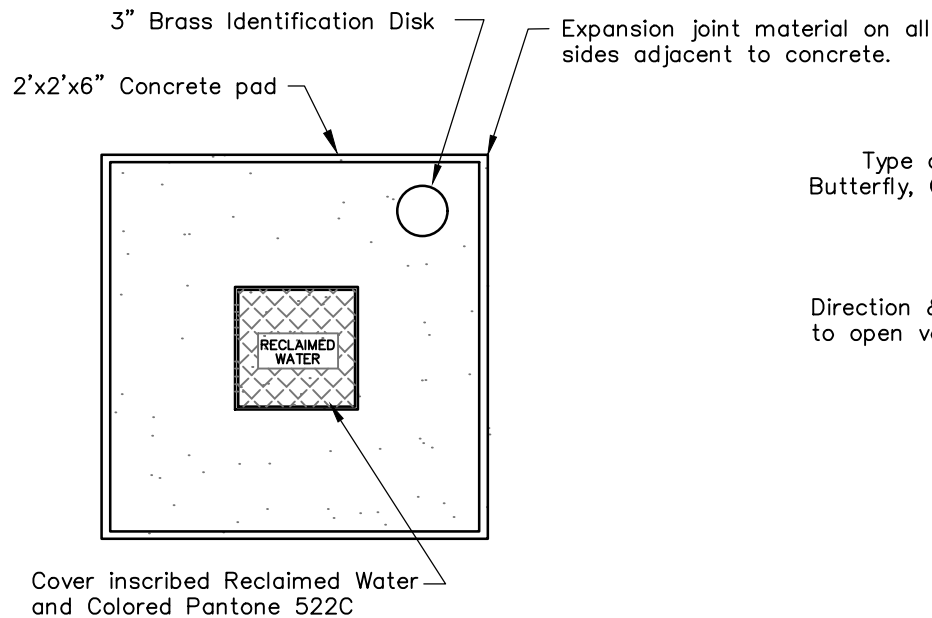

PLAN VIEW
N.T.S.

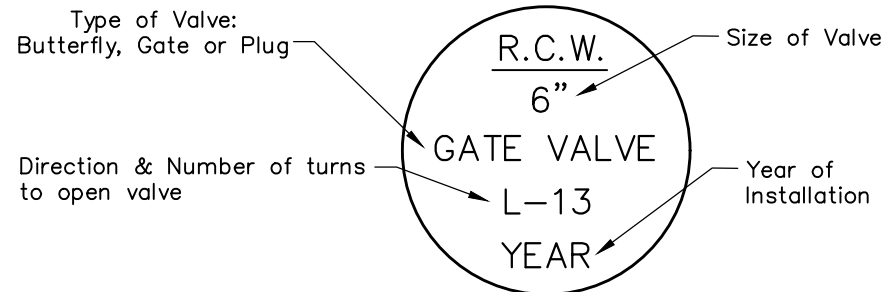

3" BRASS IDENTIFICATION DISK
N.T.S.

DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
RECLAIMED WATER
DETAILS

RECLAIMED WATER VALVE BOX
CONCRETE PAD PLAN VIEW
GREEN SPACE ONLY

INDEX NO.	PAGE NO.
502	2 OF 3
LATEST REVISION	10/21/2019