



STRAIGHT CURB
N.T.S.

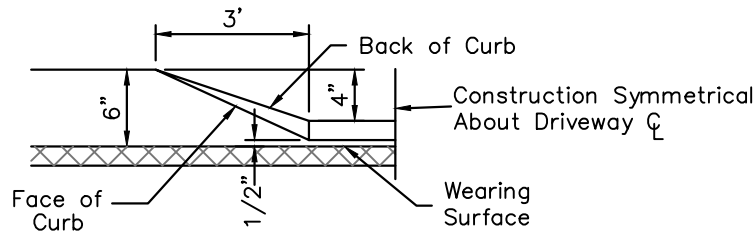

3' TRANSITION AT DRIVES
N.T.S.

NOTES:

1. There shall be a 1/2" seal joint between back of curb and driveway.
2. Concrete in curbs shall be 3000 psi, with fiber mesh reinforcing.

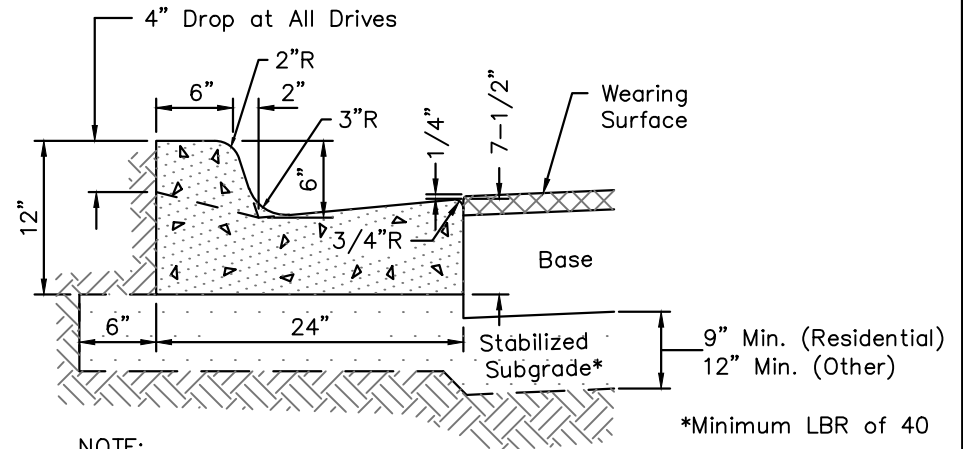

NOTE:

When used on high side of roadways, the cross slope of the gutter shall match the cross slope of the adjacent pavement and the thickness of the lip shall be 6", unless otherwise shown on plans.

TYPE I CURB
N.T.S.

2/27/17	SUBGRADE UPDATED	JWS
5/18/15	COMPACTION THICKNESS	S.R.
DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
**STREET SECTIONS
AND DETAILS**

**TYPICAL CURB
CROSS SECTIONS**

INDEX NO.	PAGE NO.
101	1 OF 2
LATEST REVISION	2/27/17