



MODIFIED CURB

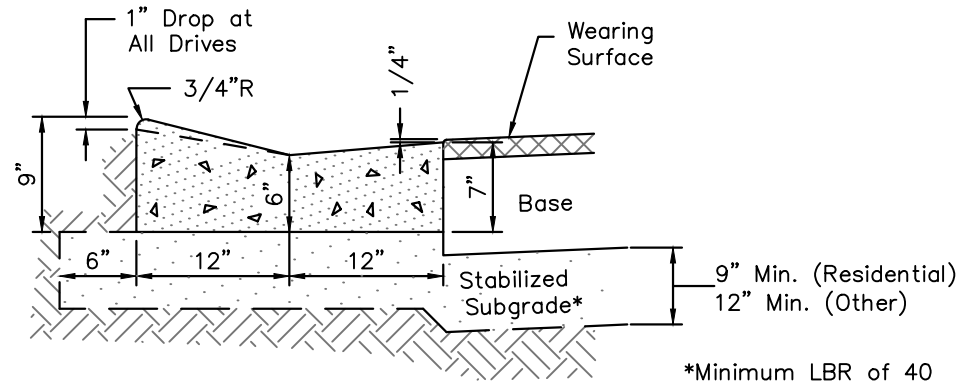


VALLEY GUTTER CURB

NOTES:

1. There shall be a 1/2" seal joint between back of curb and driveway.
2. Concrete in curbs shall be 3000 psi, with fiber mesh reinforcing.

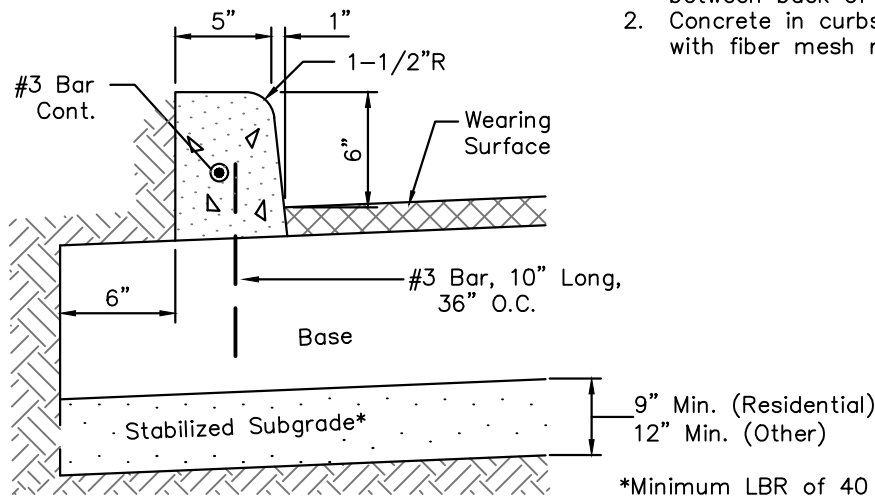

PIN / DOWELLED CURB

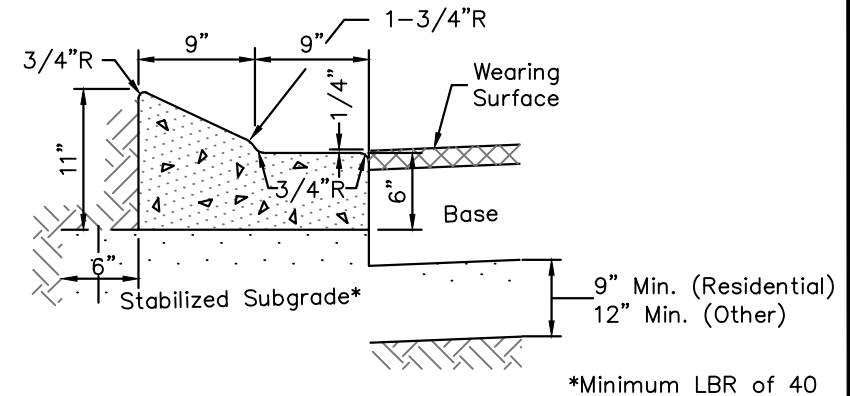

MEDIAN CURB

2/27/17	SUBGRADE UPDATED	JWS
5/18/15	COMPACTION THICKNESS	S.R.
DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
**STREET SECTIONS
AND DETAILS**

**TYPICAL CURB
CROSS SECTIONS**

INDEX NO.	PAGE NO.
101	2 OF 2
LATEST REVISION	2/27/2017