


NOTES:

1. 2" PVC casing, colored Pantone 522c, shall extend to customer side of sidewalk.
2. PVC casing to be min. 18" below the surface measured from top of face of curb.
3. Reclaimed Water Mains to be min. 30" below grade and approx. 4' back of curb.
4. Curb Stop to be located approx. 1 foot back of Right-of-Way.
5. Service Line to be min. 12" and max. 18" below grade.
6. Connect 12-gauge tracer wire with tie wraps at Corporation Stop and at Curb Stop. Provide 1 foot minimum excess length of tracer wire in Meter Box.
7. 12-gauge single strand tracer wire should accompany all reclaimed Service Line installations.
8. 2" SDR 9 purple pipe or approved equal Service Line shall be in 4" casing, colored Pantone 522c.
9. See also City of Clearwater's Technical Specification Section IV.

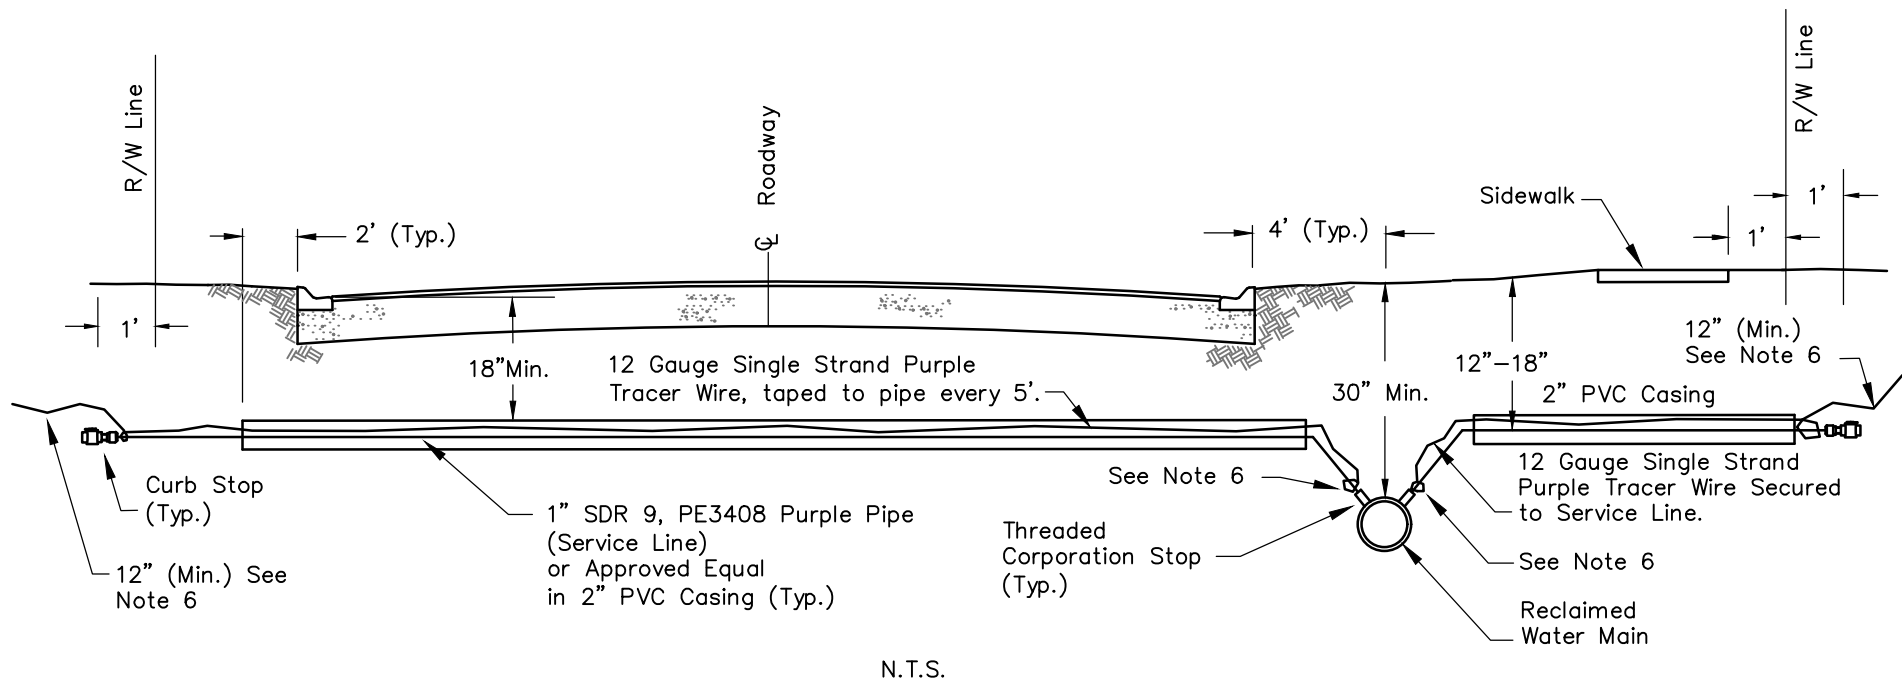

DATE	REVISION DESCRIPTION	APP

**CITY OF CLEARWATER**  
ENGINEERING DEPARTMENT  
**RECLAIMED WATER**  
DETAILS

**RECLAIMED WATER MAIN SERVICE LINES**  
**TYPICAL SECTION**

INDEX NO.	PAGE NO.
501	1 OF 2
LATEST REVISION	10/21/2019