



PLAN VIEW  
N.T.S.

NOTES:


1. Provide tooled joints at distances matching the width. Also place expansion joints at driveways.
2. If some physical obstruction exists which prevents the placing of sidewalks as shown, contact the Engineering Division for alternate location or design.
3. Wooden and other spacers will not be permitted in sidewalks or driveways.
4. No coatings of any kind will be permitted on concrete sidewalks or driveways without specific approval of the City Engineer.
5. All concrete shall be 3000 psi min. @ 28 days, with fiber mesh reinforcing.
6. Concrete surface to be light broom finish.
7. Concrete driveway construction shall be 6" thick w 6"x 6"/10x10 welded wire fabric reinforcement.
8. Ramps shall have a detectable warning surface in conformance with requirements of FDOT Roadway and Traffic Design Standards, Detail 304 or most recent modifications.
9. Grade retaining straight curb to be 6" wide x 12"-18" deep and poured monolithically with 6" thick ramp.

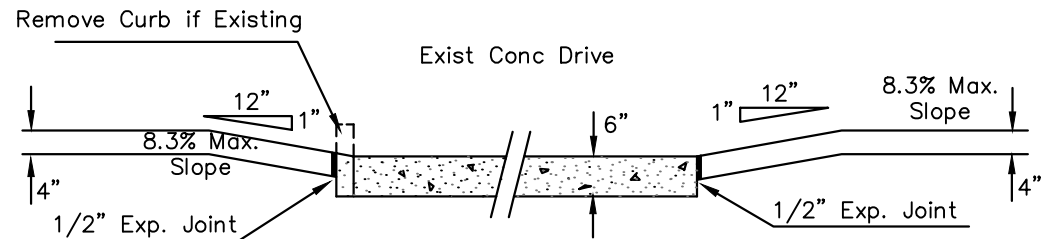

TYPICAL DRIVEWAY CROSS SECTION  
N.T.S.

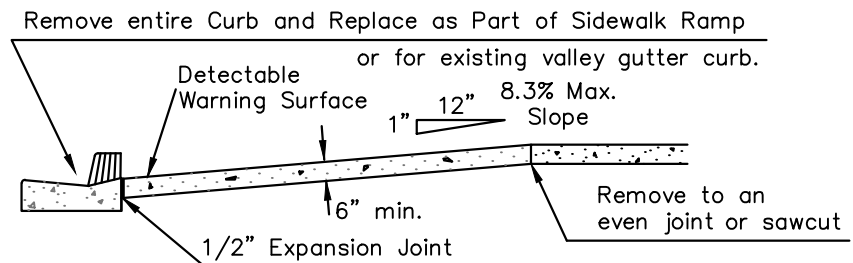

SECTION A-A  
N.T.S.

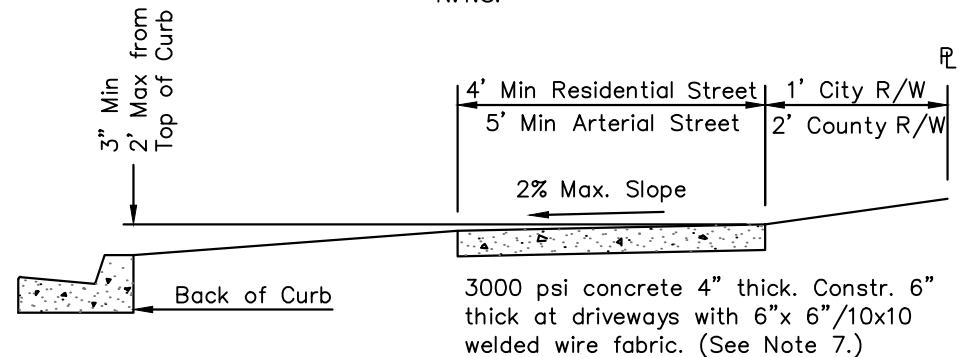

SECTION B-B  
N.T.S.

DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER  
ENGINEERING DEPARTMENT  
STREET SECTIONS  
AND DETAILS

TYPICAL SIDEWALK CONSTRUCTION  
& RAMP DETAIL

INDEX NO.	PAGE NO.
109	1 OF 5
LATEST REVISION	12/06/2019