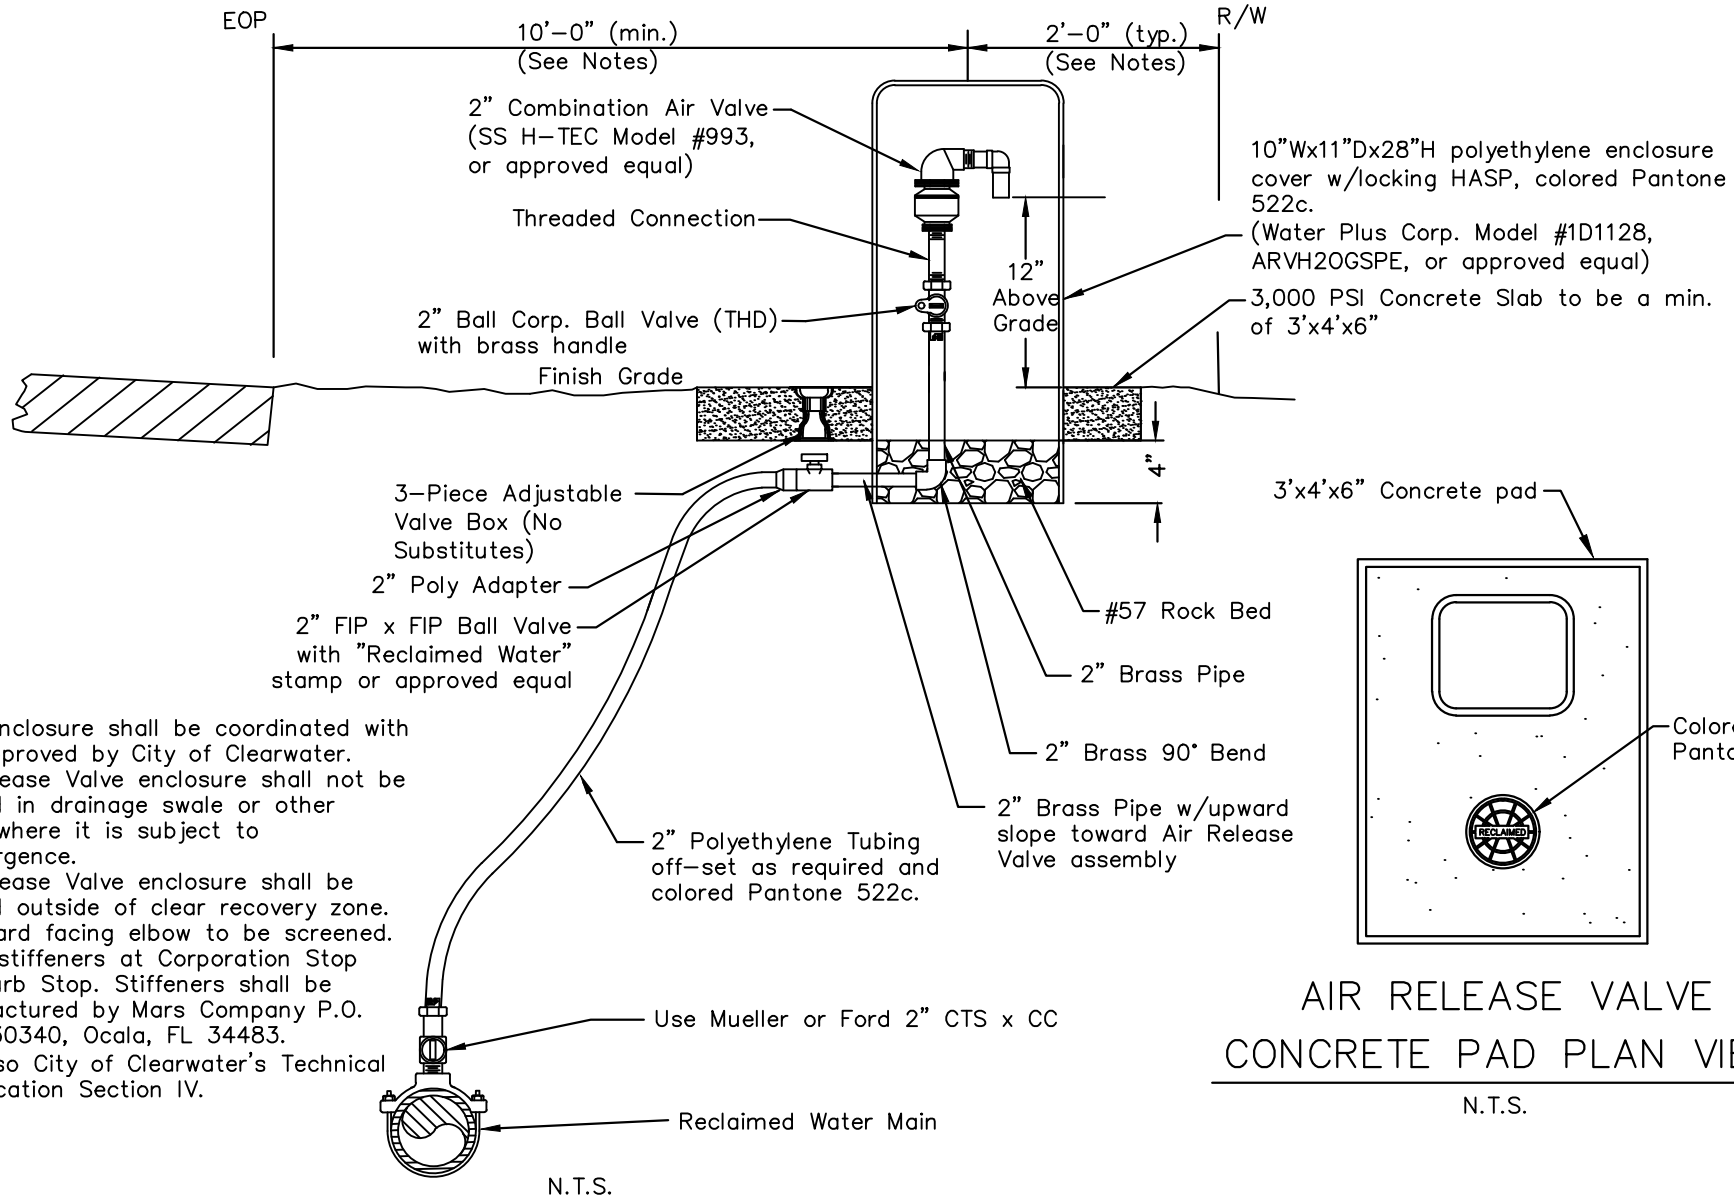

NOTES:

1. Final enclosure shall be coordinated with and approved by City of Clearwater.
2. Air Release Valve enclosure shall not be located in drainage swale or other areas where it is subject to submergence.
3. Air Release Valve enclosure shall be located outside of clear recovery zone.
4. Downward facing elbow to be screened.
5. Insert stiffeners at Corporation Stop and Curb Stop. Stiffeners shall be manufactured by Mars Company P.O. Box 830340, Ocala, FL 34483.
6. See also City of Clearwater's Technical Specification Section IV.

AIR RELEASE VALVE
CONCRETE PAD PLAN VIEW

N.T.S.

DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
RECLAIMED WATER DETAILS

TYPICAL AIR RELEASE VALVE
RECLAIMED WATER APPLICATION

INDEX NO.	PAGE NO.
505	1 OF 1
LATEST REVISION	10/21/2019