


NOTES:

1. Parallel device installation is employed whenever it is vital to maintain a continuous supply of water and where interruptions for testing and servicing would be unacceptable. device must be installed level.
2. Bottom of Reduced Pressure Zone (RPZ) Backflow Prevention Device shall be set 12" above ground elevation.
3. Contractor must purchase meter and backflow preventer from City of Clearwater Customer Service Department (727-562-4600). City of Clearwater will install.
4. Minimum of 3' clearance around device
5. See also City of Clearwater's Technical Specification Section IV.

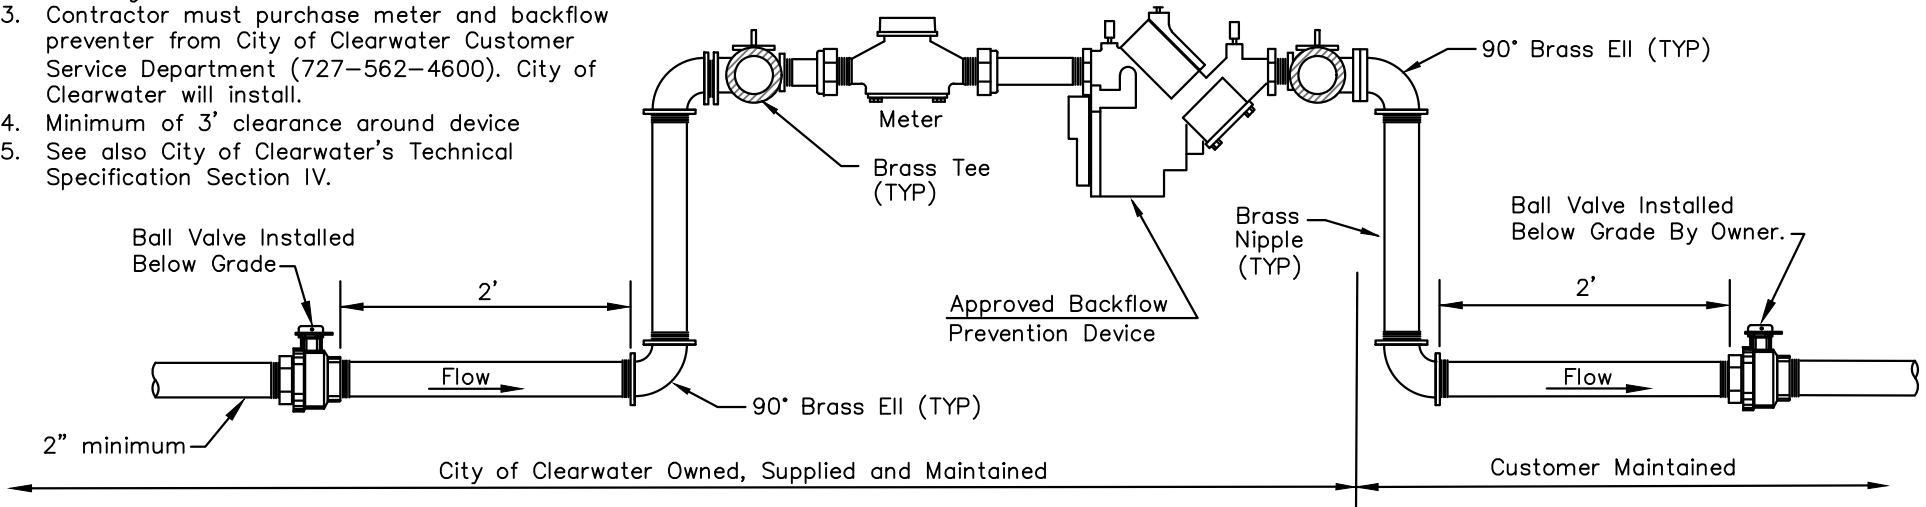

DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
POTABLE WATER
DETAILS

TYPICAL DUAL PARALLEL METER SET
1" to 2" MODELS

INDEX NO.	PAGE NO.
405	1 OF 2
LATEST REVISION	10/21/2019