


NOTES:

- Pavement materials and thickness, and base materials and thickness will be stated in construction drawings and scope of the work.
- 2. See construction drawings for curb type and lane widths.
- 3. See Section IV, 702 for acceptable base and subgrade materials
- Refer to Index No. 109 and/or FDOT Detail 304 for Sidewalk criteria. The more stringent criteria will be required.
- Stabilized subgrade shall be a minimum of 9" for neighborhood streets and a minimum of 12" for all other streets.

2 AND 3 LANE STREET N.T.S.

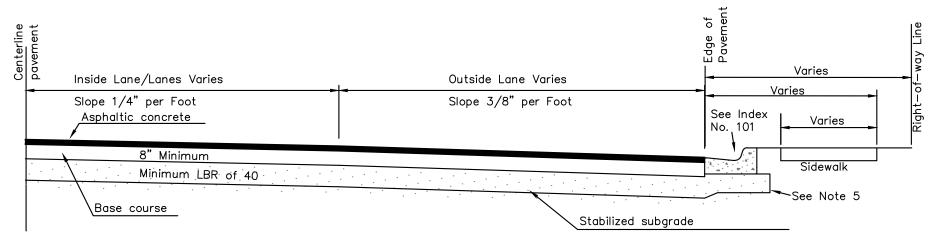

4 AND 5 LANE STREET N.T.S.

		_	
2/24/17	ADDED NOTE	JWS	11
9/9/15	ADDED SIDEWALKS & ROW DETAIL TO DRAWING	J.S.	$\ \cdot \ $
DATE	REVISION DESCRIPTION	APP	Л
			'

CITY	OF	CLEARWA	TER		
CITY OF CLEARWATER ENGINEERING DEPARTMENT STREET SECTIONS					
S	TREE	T SECTIONS			
	AND	DETAILS			

TYPICAL STREET SECTION

INDEX NO.	PAGE NO.
102	1 of 1
LATEST REVISION	02/24/17