
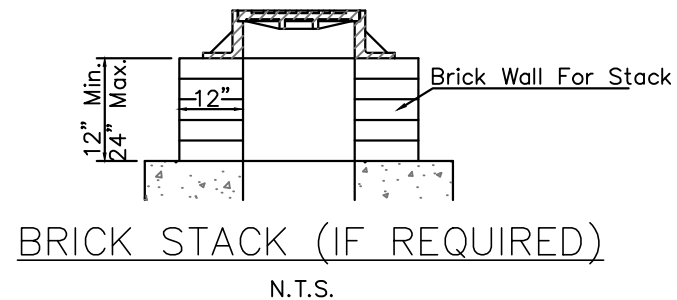


NOTES:

1. Storm sewers and manhole to be centered in junction box unless otherwise specified in plans.
2. All concrete to be 3,000 psi, with fiber mesh reinforcing.
3. All steel bars shall have 1 1/4" minimum cover unless otherwise shown and shall be hooked where indicated. Horizontal steel shall be lapped a minimum of 24 bar diameters at corners. On precast units, floor slabs may be secured to structure walls by no. 4 dowel bars (a minimum of 6 dowels) pushed into the wet concrete after the floor slab is placed.
4. Chamfer all exposed edges 3/4".

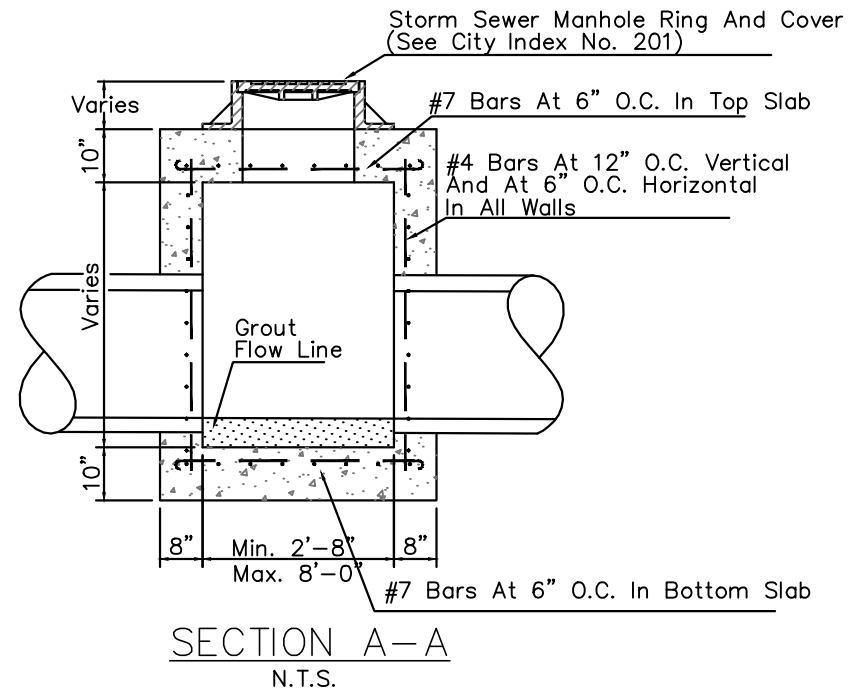

6/3/15	EDITED NOTES	S.R.
DATE	REVISION DESCRIPTION	APP

CITY OF CLEARWATER
ENGINEERING DEPARTMENT
**STORM
DETAILS**

**JUNCTION BOX – TRAFFIC TYPE
POURED CONCRETE**

INDEX NO.	PAGE NO.
207	1 OF 1
LATEST REVISION	2/22/2016