


PHOTO: EXISTING CONDUIT RACK

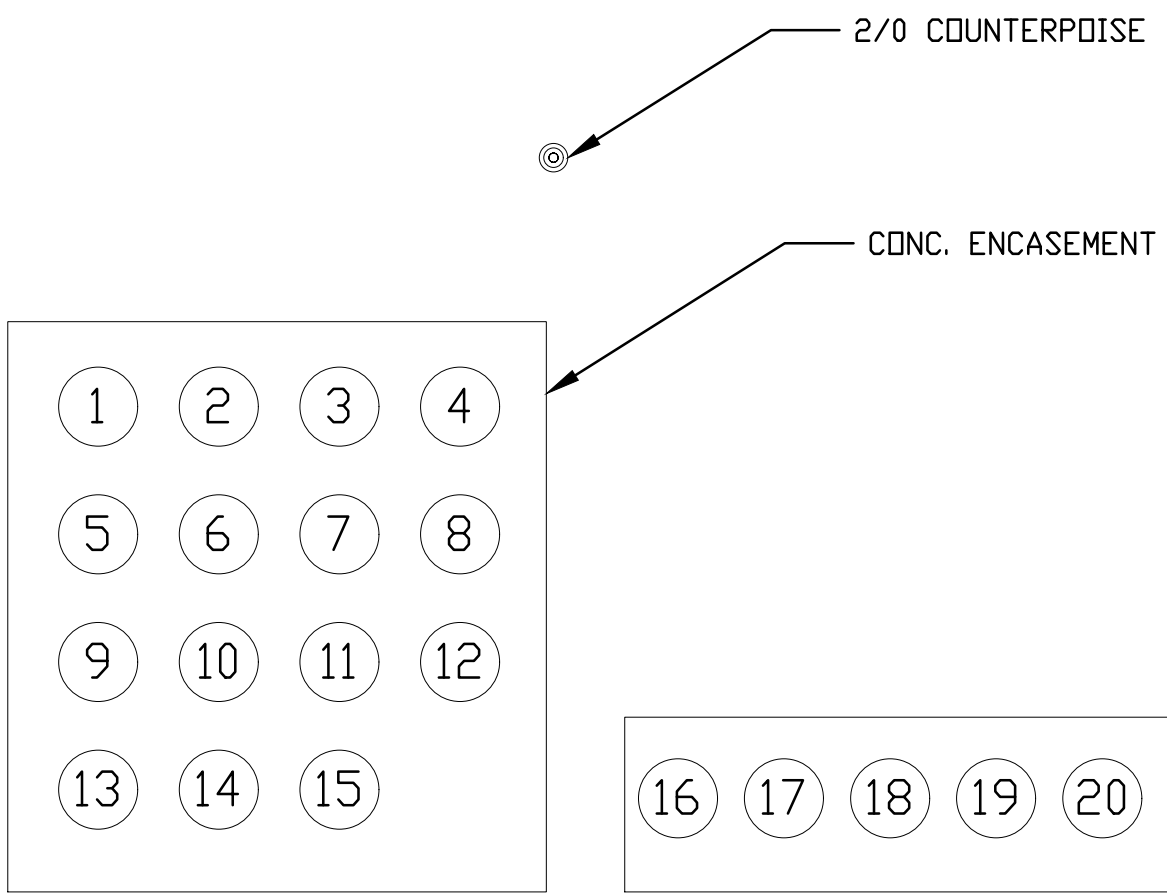

DUCTBANK A-A

- | | | | |
|----|---------|-----|--------------------|
| 1. | 101-P-1 | 10. | 110-G-1 |
| 2. | 101-P-2 | 11. | PNL LBT |
| 3. | 102-P-1 | 12. | 110-M-1 |
| 4. | 102-P-2 | 13. | 110-M-2 |
| 5. | 103-P-1 | 14. | IP CAMERA |
| 6. | 103-P-2 | 15. | SPARE-2" |
| 7. | 103-P-3 | 16. | SPARE-2" |
| 8. | 103-P-4 | 17. | CONTROL-3' |
| 9. | 101-G-1 | 18. | INSTRUMENTATION-2' |
| | | 19. | CONTROL-3' |
| | | 20. | INSTRUMENTATION-2' |

BID SET

LAST SAVED: 7/28/2020 5:39 PM WHOANSHELT DWG LOCATION: I:\MY CLIENTS DWGS\JONES EDMUNDS\CLEARWATER NE BLEND TANK\USE THESE EMI DWG 3-29-19\E-03 SITE PLAN.DWG

| RECORD DRAWINGS | | | |
|--|-----------|----|------|
| SURVEYED BY: | DRAWN BY: | | |
| REVIEWED BY: | | | |
| PROJECT ENGINEER | DATE | | |
| APPROVED BY: | | | |
| CITY ENGINEERING DIRECTOR TARA KIVETT, P.E. #86611 | DATE | | |
| REVISION | | BY | DATE |

Addendum 7, 080720 GSF

CITY OF CLEARWATER, FLORIDA
ENGINEERING DEPARTMENT
100 S. MYRTLE AVE.
CLEARWATER, FL 33756

CALL 811
SUNSHINE STATE
ONE CALL
OF FLORIDA
www.sunshine811.com
(800) 432-4770
MIN. 48 HOURS
BEFORE YOU EXCAVATE

JonesEdmunds
730 NE WALDO ROAD, GAINESVILLE, FLORIDA 32641 / (352) 377-5821
324 S HYDE PARK AVE, SUITE 250, TAMPA, FLORIDA 33606 / (813) 258-0703

NE WRF SLUDGE BLEND
TANK IMPROVEMENTS
SITE PLAN

| | | | |
|-----------------------------|-----------------------------------|-----------------|-----------------|
| DWG NAME: -03 SITE PLAN.dwg | FIELD BOOK: | SURVEYED BY: | SCALE: |
| CONTRACT NO.: 14-0036-UT | DATE DRAWN: JULY 2019 | DRAWN BY: JPH | VERT. AS NOTED |
| JOB NO.: 03720-048-01 | DESIGNED BY: WCH | CHECKED BY: WCH | HORIZ. AS NOTED |
| APPROVED FOR CONSTRUCTION | WILLARD C HOANSHELT, P.E. # 42593 | | SHEET NO.: E3 |