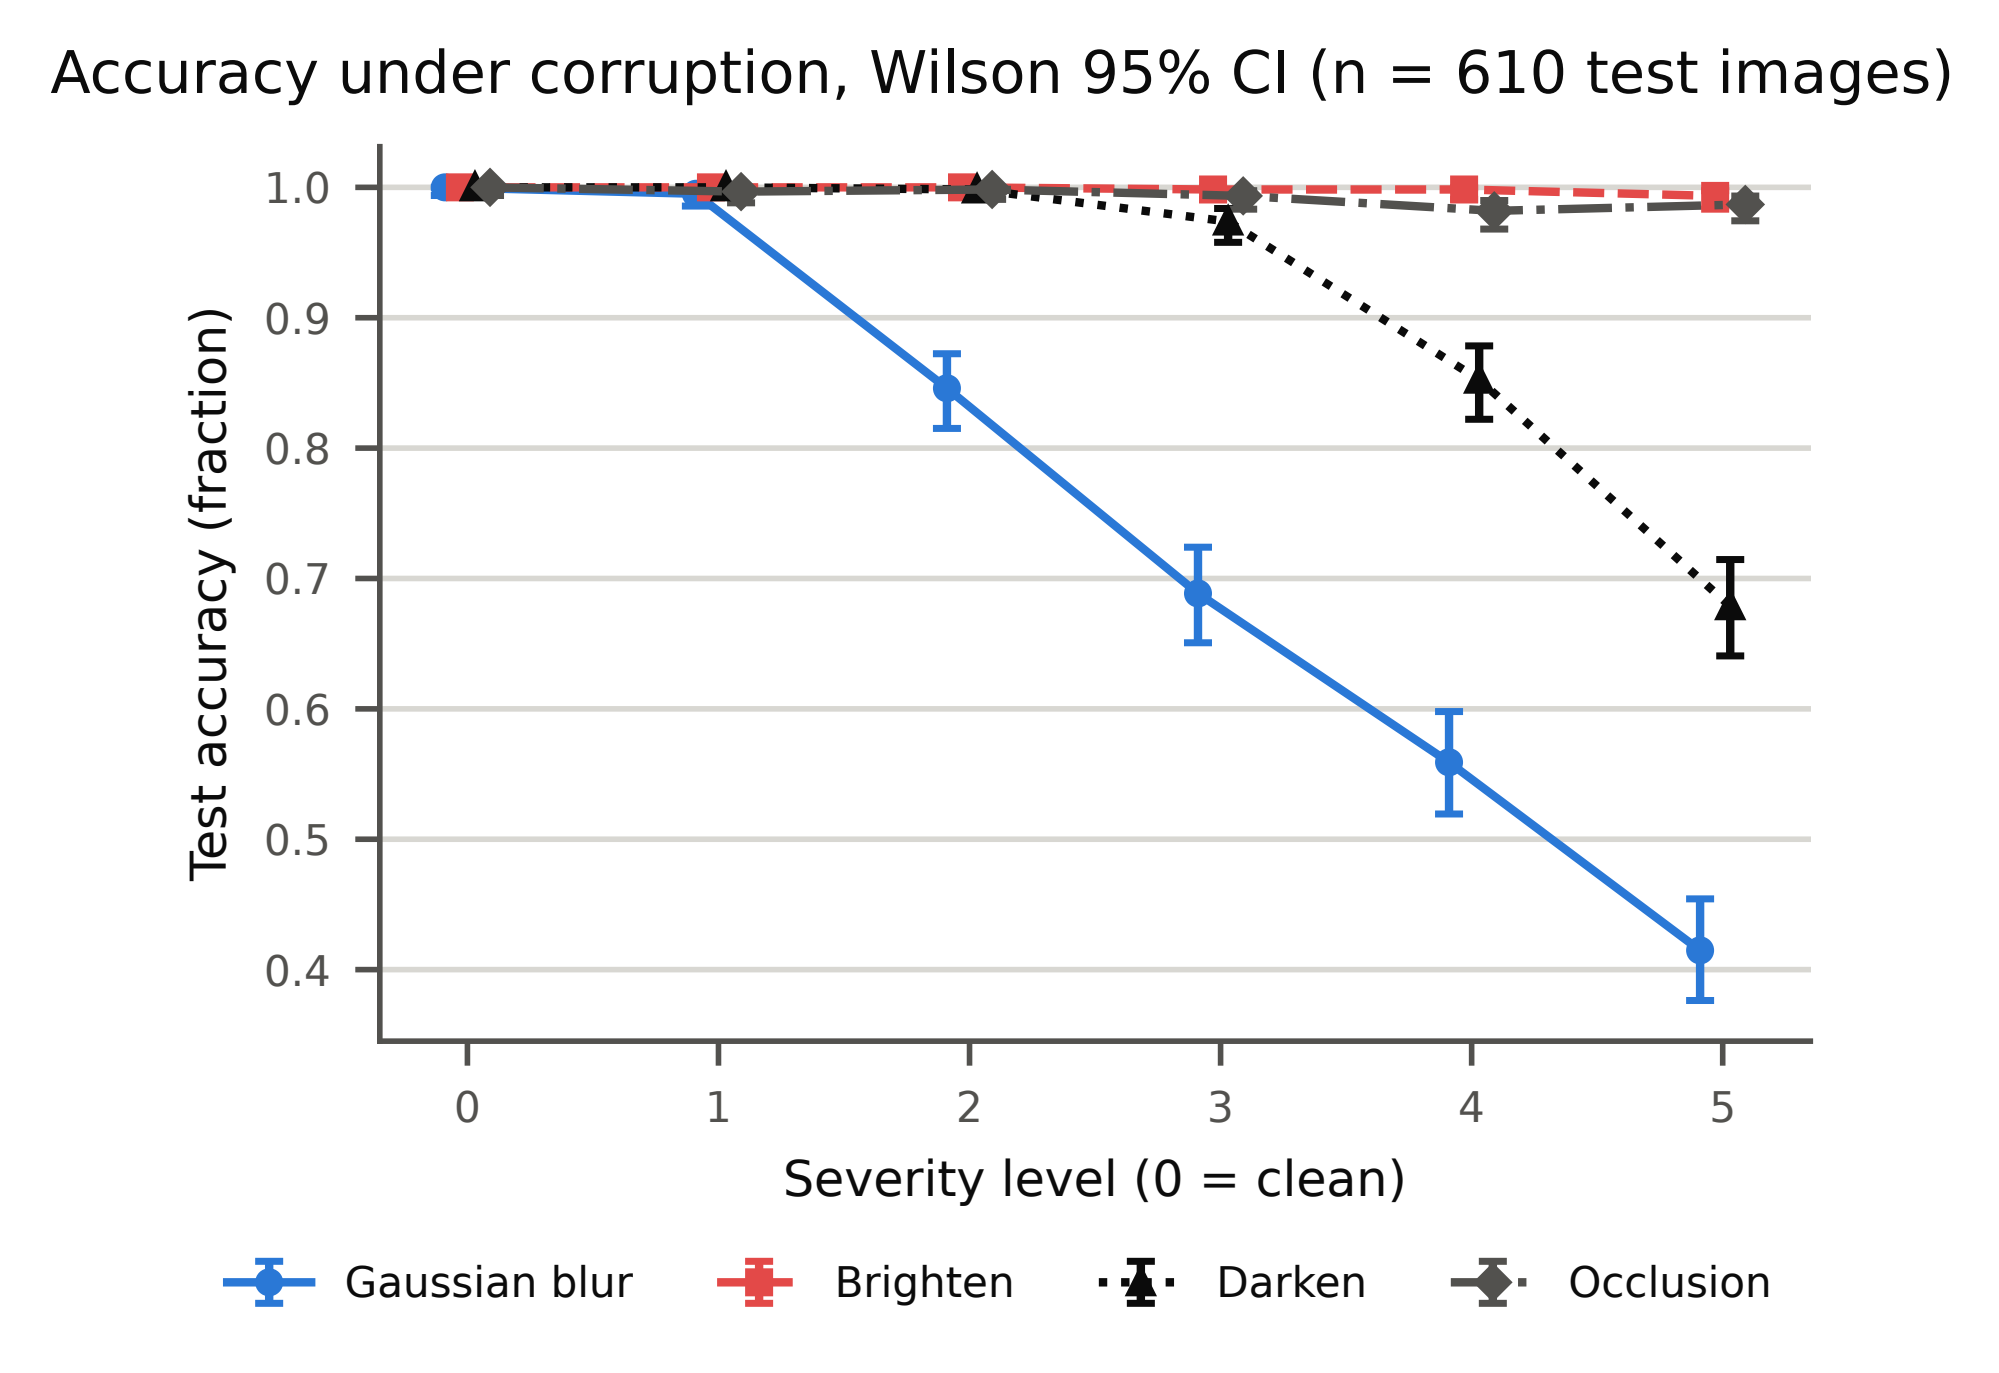
Accuracy under corruption, Wilson 95% CI (n = 610 test images)
Test accuracy (fraction)
1.0
0.9
0.8
0.7
0.6
0.5
0.4
0
1
2
3
4
5
Severity level (0 = clean)
Gaussian blur
Brighten
Darken
Occlusion