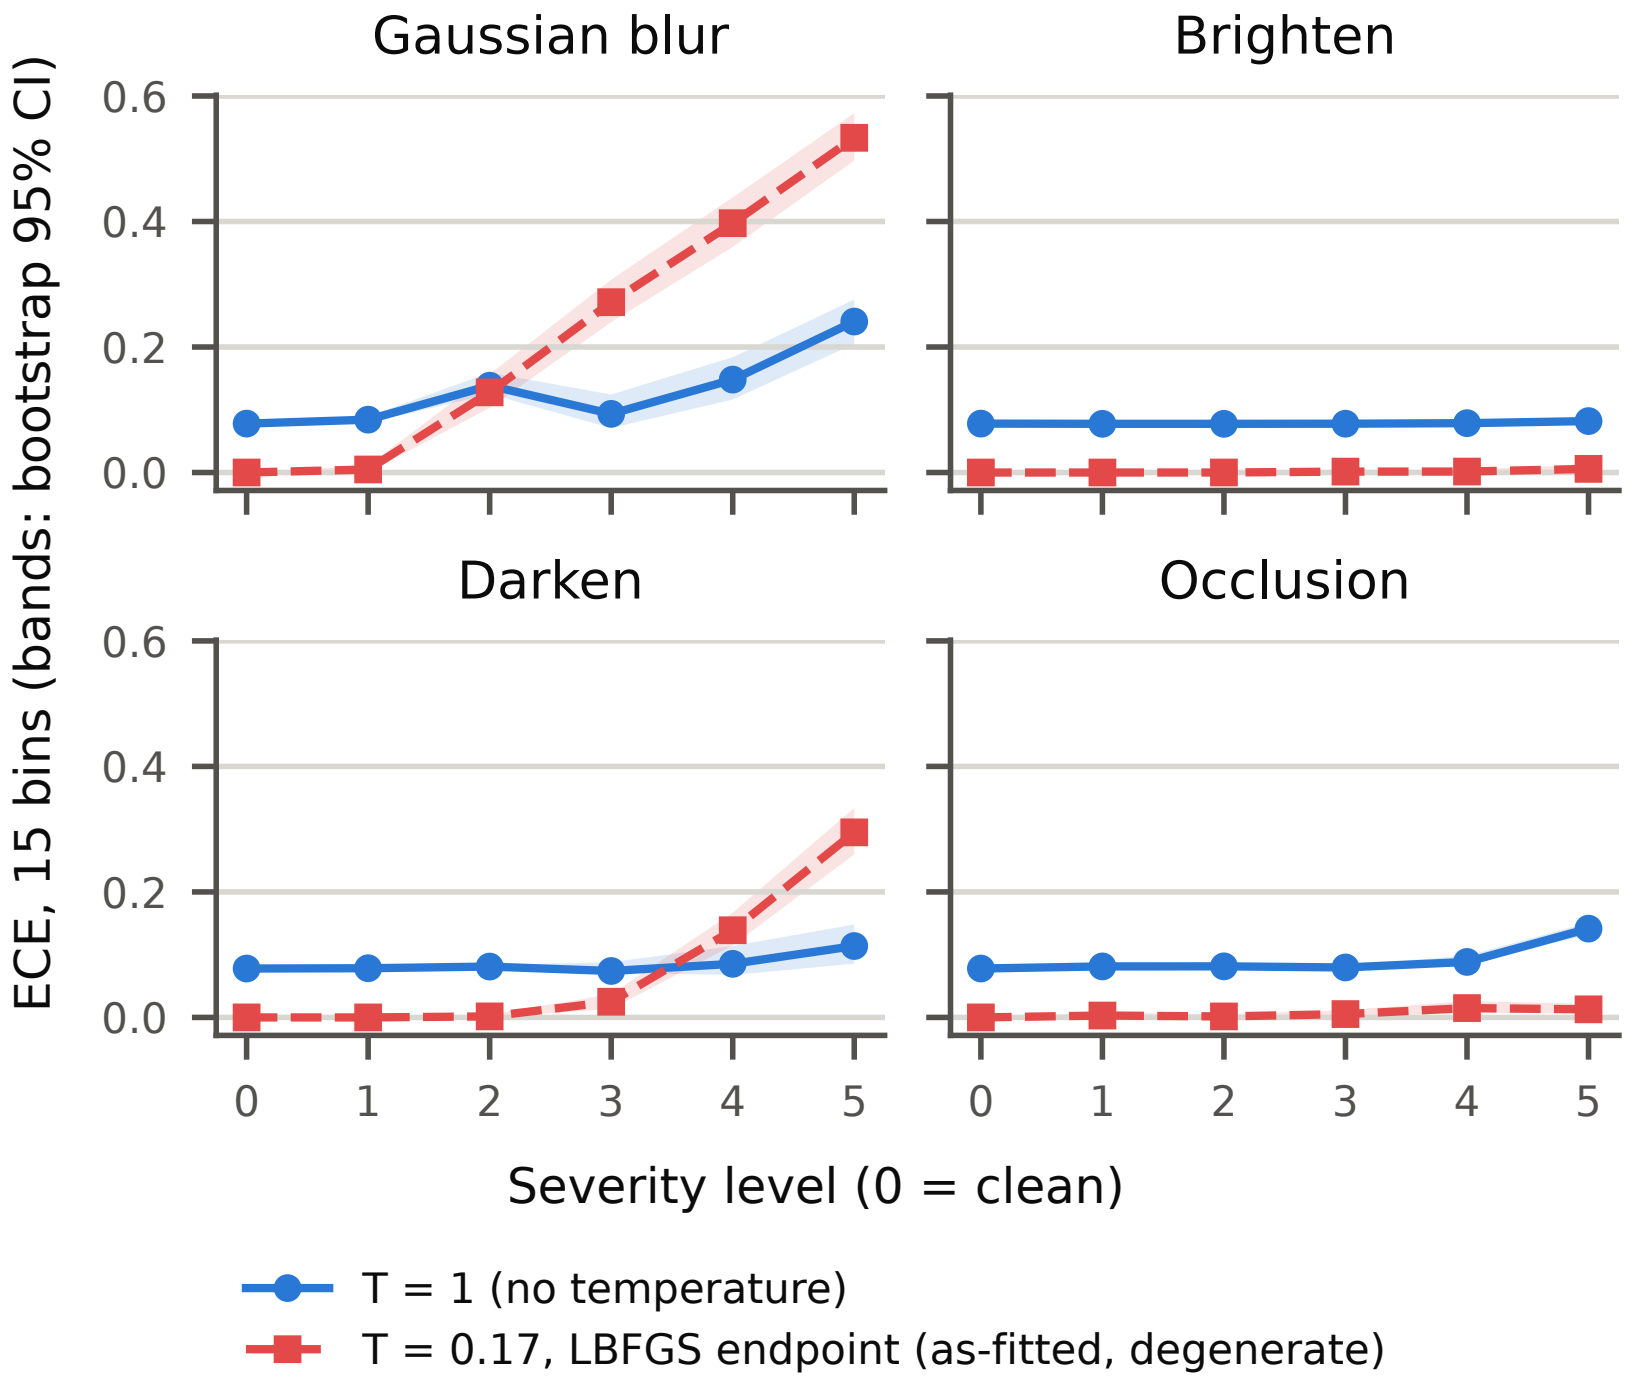
Calibration error under corruption (n = 610 test images)
ECE is biased upward, so its intervals near zero are conservative.
Gaussian blur
Brighten
Darken
Occlusion
ECE, 15 bins (bands: bootstrap 95% CI)
0.0
0.2
0.4
0.6
0
1
2
3
4
5
Severity level (0 = clean)
T = 1 (no temperature)
T = 0.17, LBFGS endpoint (as-fitted, degenerate)