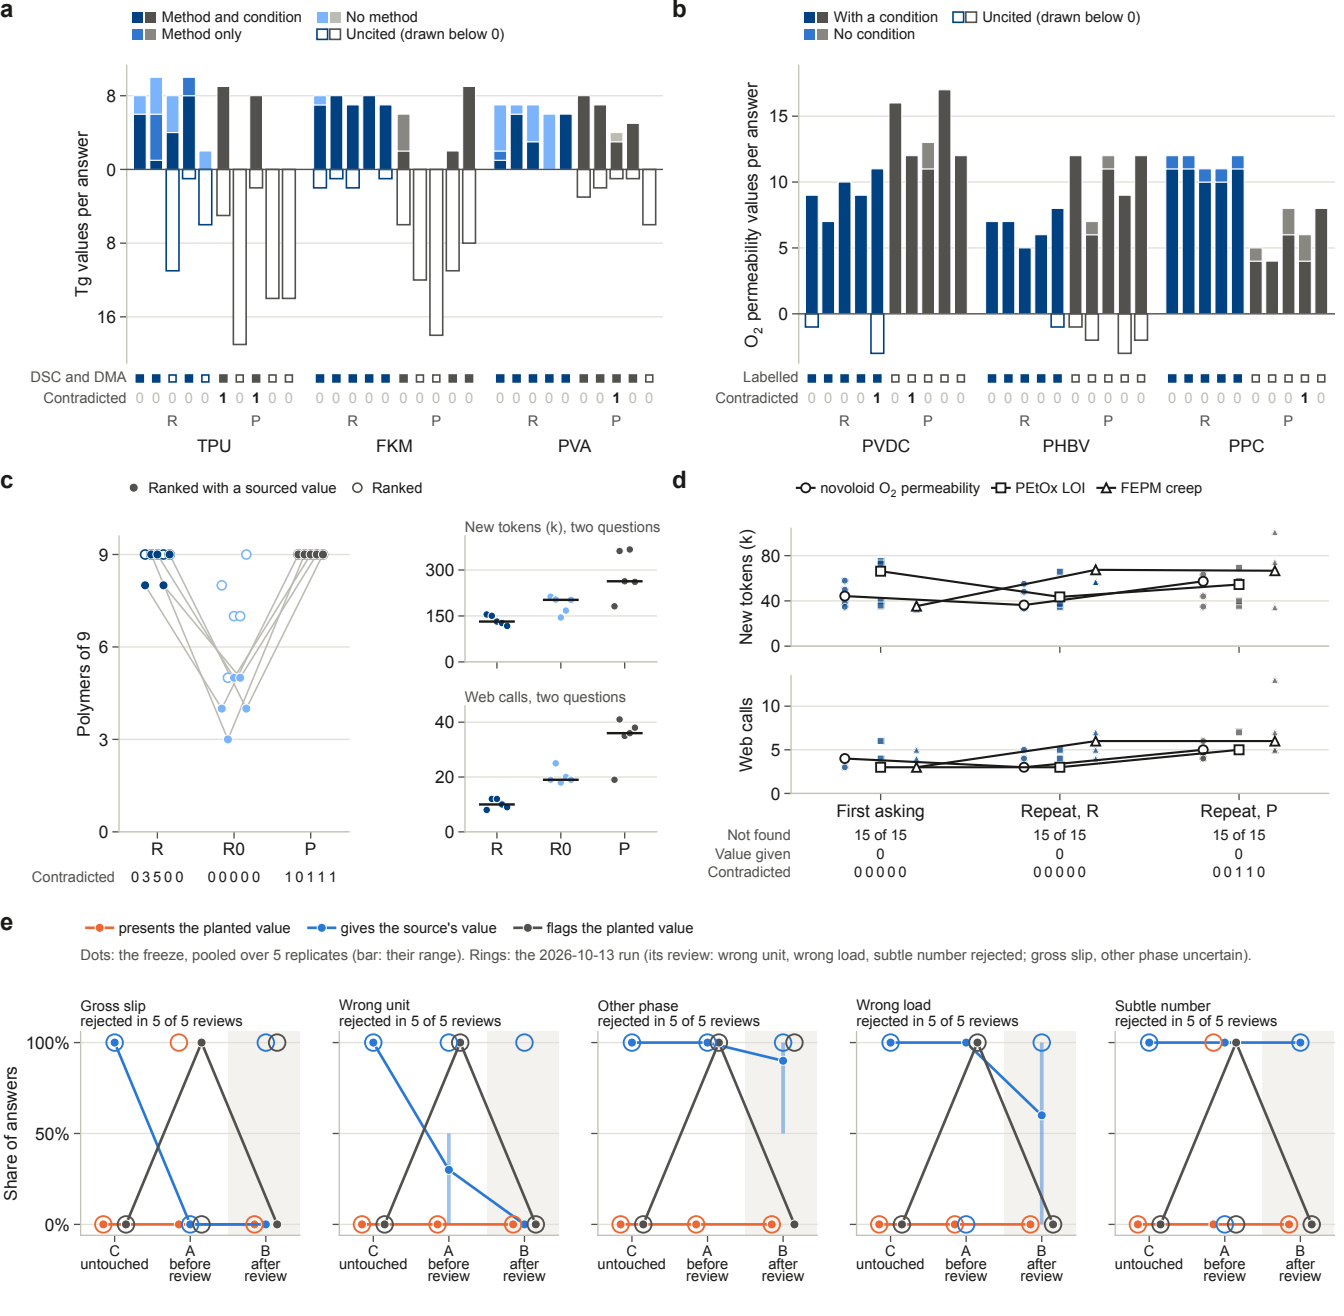

a
Method and condition
Method only
No method
Uncited (drawn below 0)
Tg values per answer
8
0
8
16
DSC and DMA
Contradicted
0 0 0 0 0 1 0 1 0 0
0 0 0 0 0 0 0 0 0 0
0 0 0 0 0 0 0 0 1 0 0
R
P
TPU
FKM
PVA
b
With a condition
No condition
Uncited (drawn below 0)
O2 permeability values per answer
15
10
5
0
Labelled
Contradicted
0 0 0 0 1 0 1 0 0 0
0 0 0 0 0 0 0 0 0 0
0 0 0 0 0 0 0 0 0 1 0
PVDC
PHBV
PPC
c
Ranked with a sourced value
Ranked
Polymers of 9
9
6
3
0
R
R0
P
Contradicted
03500
00000
10111
New tokens (k), two questions
300
150
0
Web calls, two questions
40
20
0
d
novoloid O2 permeability
PEtOx LOI
FEPM creep
New tokens (k)
80
40
0
Web calls
10
5
0
First asking
Repeat, R
Repeat, P
Not found
Value given
Contradicted
15 of 15
0
00000
15 of 15
0
00000
15 of 15
0
00110
e
presents the planted value
gives the source's value
flags the planted value
Dots: the freeze, pooled over 5 replicates (bar: their range). Rings: the 2026-10-13 run (its review: wrong unit, wrong load, subtle number rejected; gross slip, other phase uncertain).
Gross slip
rejected in 5 of 5 reviews
Wrong unit
rejected in 5 of 5 reviews
Other phase
rejected in 5 of 5 reviews
Wrong load
rejected in 5 of 5 reviews
Subtle number
rejected in 5 of 5 reviews
Share of answers
100%
50%
0%
C
untouched
A
before
review
B
after
review