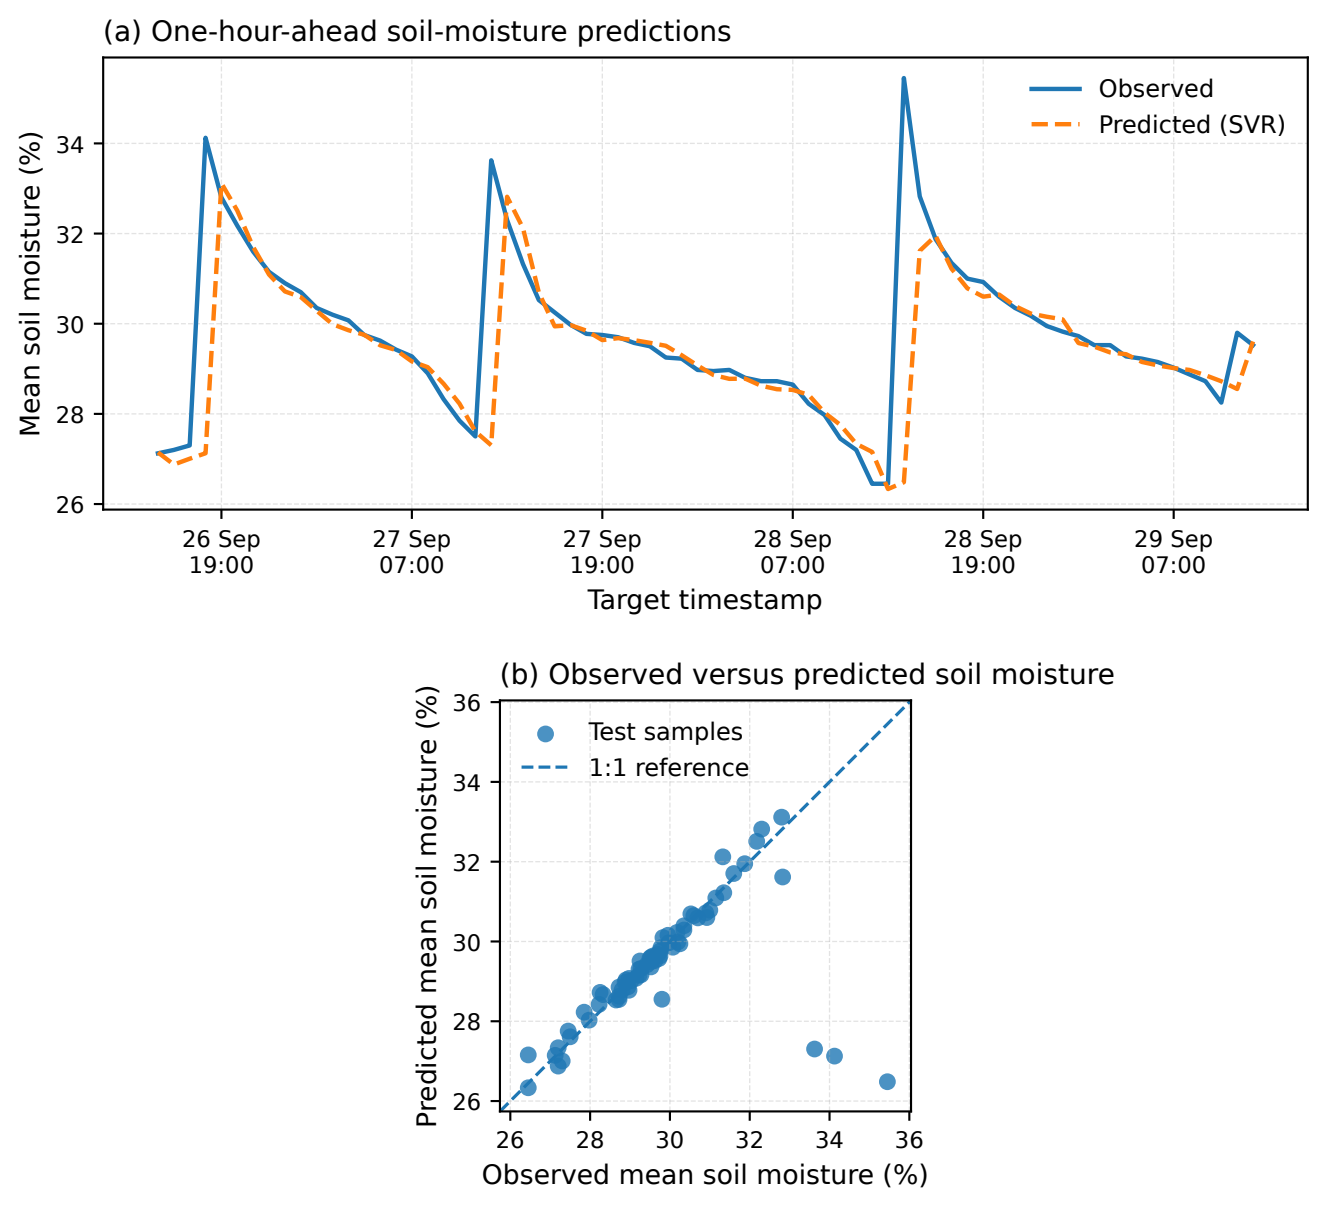
(a) One-hour-ahead soil-moisture predictions
Observed
Predicted (SVR)
Mean soil moisture (%)
34
32
30
28
26
26 Sep 19:00
27 Sep 07:00
27 Sep 19:00
28 Sep 07:00
28 Sep 19:00
29 Sep 07:00
Target timestamp
(b) Observed versus predicted soil moisture
Test samples
1:1 reference
Predicted mean soil moisture (%)
36
34
32
30
28
26
26
28
30
32
34
36
Observed mean soil moisture (%)