



Siemens
Industry
Online
Support

APPLICATION EXAMPLE

TIA Portal Add-In: SIMATIC SD Enabler

Enable the export as SIMATIC Source Documents in TIA Portal V20

SIEMENS

Legal information

Use of application examples

Application examples illustrate the solution of automation tasks through an interaction of several components in the form of text, graphics and/or software modules. The application examples are a free service by Siemens AG and/or a subsidiary of Siemens AG ("Siemens"). They are non-binding and make no claim to completeness or functionality regarding configuration and equipment. The application examples merely offer help with typical tasks; they do not constitute customer-specific solutions. **The application examples are not subject to standard tests and quality inspections of a chargeable product and may contain functional and performance defects or other faults and security vulnerabilities. You are responsible for the proper and safe operation of the products in accordance with all applicable regulations, including checking and customizing the application example for your system, and ensuring that only trained personnel use it in a way that prevents property damage or injury to persons. You are solely responsible for any productive use.**

Siemens grants you the non-exclusive, non-sublicensable and non-transferable right to have the application examples used by technically trained personnel. Any change to the application examples is your responsibility. Sharing the application examples with third parties or copying the application examples or excerpts thereof is permitted only in combination with your own products. Any further use of the application examples is explicitly not permitted and further rights are not granted. You are not allowed to use application examples in any other way, including, without limitation, for any direct or indirect training or enhancements of AI models.

Disclaimer of liability

Siemens shall not assume any liability, for any legal reason whatsoever, including, without limitation, liability for the usability, availability, completeness and freedom from defects of the application examples as well as for related information, configuration and performance data and any damage caused thereby. This shall not apply in cases of mandatory liability, for example under the German Product Liability Act, or in cases of intent, gross negligence, or culpable loss of life, bodily injury or damage to health, non-compliance with a guarantee, fraudulent non-disclosure of a defect, or culpable breach of material contractual obligations. Claims for damages arising from a breach of material contractual obligations shall however be limited to the foreseeable damage typical of the type of agreement, unless liability arises from intent or gross negligence or is based on loss of life, bodily injury or damage to health. The foregoing provisions do not imply any change in the burden of proof to your detriment. You shall indemnify Siemens against existing or future claims of third parties in this connection except where Siemens is mandatorily liable.

By using the application examples you acknowledge that Siemens cannot be held liable for any damage beyond the liability provisions described.

Other information

Siemens reserves the right to make changes to the application examples at any time without notice and to terminate your use of the application examples at any time. In case of discrepancies between the suggestions in the application examples and other Siemens publications such as catalogs, the content of the other documentation shall have precedence.

The Siemens terms of use (<https://www.siemens.com/global/en/general/terms-of-use>) shall also apply.

Cybersecurity information

Siemens provides products and solutions with industrial cybersecurity functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial cybersecurity concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial cybersecurity measures that may be implemented, please visit www.siemens.com/cybersecurity-industry.

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Cybersecurity RSS Feed under <https://www.siemens.com/cert>.

Table of contents

- 1. Introduction4**
 - 1.1. Overview 4
 - 1.2. Components used 4
- 2. Handling5**
 - 2.1. Activate and execute Add-In..... 5
 - 2.1.1. How to use..... 6
 - 2.2. CLI execution 7
 - 2.3. Handling of library type instances..... 7
 - 2.4. Open Manual 7
- 3. Troubleshooting and Report8**
 - 3.1. Report..... 8
 - 3.2. Logging 8
- 4. Appendix9**
 - 4.1. Service and support 9
 - 4.2. Links and literature 10
 - 4.3. Change documentation 10

1. Introduction

The new text based format SIMATIC Source Documents (SIMATIC SD) has been introduced in TIA Portal V20. With the new Update 4, the supported elements and languages are extended.

The following application enables TIA Portal projects that are already modified with TIA Portal V20, but prior to Update 4, to make use of these new benefits.

If an older TIA Portal Project is directly upgraded to TIA Portal V20 Update 4, the migration process takes care of the enablement and this application is not necessary. Elements that are added to the TIA Portal project after the Update are also not required to be processed by this application.

1.1. Overview

The SIMATIC SD Enabler is provided as TIA Portal Add-In for manual execution or CLI application for automated mass operation.

1.2. Components used

This application example requires the following software components

Component	Version
TIA Portal	V20 Update 4 or higher

2. Handling


2.1. Activate and execute Add-In

To use the provided TIA Portal Add-In inside your TIA Portal installation, it is necessary to copy it to the AddIn folder of your installation first.

If the default path was used for the TIA Portal installation it can be found here:

`C:\Program Files\Siemens\Automation\Portal V20\AddIns`

Second step is to activate the Add-In. This has to be done in your TIA Portal installation and can be found here:

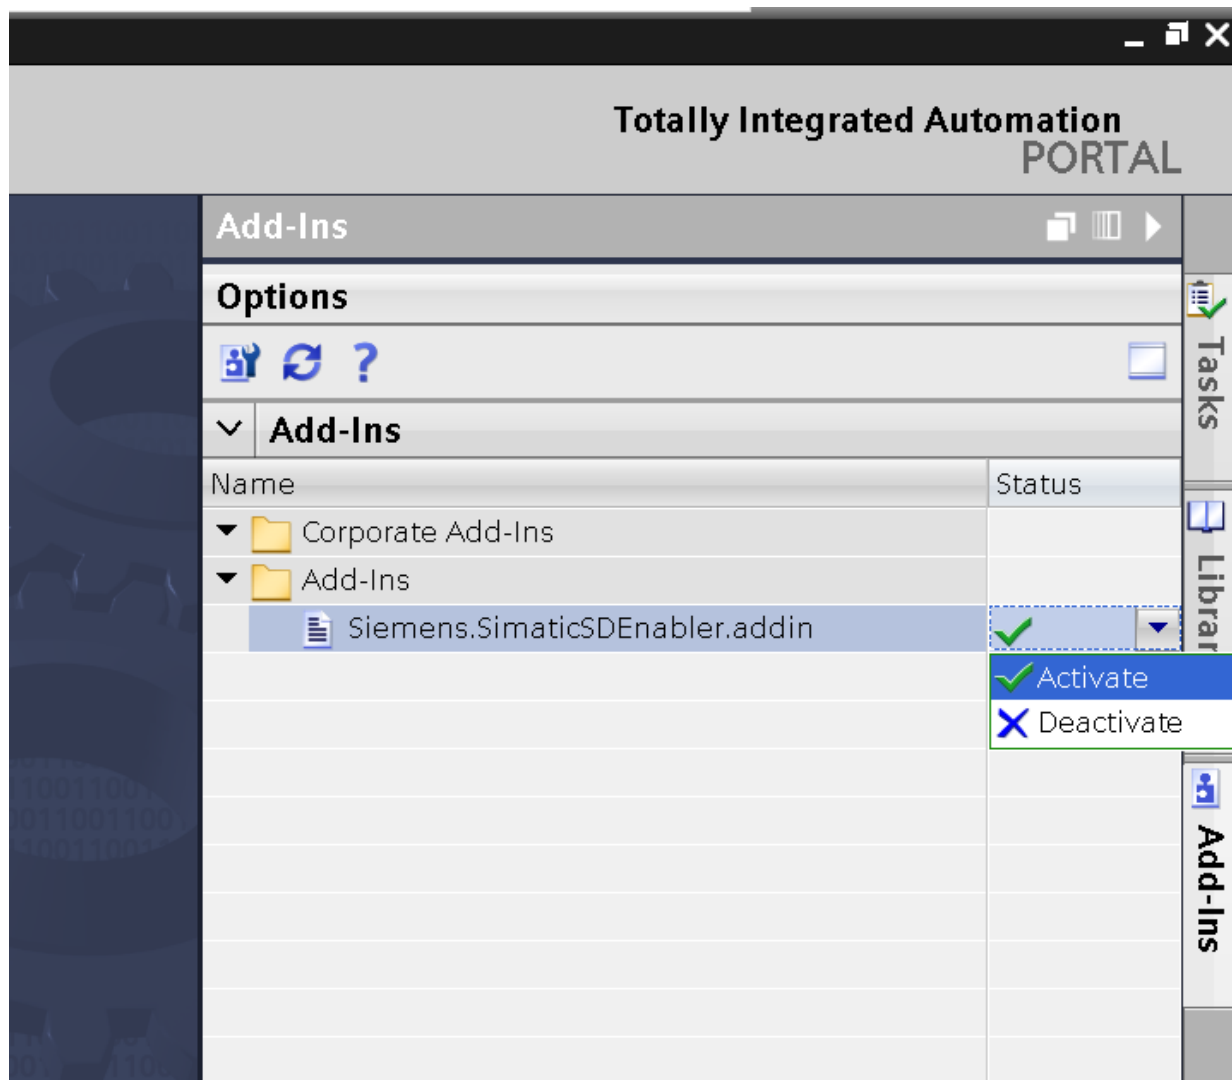


2.1.1. How to use

The TIA Portal Add-In can be started from the context menu on the following elements:

- TIA Portal Project in project navigation
- Devices
- Device group
- Program blocks
- Program block group
- PLC data types
- PLC data type group
- Software units

If the SIMATIC SD Add-In is started on a project, device, software unit or group, every item inside is processed.

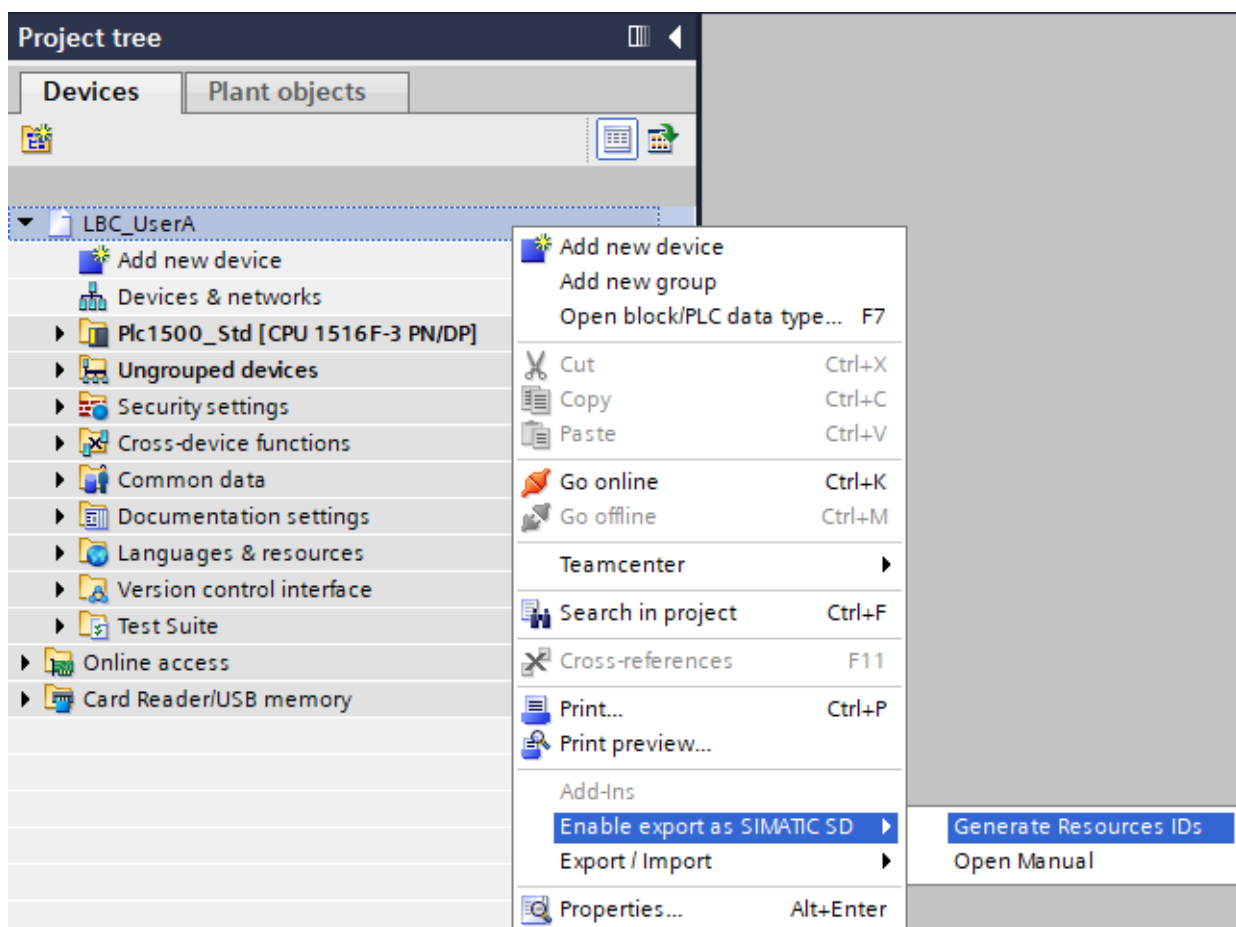

2.2. CLI execution

The SIMATIC SD Enabler comes with a standalone application. This application can be run from a cli to run the tool across multiple TIA Portal project as a mass operation. This operation will always process all elements inside a tia project.

The following two arguments can be passed:

Short	Mandatory	Details
-p	Yes	Path to TIA Portal project file. The file can either be a local project (ends with .ap20) or a local session of a multiuser project (ends with .als20)

2.3. Handling of library type instances

When instances of typed elements in the project navigation are processed, only the processed instances are enabled to use SIMATIC SD. To apply the changes to the type, switch the type to in test and release again to create a new version.

2.4. Open Manual

This manual can be opened anytime directly from the TIA Portal Add-In, to get information when needed. In the context menu select the entry "Open Manual".

3. Troubleshooting and Report

After execution of the TIA Portal Add-In a summary window appears to make the result of the execution visible. Independent if the Add-In or the CLI variant is used, a report and log file are created during every execution.

3.1. Report

A report file **SimaticSDEnabler.csv** is created in the "UserFiles"-Folder of your TIA Portal project in csv format. This file clearly lists the processed elements and if the element could be enabled for SimaticSD usage or not.

3.2. Logging

A detailed log file for troubleshooting purposes is created here:

`%AppData%\Siemens\SimaticSDEnabler\<ApplicationVersion>\`

In case support for the application is requested, please provide those files for investigation purposes.

4. Appendix

4.1. Service and support

SiePortal

The integrated platform for product selection, purchasing and support - and connection of Industry Mall and Online support. The SiePortal home page replaces the previous home pages of the Industry Mall and the Online Support Portal (SIOS) and combines them.

- **Products & Services**
In Products & Services, you can find all our offerings as previously available in Mall Catalog.
- **Support**
In Support, you can find all information helpful for resolving technical issues with our products.
- **mySieportal**
mySiePortal collects all your personal data and processes, from your account to current orders, service requests and more. You can only see the full range of functions here after you have logged in.

You can access SiePortal via this address: sieportal.siemens.com

Technical Support

The Technical Support of Siemens Industry provides you fast and competent support regarding all technical queries with numerous tailor-made offers – ranging from basic support to individual support contracts.

Please send queries to Technical Support via Web form: support.industry.siemens.com/cs/my/src

SITRAIN – Digital Industry Academy

We support you with our globally available training courses for industry with practical experience, innovative learning methods and a concept that's tailored to the customer's specific needs.

For more information on our offered trainings and courses, as well as their locations and dates, refer to our web page: siemens.com/sitrain

Industry Online Support app

You will receive optimum support wherever you are with the "Siemens Industry Online Support" app. The app is available for iOS and Android:



4.2. Links and literature

Table 5-1

No.	Topic
\1	SiePortal https://sieportal.siemens.com/
\2	SIMATIC SD https://support.industry.siemens.com/cs/ww/en/view/109994073
\3	Continuous Integration in TIA Portal https://support.industry.siemens.com/cs/ww/de/view/109801203

4.3. Change documentation

Table 5-2

Version	Date	Modifications
V1.1.0	02/2026	Remove execution on project library
V1.0.1	12/2025	- Ignore protected library types during execution - The TIA Portal Openness Pilot Container is no longer used for the "Enabler" function - Added check of the TIA Portal project for this Pilot Container
V1.0.0	09/2025	First version