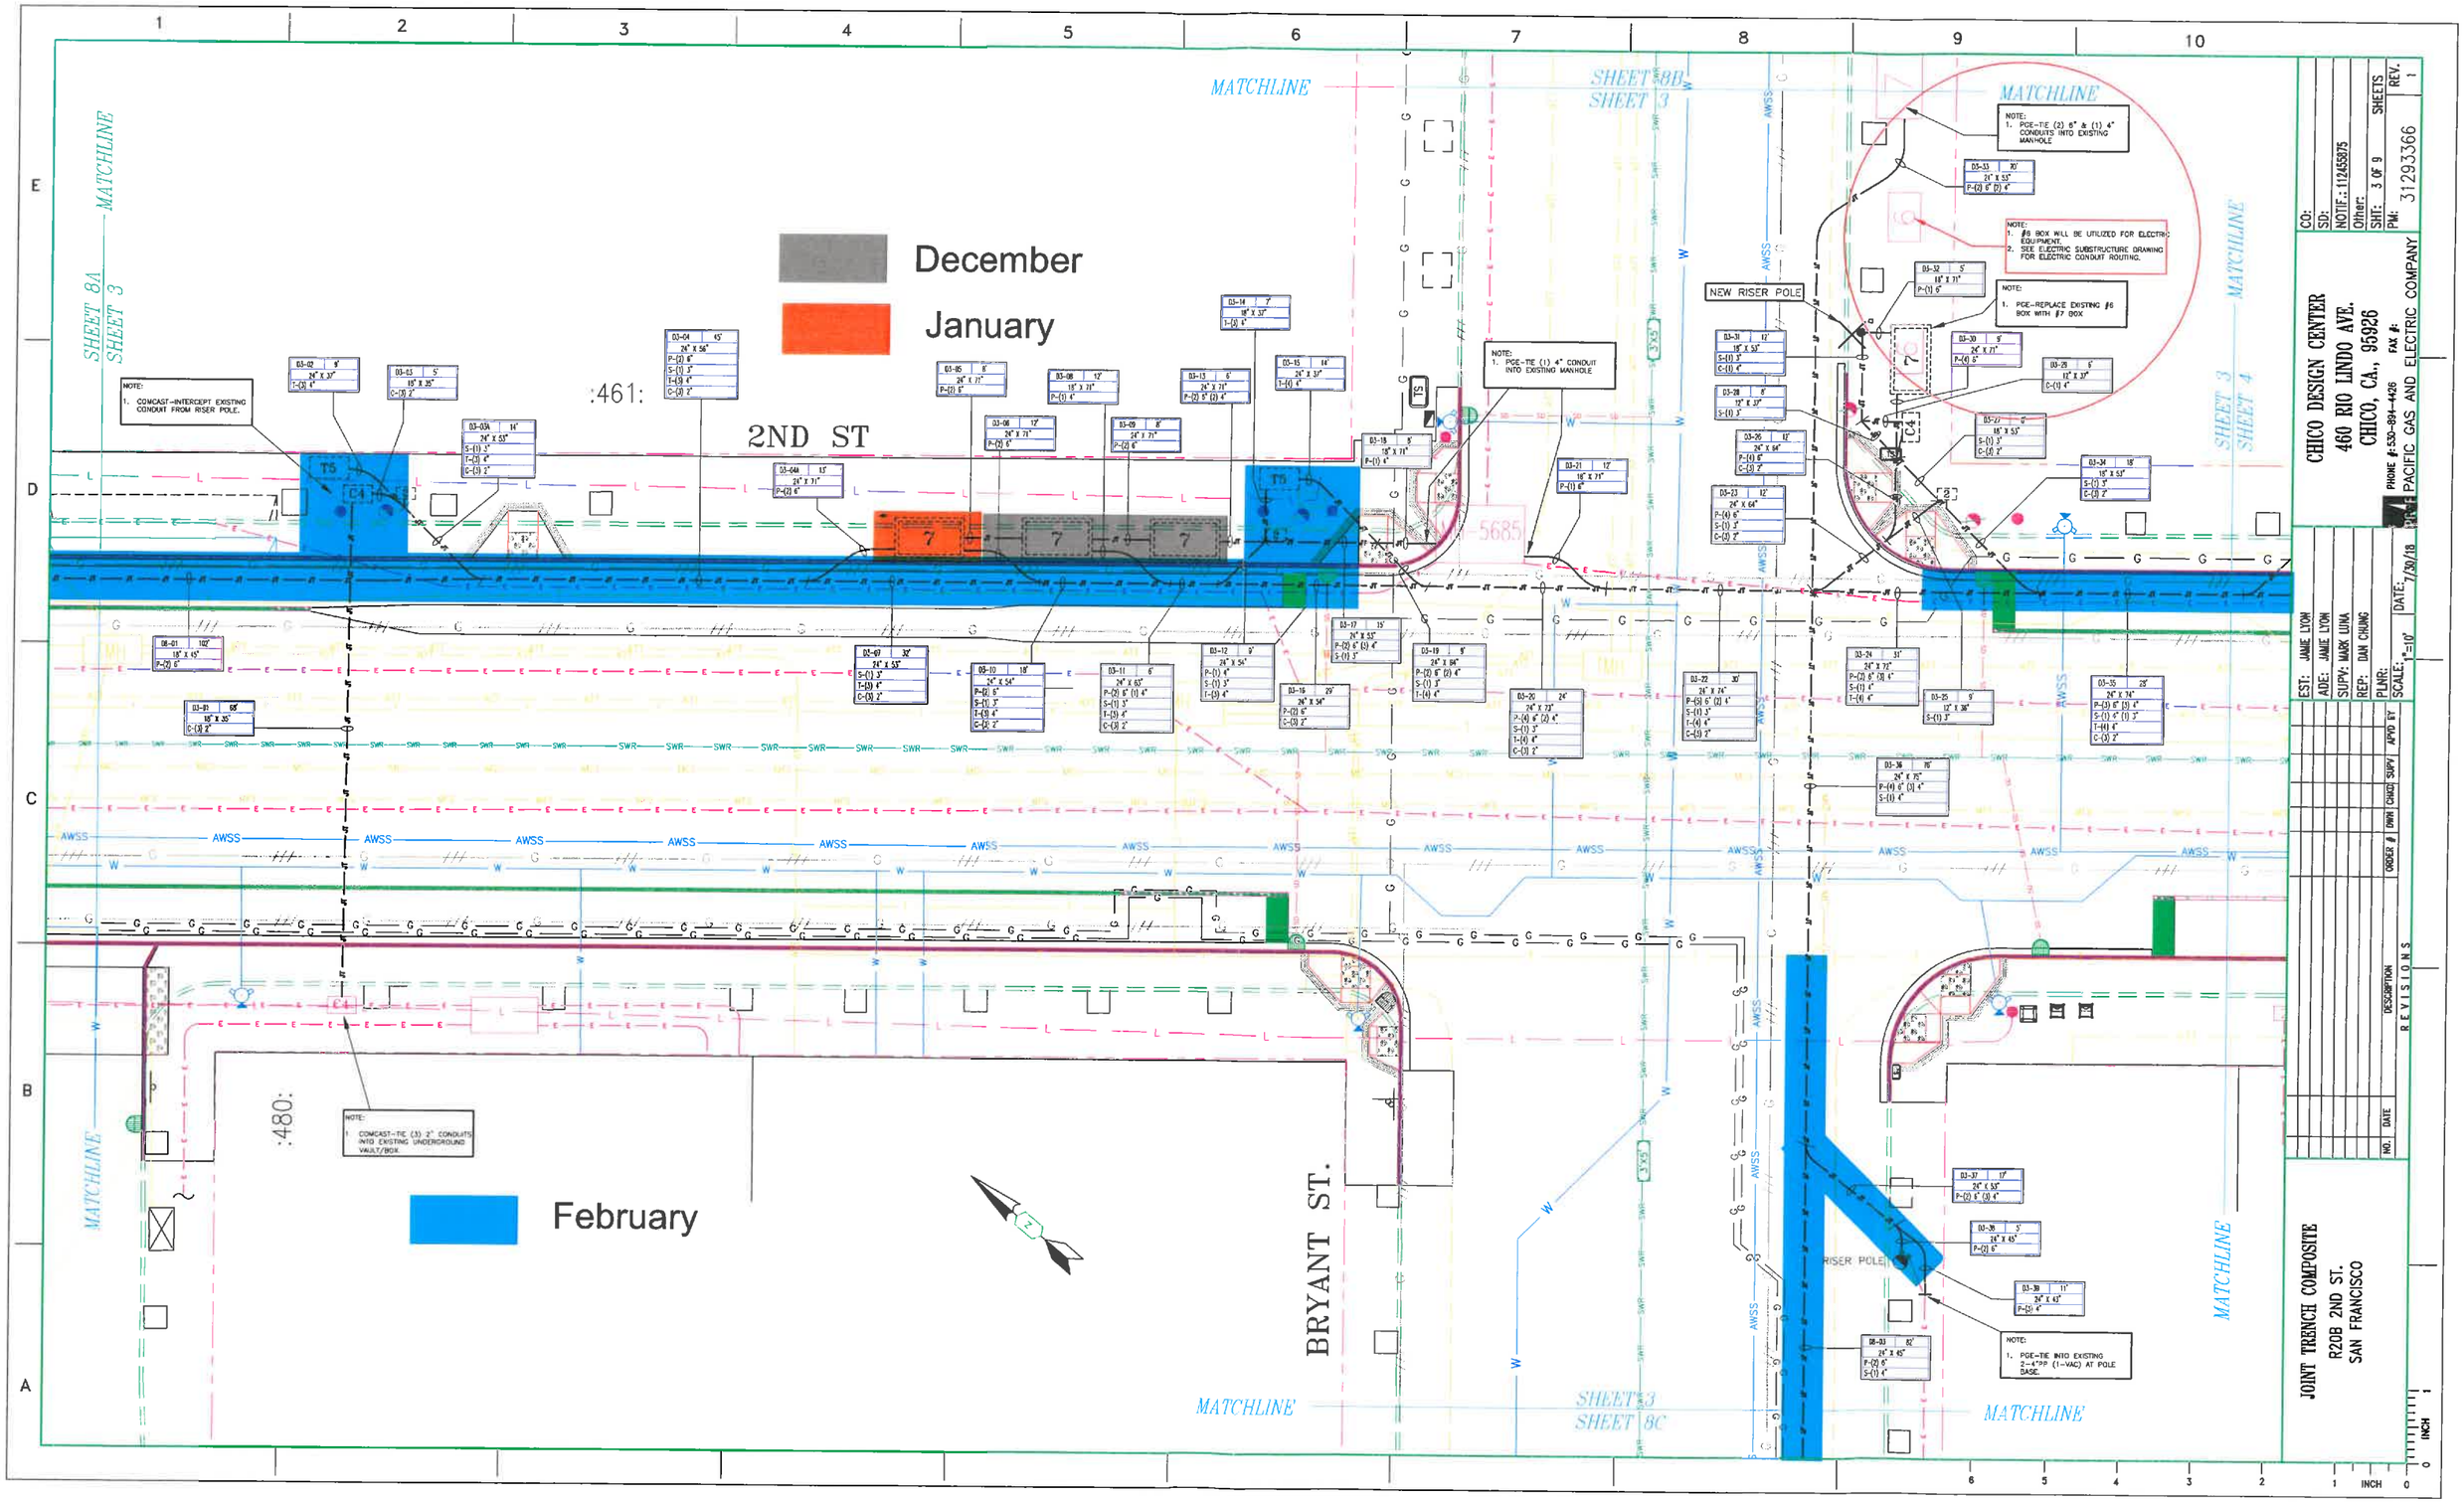
December
January
February
2ND ST
BRYANT ST.
MATCHLINE
SHEET 8A
SHEET 3
SHEET 8B
SHEET 8C
SHEET 4
NEW RISER POLE
RISER POLE
NOTE:
1. COMCAST-INTERCEPT EXISTING CONDUIT FROM RISER POLE.
NOTE:
1. PGE-TIE (1) 4" CONDUIT INTO EXISTING MANHOLE
NOTE:
1. PGE-TIE (2) 6" & (1) 4" CONDUITS INTO EXISTING MANHOLE
NOTE:
1. #8 BOX WILL BE UTILIZED FOR ELECTRIC EQUIPMENT.
2. SEE ELECTRIC SUBSTRUCTURE DRAWING FOR ELECTRIC CONDUIT ROUTING.
NOTE:
1. PGE-REPLACE EXISTING #6 BOX WITH #7 BOX
NOTE:
1. COMCAST-TIE (3) 2" CONDUITS INTO EXISTING UNDERGROUND VAULT/BOX
NOTE:
1. PGE-TIE INTO EXISTING 2-4"PP (1-VAC) AT POLE BASE.
CHICO DESIGN CENTER
460 RIO LINDO AVE.
CHICO, CA., 95926
PHONE #: 530-894-4426
FAX #:
PACIFIC GAS AND ELECTRIC COMPANY
JOINT TRENCH COMPOSITE
R20B 2ND ST.
SAN FRANCISCO
CO:
SD:
NOTIF.: 11245875
Other:
SHT: 3 OF 9
SHEETS
PM: 31293366
REV. 1
EST: JAMIE LYON
ADE: JAMIE LYON
SUPV: MARK LUNA
REP: DAN CHUNG
PLAN:
SCALE: 1"=10'
DATE: 7/30/18
REVISIONS
NO. DATE DESCRIPTION ORDER # DWN CHKD SUPV APVD BY