


(A) PLAN VIEW OF 2" SERVICE TAP
N.T.S.

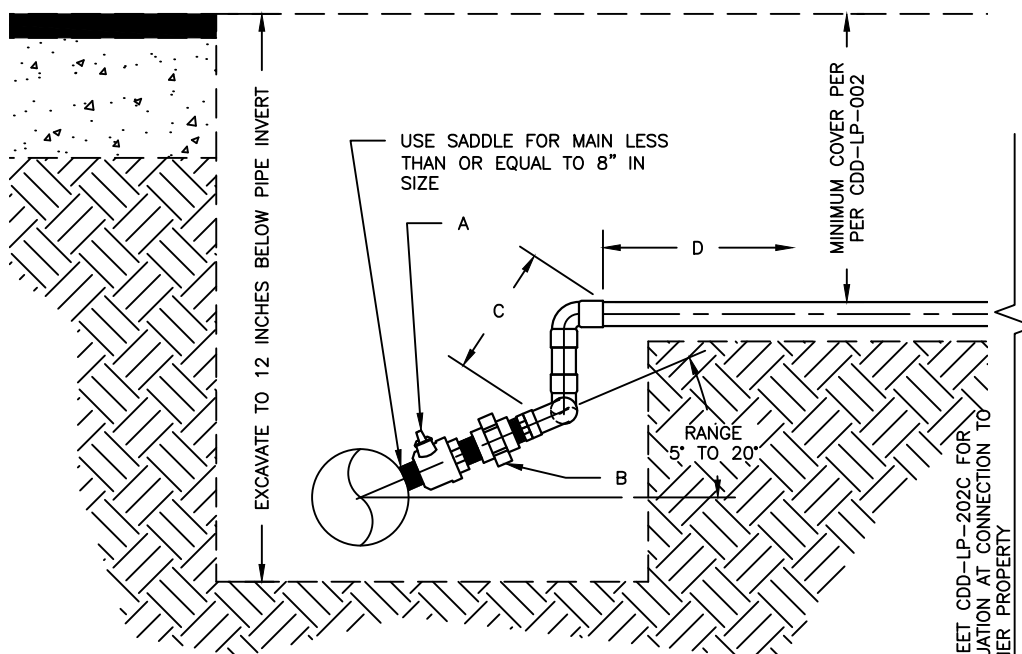

(B) SECTIONAL VIEW OF 2" SERVICE TAP
N.T.S.

NOTES:

1. ALL PLUMBING WORK ON "HOT" OR "ACTIVE" WATER LINES SHALL BE PERFORMED BY CDD CREWS. CONTRACTORS ARE NOT PERMITTED TO PERFORM PLUMBING WORK OR OPERATE VALVES ON POTABLE WATER LINES OWNED AND OPERATED BY CDD.
2. SITE CONDITIONS MAY NECESSITATE LARGER EXCAVATION DIMENSIONS FOR TAPPING AS DETERMINED BY CDD FOREMAN. CDD FOREMAN RESERVES THE RIGHT TO REQUEST A LARGER EXCAVATION AS REQUIRED TO COMPLETE WORK.
3. EXCAVATION SHALL BE TO A DEPTH 1-FOOT BELOW THE INVERT OF THE WATER MAIN. THE WATER MAIN SHALL BE SUPPORTED WITH WOOD BLOCKING UNTIL BACKFILL AND AS REQUIRED IN CDD STANDARD SPECIFICATION 01 41 28.
4. WATER SERVICES SHALL ONLY BE CONNECTED INTO A "DISTRIBUTION" WATER MAIN. WATER SERVICES SHALL NOT BE CONNECTED INTO A "TRANSMISSION," "FEEDER," OR "DEDICATED" WATER MAIN WITHOUT PRIOR CONSENT OF CDD.
5. WATER SERVICES SHALL ONLY BE TAPPED INTO DOMESTIC OR RECYCLED WATER MAINS. WATER SERVICES (INCLUDING FIRE SERVICES) MAY NOT BE CONNECTED INTO AUXILIARY WATER SUPPLY SYSTEM MAINS.
6. ALL MATERIALS INSTALLED SHALL BE COMPLIANT WITH CDD STANDARD SPECIFICATION SECTION 33 10 00 "WATER UTILITY DISTRIBUTION PIPING MATERIALS" FOR NEW SERVICE INSTALLATIONS ON EXISTING WATER MAINS, SADDLE SHALL BE USED FOR TAP REGARDLESS OF MAIN SIZE OR SERVICE SIZE.
- 7.

SEE SHEET CDD-LP-202C FOR CONTINUATION AT CONNECTION TO CUSTOMER PROPERTY

SEE SHEET CDD-LP-202C FOR CONTINUATION AT CONNECTION TO CUSTOMER PROPERTY

SUPERSEDES A-1240-2B



San Francisco
**Water
Power
Sewer**

Services of the San Francisco Public Utilities Commission

WATER ENTERPRISE - CITY DISTRIBUTION DIVISION STANDARD PLANS

**WATER SERVICES
2-INCH SERVICE LATERAL CONNECTION AT
MAIN**

DATE	10/1/2016	REV.	DRAWING NO.	SHEET
SCALE	N.T.S.	0	CDD-LP-202B	51