


MATERIAL: STEEL 18/8  
 BASE: GAUGE 9 STEEL  
 CONCRETE ANCHOR BOLT: 3/4" STEEL  
 WIRE MESH SCREEN: 3/8" STAINLESS  
 STEEL (INSTALLED INSIDE THE BODY)  
 PAINT: EPOXY WHITE

INSTRUCTIONS TO MACHINIST:  
 -CUT PIPE TO PROPER HEIGHT  
 -ADD SCREEN TO TOP OF PIPE  
 -ADD BRACKETS TO PIPE  
 -ADD BASE TO PIPE  
 -ADD HOLES AND MESH TO  
 BOTTOM OF PIPE

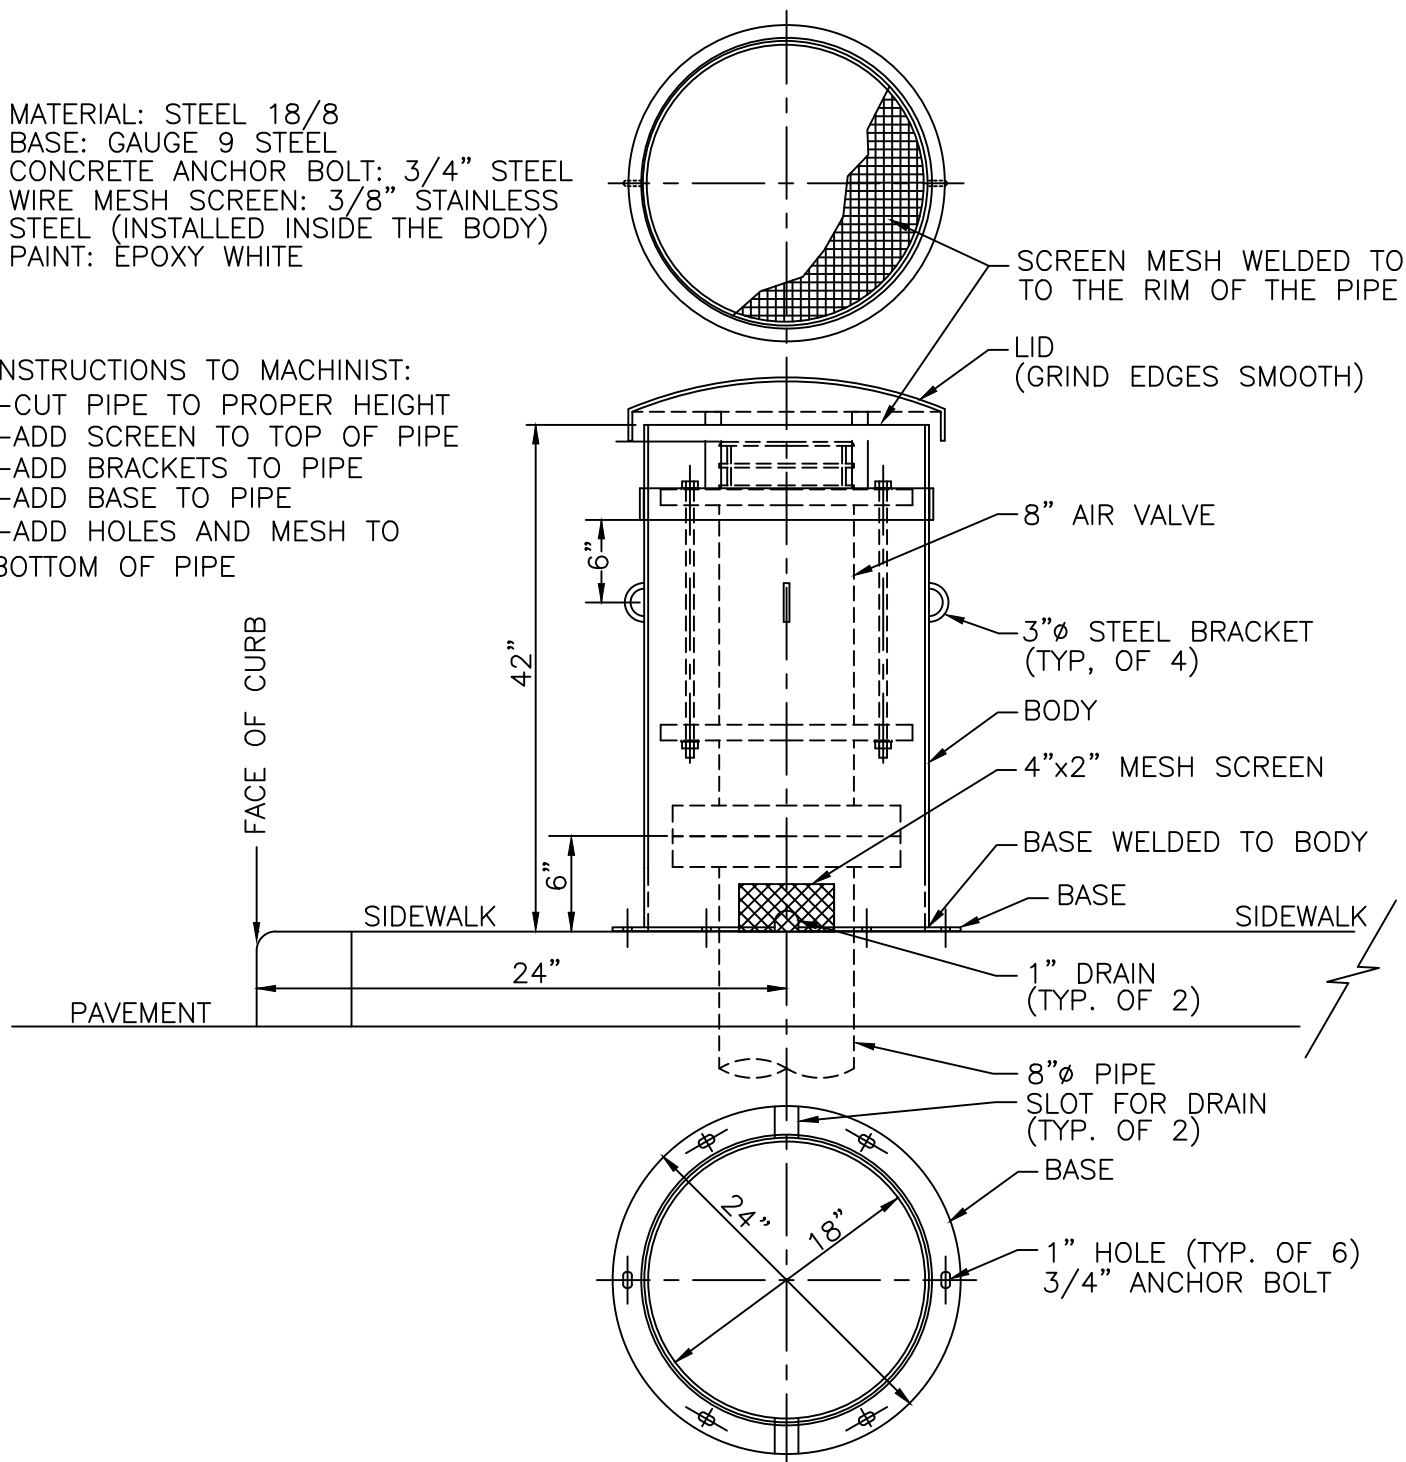

San Francisco  
**Water  
 Power  
 Sewer**

Services of the San Francisco Public Utilities Commission

WATER ENTERPRISE - CITY DISTRIBUTION DIVISION STANDARD PLANS

VALVE BOXES & COVERS  
 AIR VALVE ENCLOSURE MODIFIED FOR 8-IN AIR  
 VALVE

DATE 10/1/2016

REV.

DRAWING NO.

SHEET

SCALE N.T.S.

0

CDD-LP-256

91