



NOTE: ALL MATERIAL SHALL BE ASSEMBLED AND INSTALLED BY THE CONTRACTOR UNLESS OTHERWISE NOTED ON PROJECT PLANS.

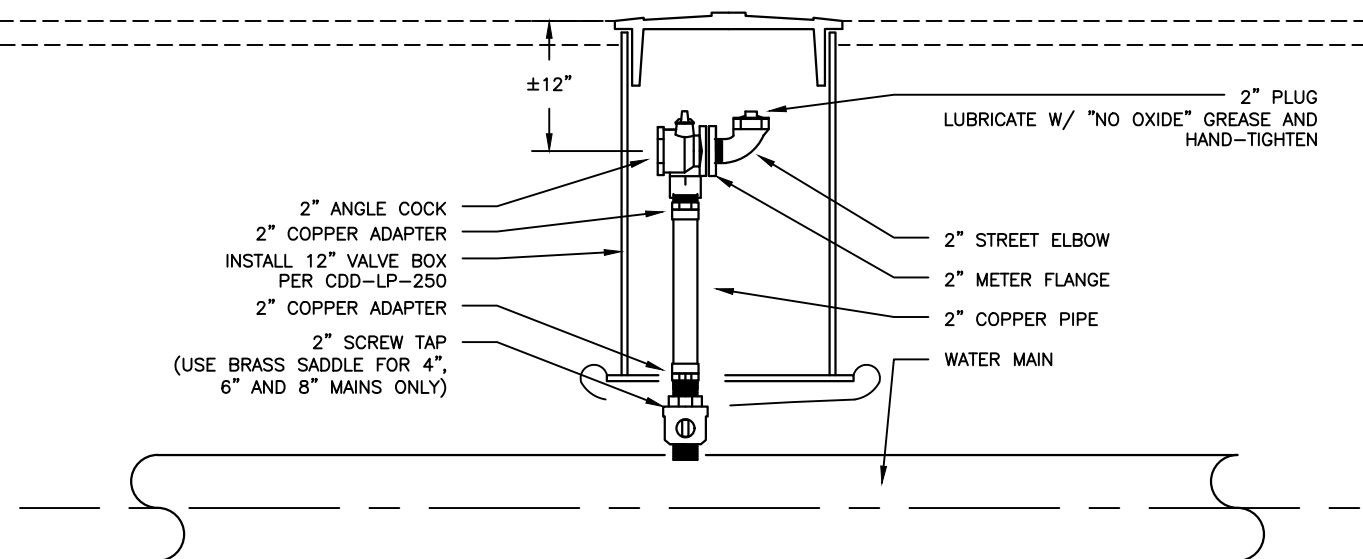

A 2" AIR VALVE OR BLOW OFF  
- N.T.S.

NOTE: ALL MATERIAL SHALL BE ASSEMBLED AND INSTALLED BY THE CONTRACTOR UNLESS OTHERWISE NOTED ON PROJECT PLANS.

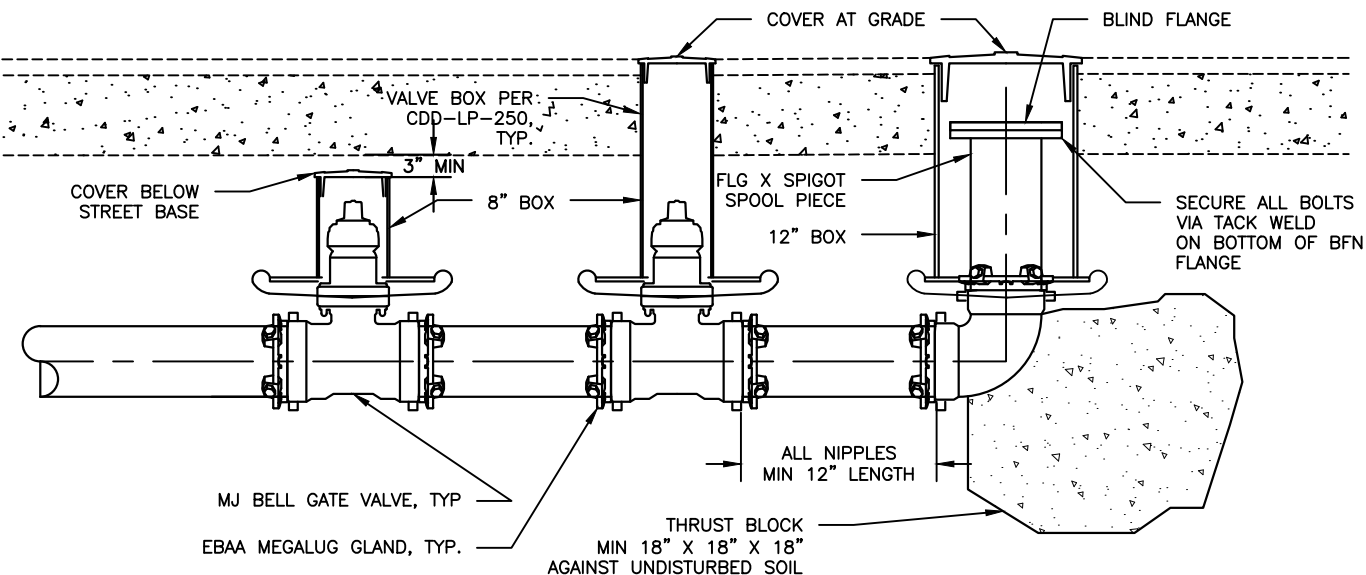

B 4", 6" OR 8" BLOW OFF  
- N.T.S.

SUPERSEDES E-4969R



San Francisco  
**Water  
Power  
Sewer**

Services of the San Francisco Public Utilities Commission

WATER ENTERPRISE - CITY DISTRIBUTION DIVISION STANDARD PLANS

# STANDARD PLAN FOR DUCTILE IRON PIPE MAIN INSTALLATION AIR VALVES AND BLOW OFFS

DATE 5/16/2017

REV.

DRAWING NO.

SHEET

SCALE N.T.S.

1

CDD-LP-003

4