


MATERIAL: STEEL 18/8
 BASE: GAUGE 9 STEEL
 CONCRETE ANCHOR BOLT: 3/4" STEEL
 WIRE MESH SCREEN: 3/8" STAINLESS
 STEEL (INSTALLED INSIDE THE BODY)
 PAINT: EPOXY WHITE

INSTRUCTIONS TO MACHINIST:

- CUT PIPE TO PROPER HEIGHT
- ADD SCREEN TO TOP OF PIPE
- ADD BRACKETS TO PIPE
- ADD BASE TO PIPE
- ADD HOLES AND MESH TO BOTTOM OF PIPE

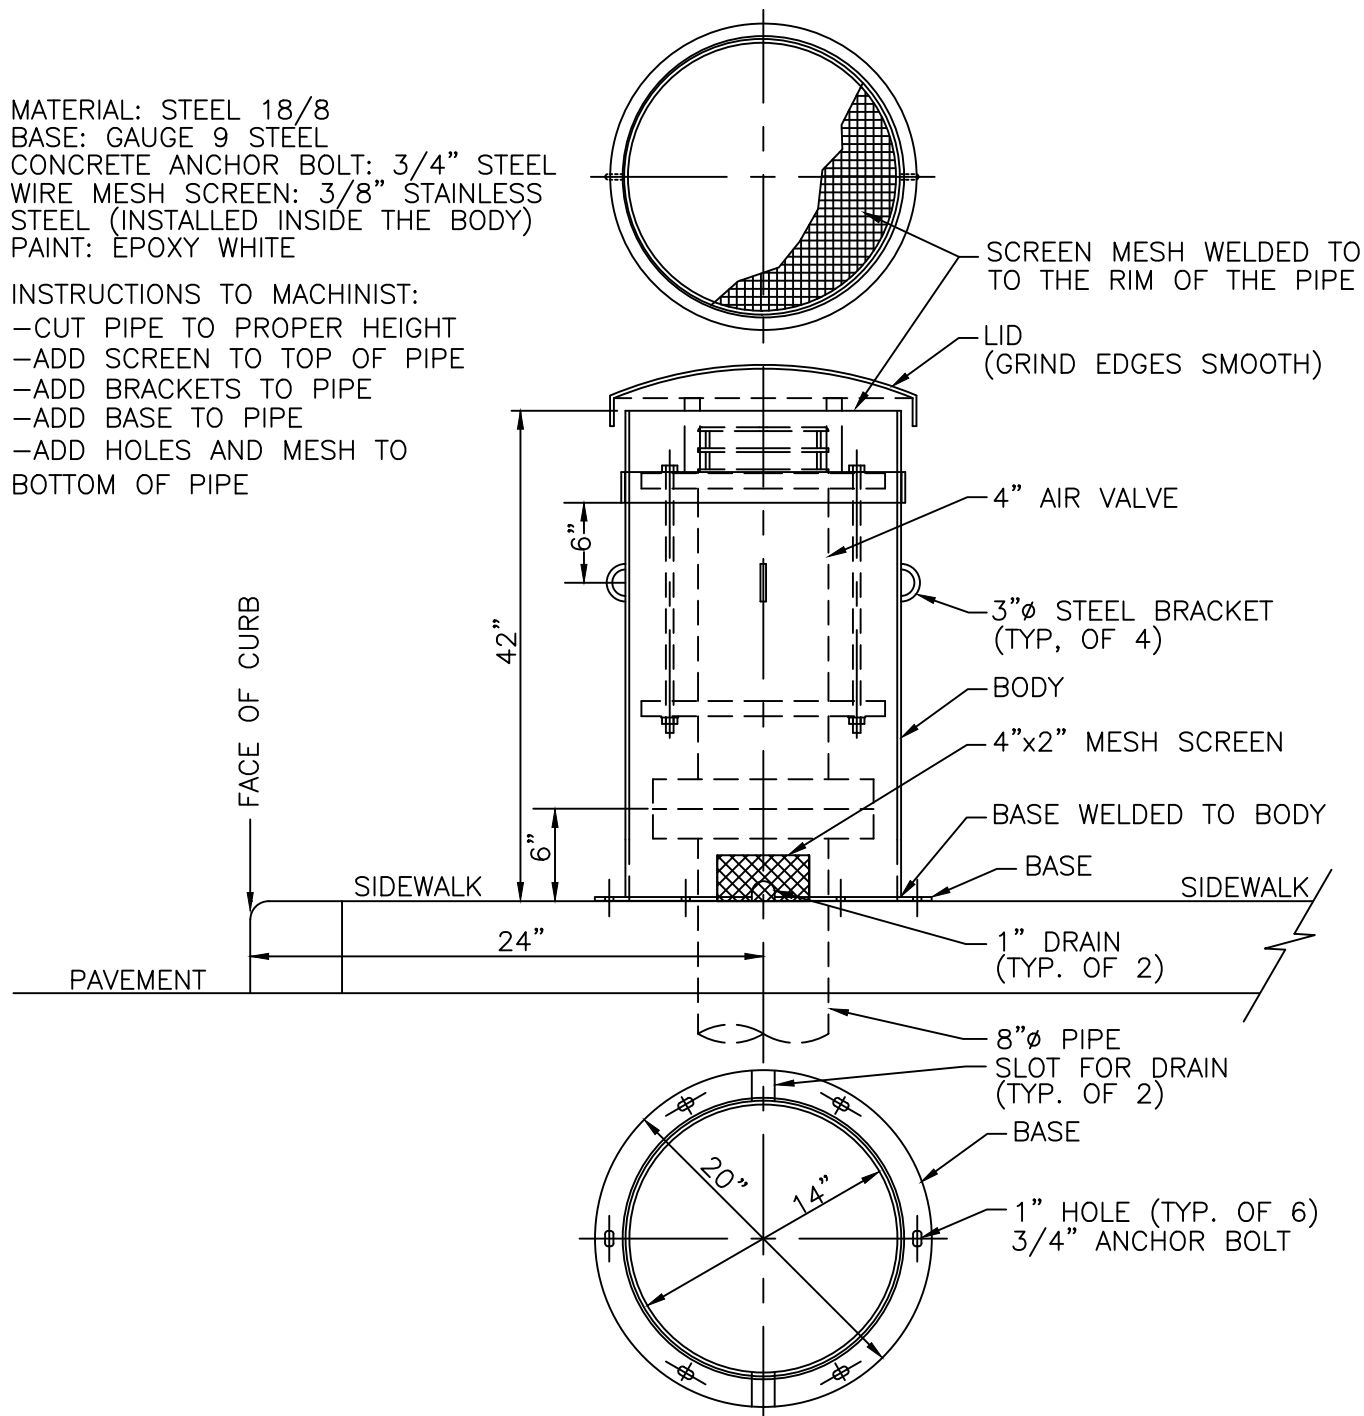

San Francisco
**Water
 Power
 Sewer**

Services of the San Francisco Public Utilities Commission

WATER ENTERPRISE - CITY DISTRIBUTION DIVISION STANDARD PLANS

VALVE BOXES & COVERS
 4-IN AIR VALVE ENCLOSURE

DATE 3/7/2017

REV.

DRAWING NO.

SHEET

SCALE N.T.S.

1

CDD-LP-255

90