
















BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
Assembly Area shown below

 Mobility Impaired Persons should evacuate
IMMEDIATELY on hearing the alarm with
assistance from a nominated person.

Follow Fire Warden Instructions
Do NOT use lifts
















ASSEMBLY AREA




78 G.P. SOUTH BUILDING
Level 1
Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

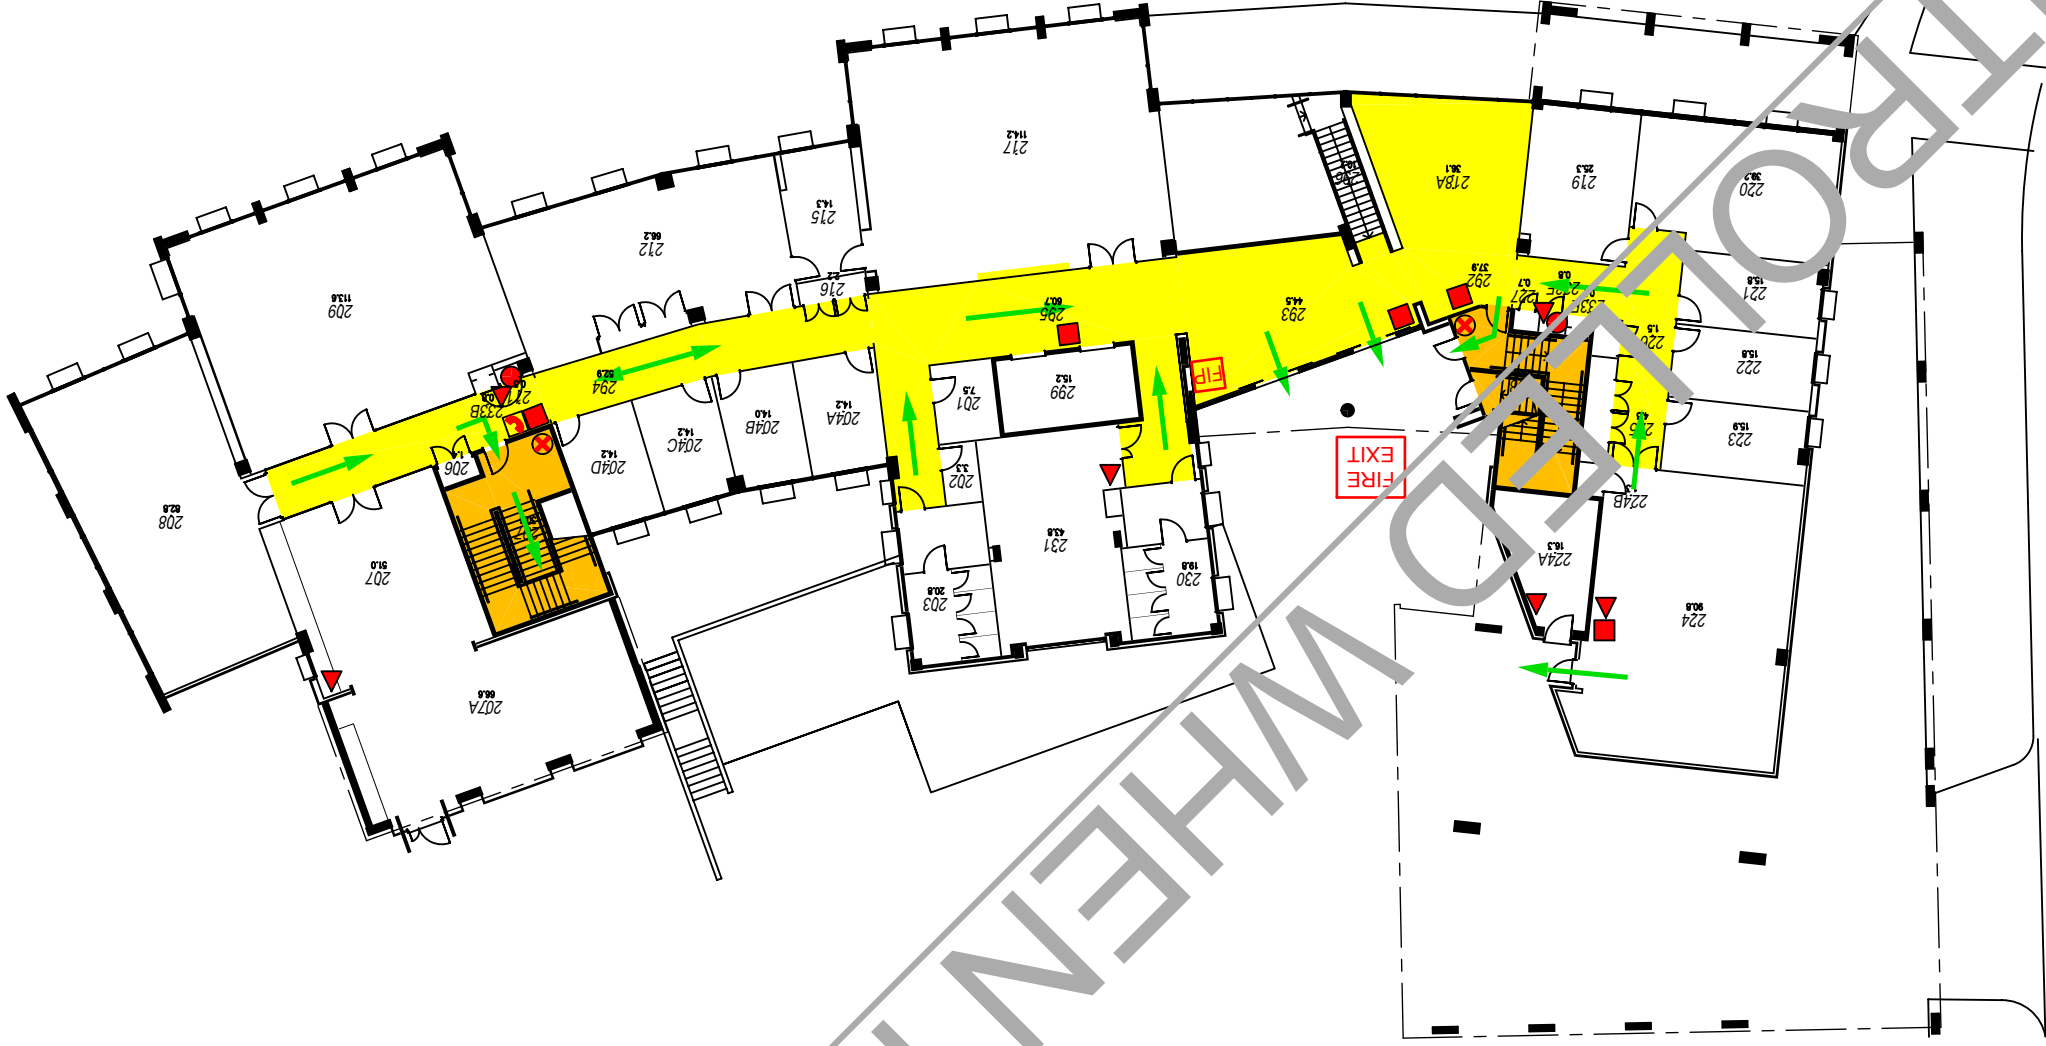
Available online at www.pf.uq.edu.au

LEGEND	
	Exit Paths
	Exit Stairs
	Manual Call Point
	Fire Hose Reel
	Fire Hydrant
	Fire Extinguisher
	Fire Blanket
	Wardens Phone
	Emergency Shut Down
	First Aid
	Breathing Apparatus
	Safety Shower
	Eye Wash
	Spill Kit
	Defibrillator

IN CASE OF FIRE & EMERGENCY

- R** REMOVE persons from immediate danger
- A** ALERT UQ Security (Tel 5 3333 or 3365 3333)
- C** CONFINE the Fire & Smoke
- C** CLOSE Doors & Windows (if safe to do so)
- E** EVACUATE to the Assembly Area shown below
-  Mobility Impaired Persons should evacuate IMMEDIATELY on hearing the alarm with assistance from a nominated person.
- Follow Fire Warden Instructions
- Do NOT use lifts

ASSEMBLY AREA


















78 G.P. SOUTH BUILDING
Level 2
Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
A ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
C CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
E Assembly Area shown below

 Mobility Impaired Persons should evacuate
IMMEDIATELY on hearing the alarm with
assistance from a nominated person.

Follow Fire Warden Instructions
Do NOT use lifts

ASSEMBLY AREA



78 G.P. SOUTH BUILDING
















Level 3

Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
Assembly Area shown below

 Mobility Impaired Persons should evacuate
IMMEDIATELY on hearing the alarm with
assistance from a nominated person.

Follow Fire Warden Instructions
Do **NOT** use lifts

ASSEMBLY AREA



78 G.P. SOUTH BUILDING
















Level 4

Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
Assembly Area shown below

 Mobility Impaired Persons should evacuate
IMMEDIATELY on hearing the alarm with
assistance from a nominated person.

Follow Fire Warden Instructions
Do NOT use lifts

ASSEMBLY AREA


















78 G.P. SOUTH BUILDING
Level 5
Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
Assembly Area shown below

 Mobility Impaired Persons should evacuate
IMMEDIATELY on hearing the alarm with
assistance from a nominated person.

Follow Fire Warden Instructions
Do **NOT** use lifts

ASSEMBLY AREA



78 G.P. SOUTH BUILDING
















Level 6

Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
Assembly Area shown below

 Mobility Impaired Persons should evacuate
IMMEDIATELY on hearing the alarm with
assistance from a nominated person.

Follow Fire Warden Instructions
Do NOT use lifts

ASSEMBLY AREA


















78 G.P. SOUTH BUILDING
Level 7
Revised 18/12/2013

BUILDING EVACUATION DIAGRAM

Available online at www.pf.uq.edu.au

LEGEND

	Exit Paths		First Aid
	Exit Stairs		Breathing Apparatus
	Manual Call Point		Safety Shower
	Fire Hose Reel		Eye Wash
	Fire Hydrant		Spill Kit
	Fire Extinguisher		Defibrillator
	Fire Blanket		
	Wardens Phone		
	Emergency Shut Down		


IN CASE OF FIRE & EMERGENCY

R REMOVE persons from immediate danger

A ALERT UQ Security (Tel 5 3333 or 3365 3333)
ACTIVATE Manual Call Point (if nearby)

C CONFINE the Fire & Smoke
CLOSE Doors & Windows (if safe to do so)

E EVACUATE to the
Assembly Area shown below

 Mobility Impaired Persons should evacuate **IMMEDIATELY** on hearing the alarm with assistance from a nominated person.

Follow Fire Warden Instructions
Do NOT use lifts

ASSEMBLY AREA



78 G.P. SOUTH BUILDING
Level 8
Revised 18/12/2013