

CONSTRUCTION DOCUMENT DRAWINGS FOR: OLSEN CUSTOM HOMES



OLSEN ERIC C. OLSEN — CCC 1508852
"BUILDING INTEGRITY WITH EVERY HOME"
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA 32127
TEL: (386) 947-4481
FAX: (386) 947-4481
WWW.OLSENCUSTOMHOMES.COM

CUSTOM MODEL:
OLSEN MODEL
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA

GENERAL NOTES:

- DO NOT SCALE DRAWINGS. USE FIGURED DIMENSIONS ONLY.
- ALL DIMENSIONS ARE TAKEN FROM OUT TO OUT OF CONCRETE, UNLESS OTHERWISE NOTED. DIMENSIONS ARE PLUS AND MINUS AND MUST BE FIELD VERIFIED PRIOR TO TRUSSES BEING MANUFACTURED.
- THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS, SHALL VERIFY EXISTING TOPOGRAPHY AND GRADE ELEVATIONS AND SHALL NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO PROCEEDING WITH THE PROJECT.
- SOIL BEARING VALUES, FOUNDATION DESIGNS SHOWN HERE ARE BASED ON A SOIL BEARING VALUE OF 2500 PSF. FOUNDATIONS AND SLABS ARE DESIGNED TO UNIFORMLY BEAR ON WELL COMPACTED, WELL DRAINED NON EXPANSIVE SOILS. A CERTIFIED SOILS ENGINEER SHALL REVIEW FOUNDATION DESIGNS, BUILDING LOADS AND COMPARE WITH SUBSURFACE SOIL INVESTIGATION RECOMMENDATIONS. SHOULD ON- SITE OBSERVATIONS SHOW THAT FOOTINGS SHOWN HERE ARE NOT SATISFACTORY, THE ARCHITECT SHALL BE CONTACTED IMMEDIATELY FOR NEW DESIGNS.
- CONCRETE STRENGTH: MINIMUM CONCRETE STRENGTH FOR ALL SLABS, PATIOS AND FOUNDATIONS SHALL BE MINIMUM 3000 PSI AFTER 28 DAYS. ALL SLABS ON GRADE SHALL BE 4" THICK AND BE REINFORCED WITH 6x6 10/10 W.W.M. UNLESS NOTED OTHERWISE. LAP MESH 8" AT EDGES AND ENDS AND PROVIDE ADDITIONAL REINFORCING WHERE SHOWN ON DRAWINGS. PLACE MESH IN CENTER OF SLAB. VAPOR BARRIER BENEATH FLOOR SLABS SHALL BE 6 MIL. VISQUEEN OR EQUAL. TOP OF ALL FOOTINGS SHALL BE A MINIMUM OF 6" BELOW TOP OF FINISHED FLOOR SLAB UNLESS OTHERWISE NOTED.
- ALL FOOTINGS SHALL BE CENTERED UNDER COLUMNS AND WALLS. REINFORCING STEEL: GENERAL REINFORCING STEEL SHALL BE No. 5 BARS, EXCEPT WHERE TWO No. 5 BARS ARE REQUIRED WITHIN THE SAME GROUTED MASONRY CELL OR BOND BEAM, ONE No.7 BAR MAY BE SUBSTITUTED. WHEN TWO BARS ARE REQUIRED IN THE SAME CELL OR BOND BEAM, THEY MAY BE BUNDLED. SPLICES SHALL BE LAP SPLICES. NON-CONTACT LAP SPLICES MAY BE USED PROVIDED REINFORCING BARS ARE NOT SPACED FARTHER APART THAN 3 INCHES FOR No. 3 BARS, 4 INCHES FOR No. 4 BARS, 5 INCHES FOR No. 5 BARS AND 7 INCHES FOR No. 7 BARS. SPLICE LENGTHS FOR GRADE 40 STEEL SHALL BE A MINIMUM OF 15 INCHES FOR No.3 BARS, 20 INCHES FOR No. 4 BARS, 25 INCHES FOR No. 5 BARS AND 35 INCHES FOR No. 7 BARS (40 BAR DIAMETERS). WHERE GRADE 60 STEEL IS SUBSTITUTED FOR GRADE 40 STEEL, THE LAP LENGTHS FOR GRADE 40 STEEL MAY BE USED. SPLICES OF A No. 5 BAR WITH ONE No. 7 BAR SHALL BE A MINIMUM OF 25 INCHES AND TWO No. 5 BARS WITH ONE No. 7 BAR SHALL BE A MINIMUM OF 35 INCHES. REINFORCEMENT MAY BE BENT IN THE SHOP OR IN THE FIELD PROVIDED: ALL REINFORCEMENT SHALL BE BENT COLD; THE DIAMETER OF THE BEND, MEASURED IN THE INSIDE OF THE BAR, IS NOT LESS THAN SIX BAR-DIAMETERS; AND REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT. EXCEPTION: WHERE BENDING IS NECESSARY TO ALIGN DOWEL BARS WITH A VERTICAL CELL, BARS PARTIALLY EMBEDDED IN CONCRETE SHALL BE PERMITTED TO BE BENT AT A SLOPE OF NOT MORE THAN 1 INCH OF HORIZONTAL DISPLACEMENT TO 6 INCHES OF VERTICAL BAR LENGTH.
- COVER OVER REINFORCING STEEL: FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE: 3 INCHES IN FOUNDATIONS WHERE THE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH THE EARTH; OR, 1 1/2 INCHES FOR No. 5 AND SMALLER BARS AND 2 INCHES FOR No. 6 AND LARGER BARS WHERE CONCRETE IS FORMED AND WILL BE EXPOSED TO THE EARTH OR WEATHER. IN NARROW FOOTINGS WHERE INSUFFICIENT WIDTH IS AVAILABLE TO ACCOMMODATE A STANDARD 90 DEGREE HOOK AND PROVIDE THE REQUIRED CONCRETE COVER, THE HOOK SHALL BE ROTATED IN THE HORIZONTAL DIRECTION UNTIL THE REQUIRED CONCRETE COVER IS ACHIEVED. WHERE CONCRETE IS NOT EXPOSED TO WEATHER, THE MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 1 1/2 INCHES REGARDLESS OF BAR SIZE. REINFORCING BARS EMBEDDED IN GROUTED MASONRY CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/4 INCH FOR FINE GROUT OR 1/2 INCH FOR COARSE GROUT BETWEEN REINFORCING BARS AND ANY FACE OF A CELL. REINFORCING BARS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN 2 INCHES FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER OR 1 1/2 INCHES FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER.
- STRUCTURAL LUMBER: ALL LUMBER SHALL BE SYP #2 OR BETTER FOR LUMBER EXPOSED TO CONCRETE OR WHEATHER USE P.T. CONNECTORS, METAL PLATES, SCREWS, BOLTS AND NAILS EXPOSED DIRECTLY TO THE WEATHER OR SUBJECT TO SALT CORROSION IN COASTAL AREAS SHALL BE STAINLESS STEEL, HOT DIPPED GALVANIZED AFTER THE FASTENER OR CONNECTOR IS FABRICATED TO FORM A ZINC COATING NOT LESS THAN 1oz PER sq.ft. OR HOT DIPPED GALVANIZED WITH A MINIMUM COATING OF 1.8 oz PER sq ft. OF STEEL MEETING THE REQUIREMENTS OF ASTM A 90 (TRIPLE SPOT TEST). PROVIDE PRE-ENGINEERED, PREFABRICATED 2X WOOD TRUSSES FOR LOADS, SPANS AND CONDITIONS SHOWN. PROVIDE ALL REQUIRED INFILL FRAMING, BLOCKING AND BRACING REQUIRED TO FRAME ENTIRE ROOF SYSTEM. SECURE BEARING POINTS OF EACH TRUSS WITH HURRICANE CLIPS AS SPECIFIED AND DETAILED.
- ALL WORK IS DONE ON A BEST EFFORT. THE CONTRACTOR / OWNER IS RESPONSIBLE TO VERIFY ALL DIMENSIONS, SPECIFICATIONS, AND OTHER DETAILS PRESENTED IN THESE RENDERINGS. THE CONTRACTOR AND OWNER INDEMNIFIES AND HOLDS HARMLESS DRAFTING AND DESIGNS INC. FROM ANY RESPONSIBILITY FOR ANY DAMAGES RESULTING FROM PLAN ERRORS AND OMISSIONS. BUILDER/ HOMEOWNER TO VERIFY SETBACKS AND LOT BUILDABLE.

ALL WORK IS DONE ON A BEST EFFORT. THE CONTRACTOR / OWNER IS RESPONSIBLE TO VERIFY ALL DIMENSIONS, SPECIFICATIONS, AND OTHER DETAILS PRESENTED IN THESE RENDERINGS. THE CONTRACTOR AND OWNER INDEMNIFIES DRAFTING AND DESIGNS INC. FROM ANY RESPONSIBILITY FOR ANY DAMAGES RESULTING FROM PLAN ERRORS AND OMISSIONS. BUILDER/ HOMEOWNER TO VERIFY SETBACKS AND LOT BUILDABLE.

REVISIONS

DATE:	NO:	DESCRIPTION

WIND LOAD DATA

THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE RESIDENTIAL— EIGHT EDITION (2023), INCLUDING THE CODES REFERENCED THEREIN, AND WITH ASCE-7-22 FOR ENCLOSED STRUCTURE (NT. PRESSURE COEFFICIENT +/-0.18). WIND DESIGN SPEED 139 MPH RISK CATEGORY = II WIND EXPOSURE CLASSIFICATION = "C" FLOOR LIVE LOAD = 40 P.S.F. (MIN.) ROOF LIVE LOAD = 20 P.S.F. (MIN.) DESIGN SOIL BEARING = 2000 P.S.F. (MIN.) WIND LOADS ON COMPONENTS AND CLADDING :

ROOF =
1 15.89, -41.42
2 15.89, -73.35
3 15.89, -84.18

WALL ZONE:
4 29.09, -31.56
5 29.09, -38.95

GARAGE DOORS:
8'-10" W 24.74, -30.25
16'-18" W 23.97, -28.71

ALL EXTERIOR MASONRY WALLS ARE "SHEAR WALLS WITH STRUCTURAL DOWN POURS LOCATED AT 6'-0" ON CENTER MAX FOR 6'-0" FOR ONE STORY AND 4'-0" MAX ON CENTER FOR TWO STORY.

INDEX OF DRAWINGS

COVER	COVER PAGE
SHT. 1	FLOOR PLAN
SHT. 2	FRONT/REAR ELEVATIONS
SHT. 3	SIDE ELEVATIONS
SHT. 4	FOUNDATION
SHT. 5	ELECTRICAL
SHT. 6	DETAILS / WALL SECTIONS
SHT. 7	DETAILS / NOTES
SHT. 8	TRUSS CONNECTOR

ABBREVIATIONS

C	G	M	R
C/C CENTER TO CENTER	GA GAUGE	MAINT MAINTENANCE	R RISER
CAB CABINET	GALV GALVANIZED	MAT MATERIAL	R&S ROD AND SHELF
CAR CARPET	GC GENERAL CONTRACTOR	MAX MAXIMUM	RA RETURN AIR, REGISTERED ARCHITECT
CBL CONCRETE BLOCK	GENL GENERAL	ME MECHANICAL ENGINEER	RAD RADIUS
CJ CONTROL JOINT	GFI GROUND FAULT INTERRUPTED	MECH MECHANICAL	REBAR REINFORCING BAR
CL CENTERLINE, CLEARANCE, CLOSING	GL GLASS	MEZZ MEZZANINE	RECEP RECEPTACLE
CLG CEILING	GL BLK GLASS BLOCK	MFR MANUFACTURE	REFR REFRIGERATE, REFRIGERATOR
CMU CONCRETE MASONRY UNIT	GR GROUND	MIR MIRROR	REFR REINFORCEMENT, OR REINFORCE
COL COLUMN	GR GRADE	MISC MISCELLANEOUS	REQ REQUIRE, REQUIRED
CONC CONCRETE	GRND GROUND	MOUNT MOUNTED	REV REVISE, REVISION
CONST CONSTRUCTION	GYP GYPSUM	ROOM ROOM	RGH ROUGH
CORR CORRIDOR	GYP BD GYPSUM BOARD	MTL MATERIAL	RM ROOM
			RO ROUGH OPENING
D	H	N	S
DBL DEEP, DEPTH	H HIGH	N NORTH	S SOUTH, SUPPLY, SINK
DEG DOUBLE	HB HOSE BID	NO NUMBER	SC SOLID CORE
DET DETAIL	HC HOLLOW CORE, HANDICAPPED	NTS NOT TO SCALE	SCH SCHEDULE
DF DRINKING FOUNTAIN	HGT HEIGHT		SEAL SEALANT
DIA DIAMETER	HM HOLLOW METAL		SECT SECTION
DN DOWN	HOR, HORIZ HORIZONTAL		SF SQUARE FOOT
DR DOOR, DRAIN, DINING ROOM	HR HOUR		SH SHELF, SHEET, SHOWER
DS DOWNSPOUT	HT HEIGHT		SHT SHEET
DTL DETAIL	HVAC HEATING, VENTILATING & AIR CONDITION		SPEC SPECIFICATION, SPECIFICATIONS
DWG DRAWING	HW HOT WATER		SQ SQUARE
	HWH HOT WATER HEATER		SST STAINLESS STEEL
E	I	P	T
E EAST	ID INSIDE DIAMETER	PAR PARALLEL	T TONGUE & GROVE
EA EACH	IN INCH	PB PUSH BUTTON	TEL TELEPHONE
EJ EXPANSION JOINT	INFO INFORMATION	PC PULL CHAIN	THK THICK
ELEC, ELECT ELECTRICAL	INSTL INSTALL	PE PROFESSIONAL ENGINEERING	THRU THROUGH
ELEV ELEVATOR, ELEVATION	INSUL INSULATION	PERP PERPENDICULAR	TV TELEVISION
ENG ENGINEER	INTER INTERIOR	PL PLATE, PROPERTY LINE	
ENT, ENTR ENTRANCE		PLUMB PLUMBING	
EQ EQUAL		PLWD PLYWOOD	
EOP, EOPT EQUIPMENT		PRE PREFINISHED	
EXG, EXIST EXISTING		PREC PRESSURE	
		PT PAVEMENT TREATED	
F	J	Q	U
FAST FASTENER, FASTEN	J JOIST	QUAL QUALITY	UNFIN UNFINISHED
FBC FLORIDA BUILDING CODE	J-BOX JUNCTION BOX	QTY QUANTITY	UNO UNLESS NOTED OTHERWISE
FD FLOOR DRAIN	JANIT JANITOR		UT UNLESS OTHERWISE NOTED
FDN FOUNDATION	JB JUNCTION BOX		UTILITY
FE FIRE EXTINGUISHER	JST JOIST		
FEC FIRE EXTINGUISHER CABINET			
FF FINISH FLOOR			
FFE FINISH FLOOR ELEVATION			
FIN FINISH			
FLX FIXTURE			
FL, FLR FLOOR			
FP FIRE PLACE			
FT FOOT, FEET			
FTG FOOTING			
FURR FURRING			
A	B	V	W
AB ANCHOR BOLT	B BOTTOM	V VERTICAL	W WEST
A/C AIR CONDITION	BDM BEDROOM	VLT VAULT	WITH
ACC ACCESS	BEL BELOW		WITHOUT
ADA AMERICAN WITH DISABILITIES ACT	BET, BETW BETWEEN		WATERCLOSET
ADH ADHESIVE	BLK BLOCK		WATER HEATER
AF ABOVE FLOOR	BLKG BLOCKING		
AFF ABOVE FINISH FLOOR	BLT-IN BUILT-IN		
AIA AMERICAN INSTITUTE OF ARCHITECTS	BM BEAM		
AL / ALUM ALUMINUM	BOT BOTTOM		
ANCH ANCHOR	BP BASEPLATE, BYPASS		
APPROX APPROXIMATE	BRG BEARING		
ARCH ARCHITECT, ARCHITECTURAL			
ASPH ASPHALT			
AUTO AUTOMATIC			

REVISIONS	DATE:	NO.:	DESCRIPTION



Daniel Johns, P.E. #54037
Digitally signed by Daniel Johns, P.E.
Date: 2025.11.24 11:13:02 -05'00'
3869 S. NOVA ROAD SUITE #4
Port Orange, FL 32127
756-8582

DESIGN AND PLANS ARE COPYRIGHTED BY OLSEN CUSTOM HOMES
© 2003



DATE: 11/20/25
CHECKED BY: E.O.

SHEET #

COVER

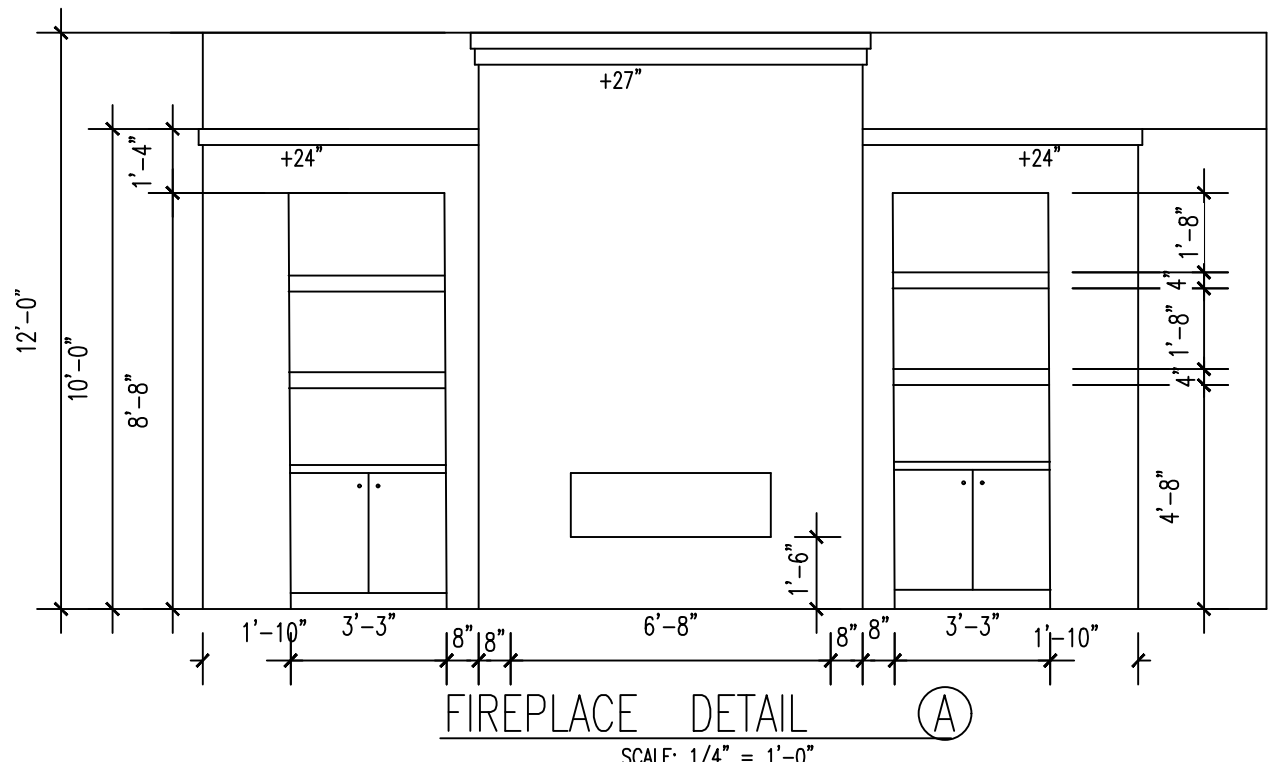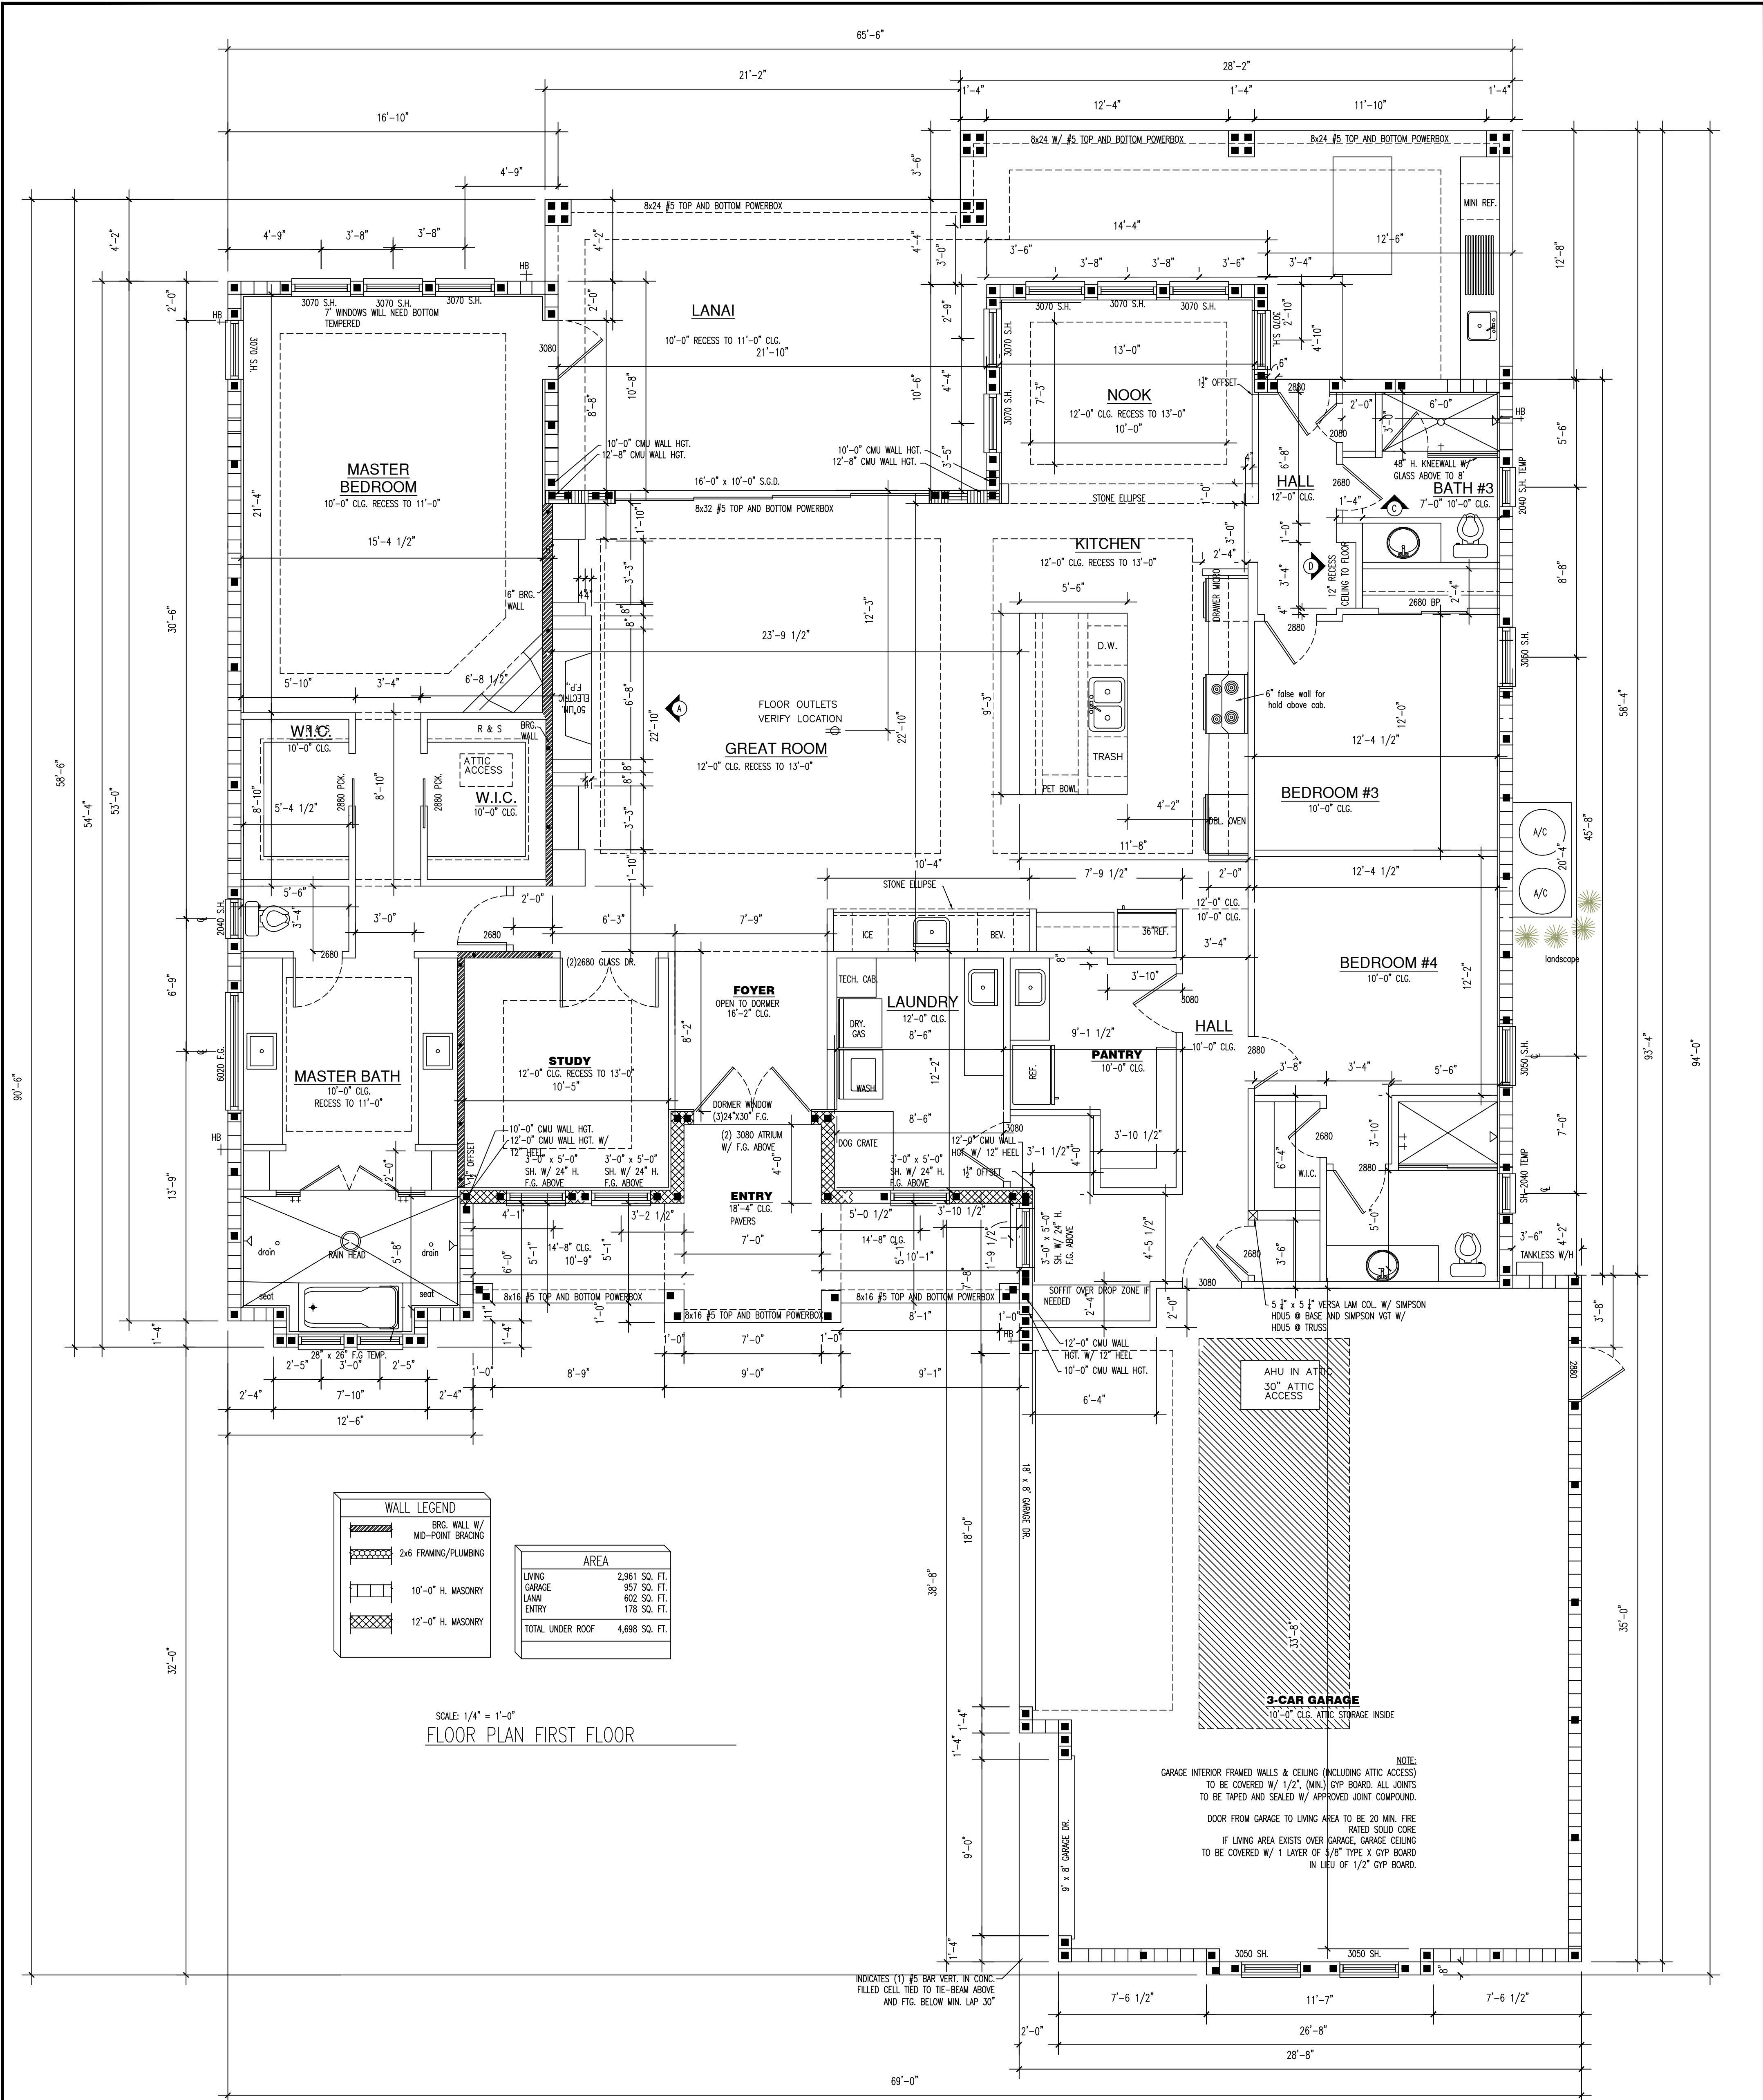

REVISIONS		
DATE:	NO.:	DESCRIPTION

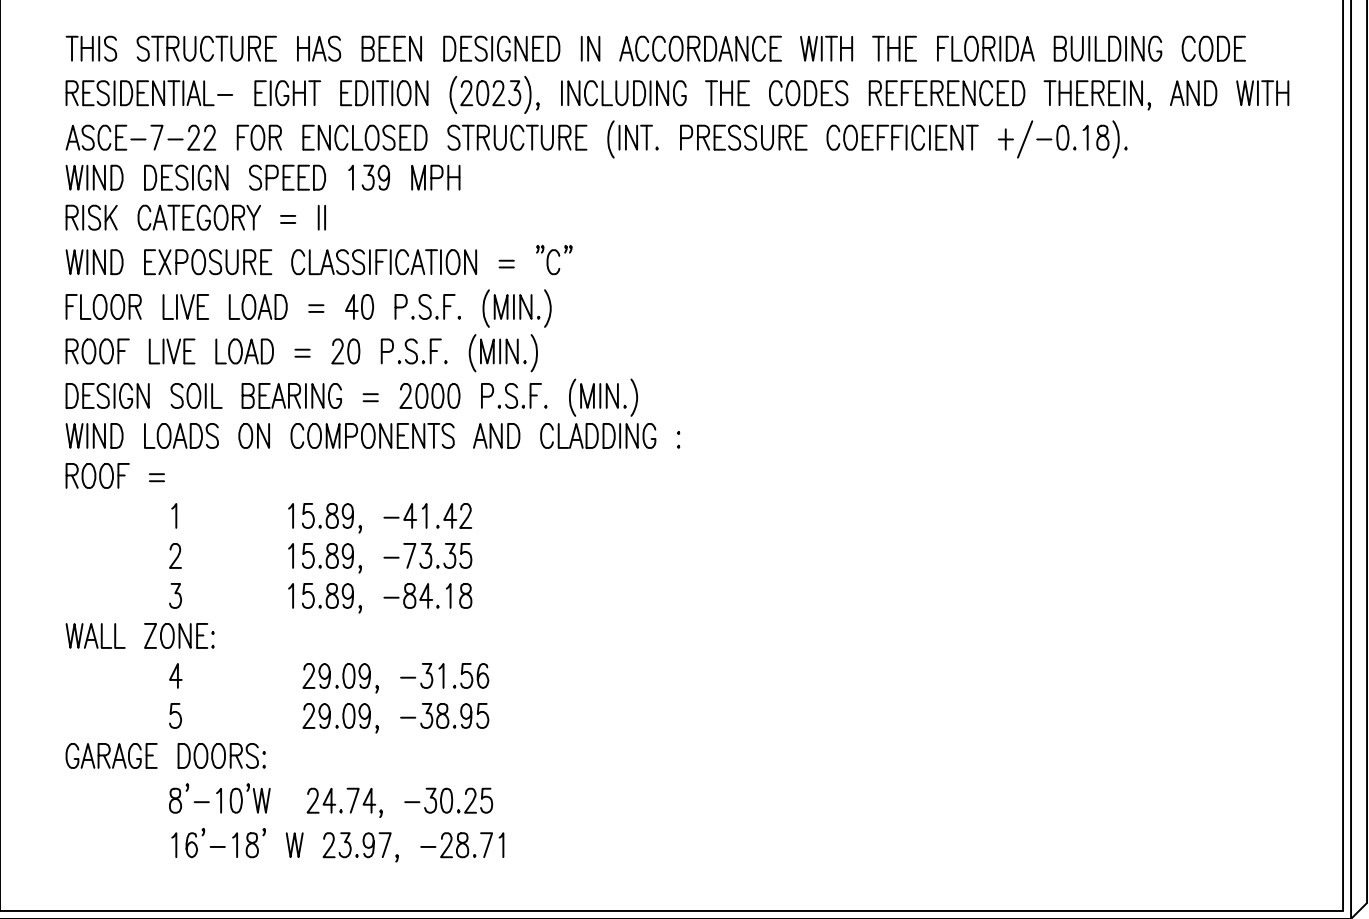

OLSEN
CUSTOM HOMES

ERIC C. OLSEN — CCC 1508352
"BUILDING INTEGRITY WITH EVERY HOME"

2450 SOUTH RIDGEWOOD AVE
PORT ORANGE, FL 32129
OFFICE (386) 947-4481
CELL (386) 581-1882
WWW.OLSENCUSTOMHOMES.COM

CUSTOM MODEL:
OLSEN MODEL
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA

[illegible]



Daniel Johns, P.E. #54037

DESIGN AND PLANS
ARE COPYRIGHTED BY
OLSEN CUSTOM HOMES
© 2003

DATE: 11/20/25

CHECKED BY: E.O.

SHEET #

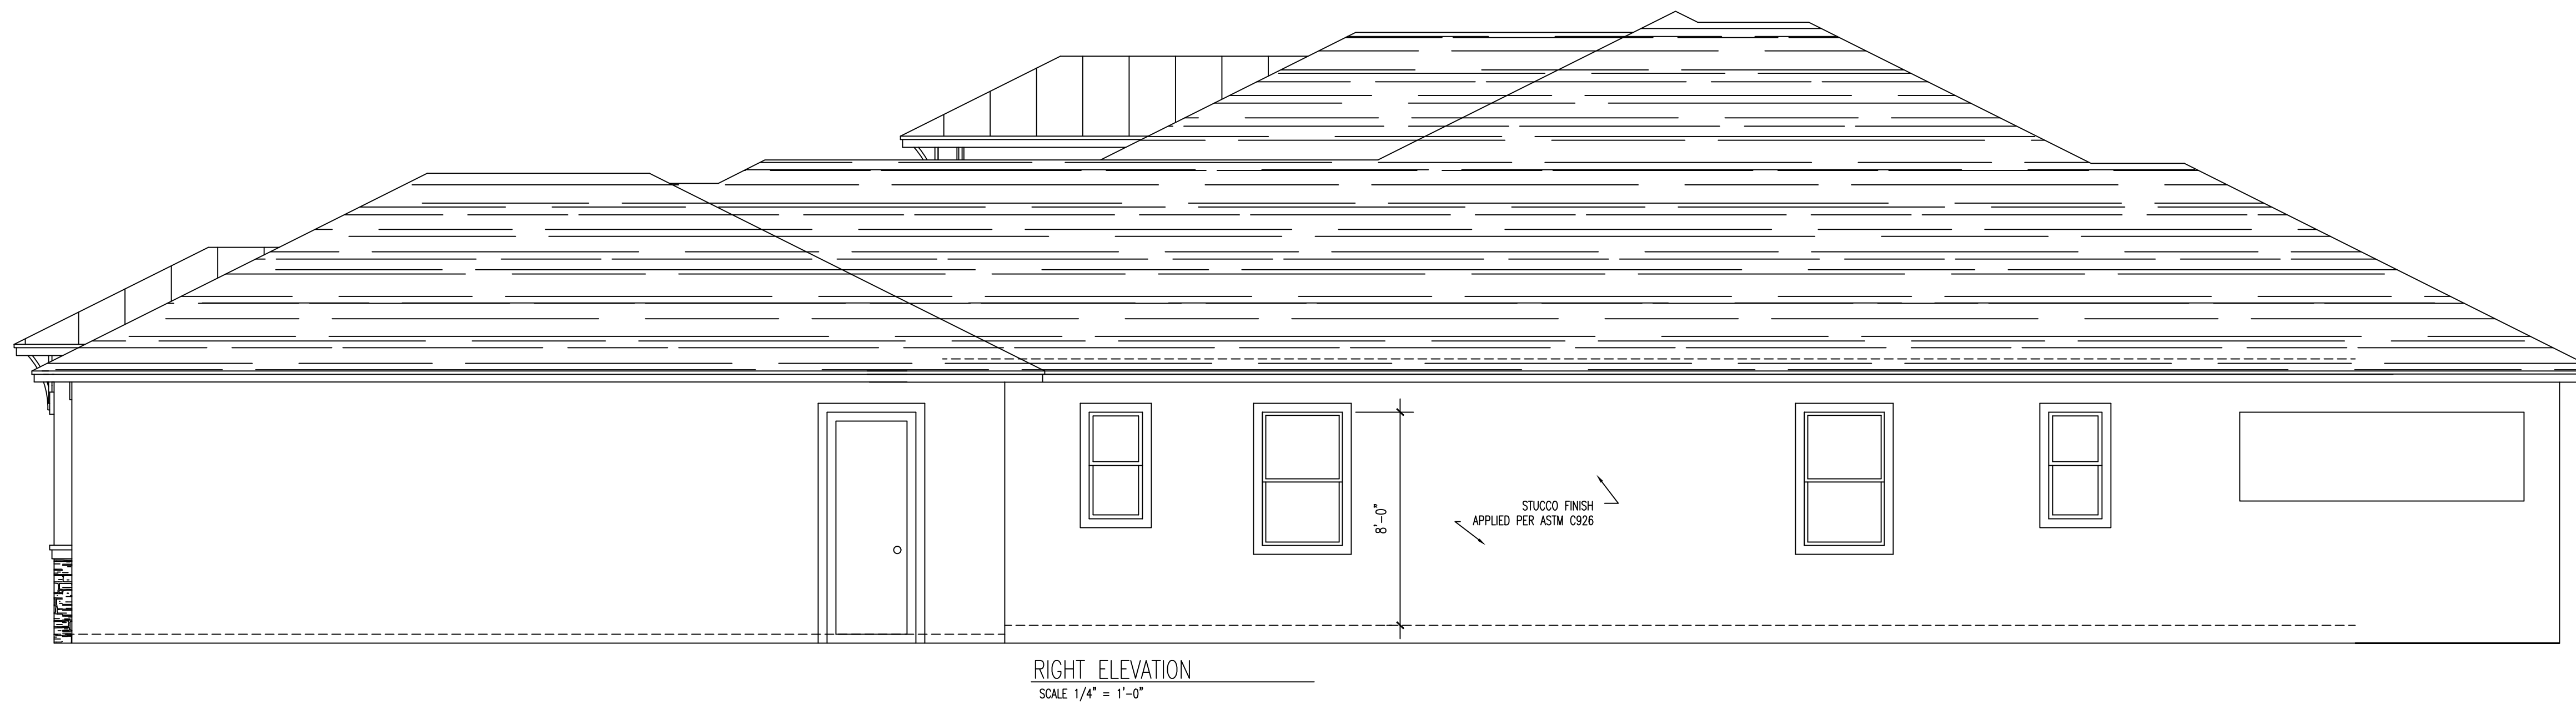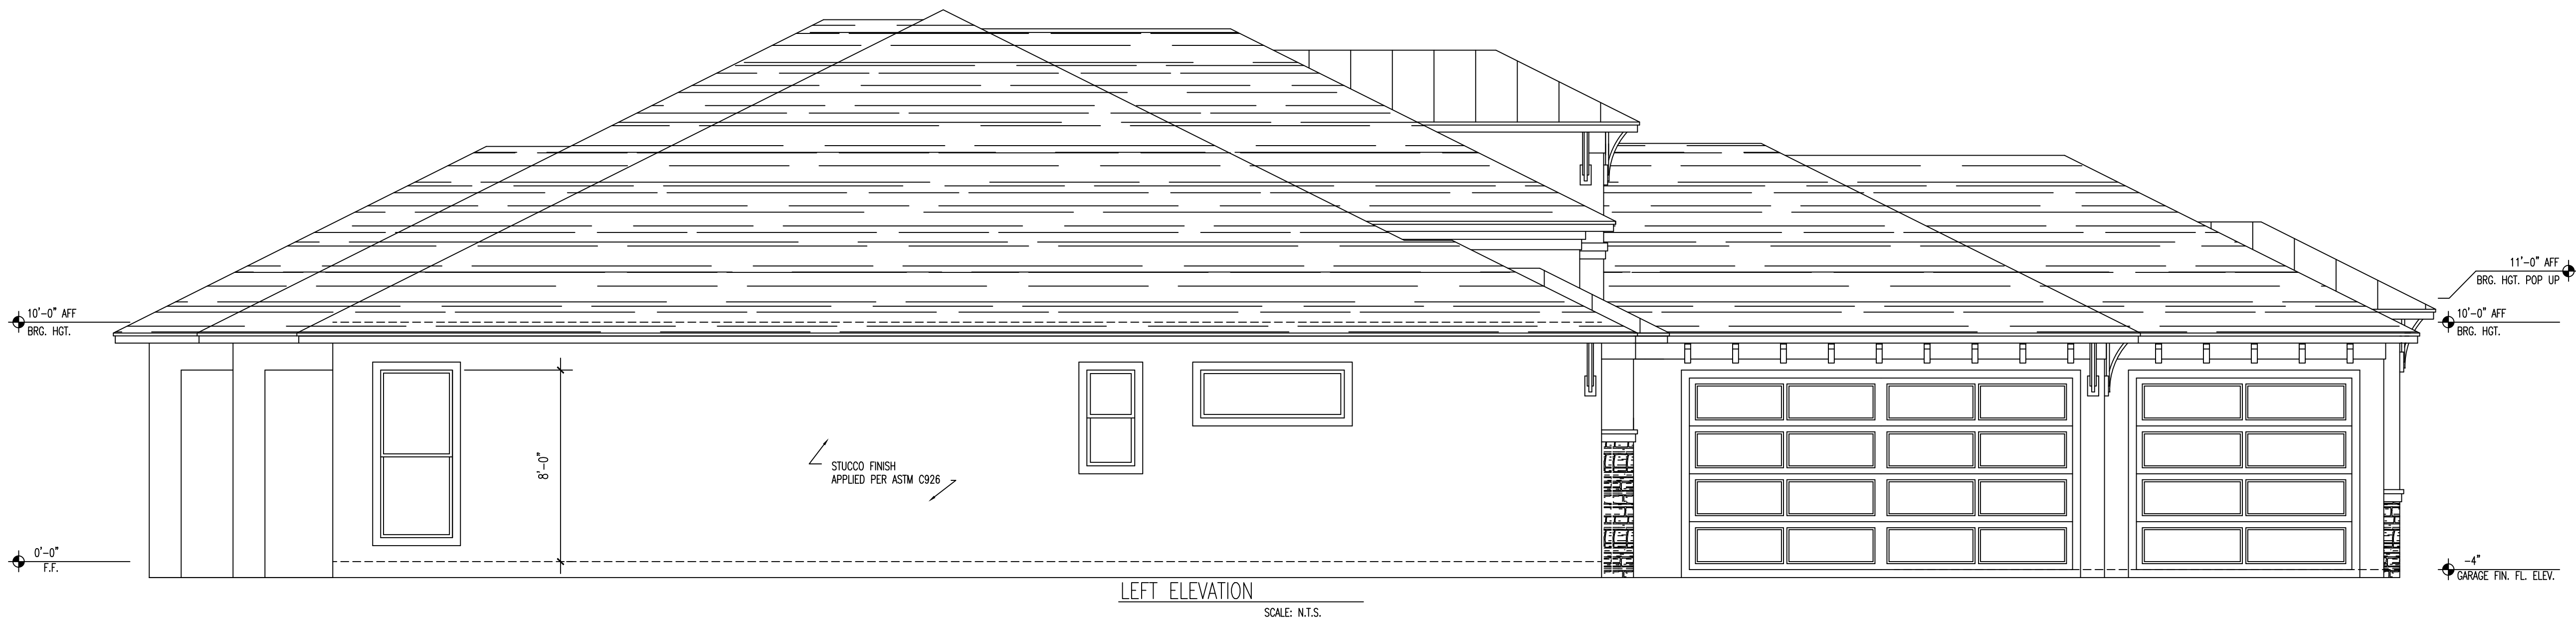

OLSEN

ERIC C. OLSEN — CCC 1508852

"BUILDING INTEGRITY WITH EVERY HOME"

CUSTOM HOMES

1450 STILLWATER DRIVE
PORT ORANGE, FL 32129
OFFICE: (386) 947-4481
FAX: (386) 947-4482
WWW.OLSENCUSTOMHOMES.COM

CUSTOM MODEL:
OLSEN MODEL
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA

REVISIONS	
DATE	DESCRIPTION

Daniel Johns, P.E. #54037

3869 S. NOVA ROAD SUITE #4
Port Orange, FL 32127
756-8582


DESIGN AND PLANS
ARE COPYRIGHTED BY
OLSEN CUSTOM HOMES
© 2003

DATE: 11/20/25

CHECKED BY: E.O.

SHEET #

3 OF 8

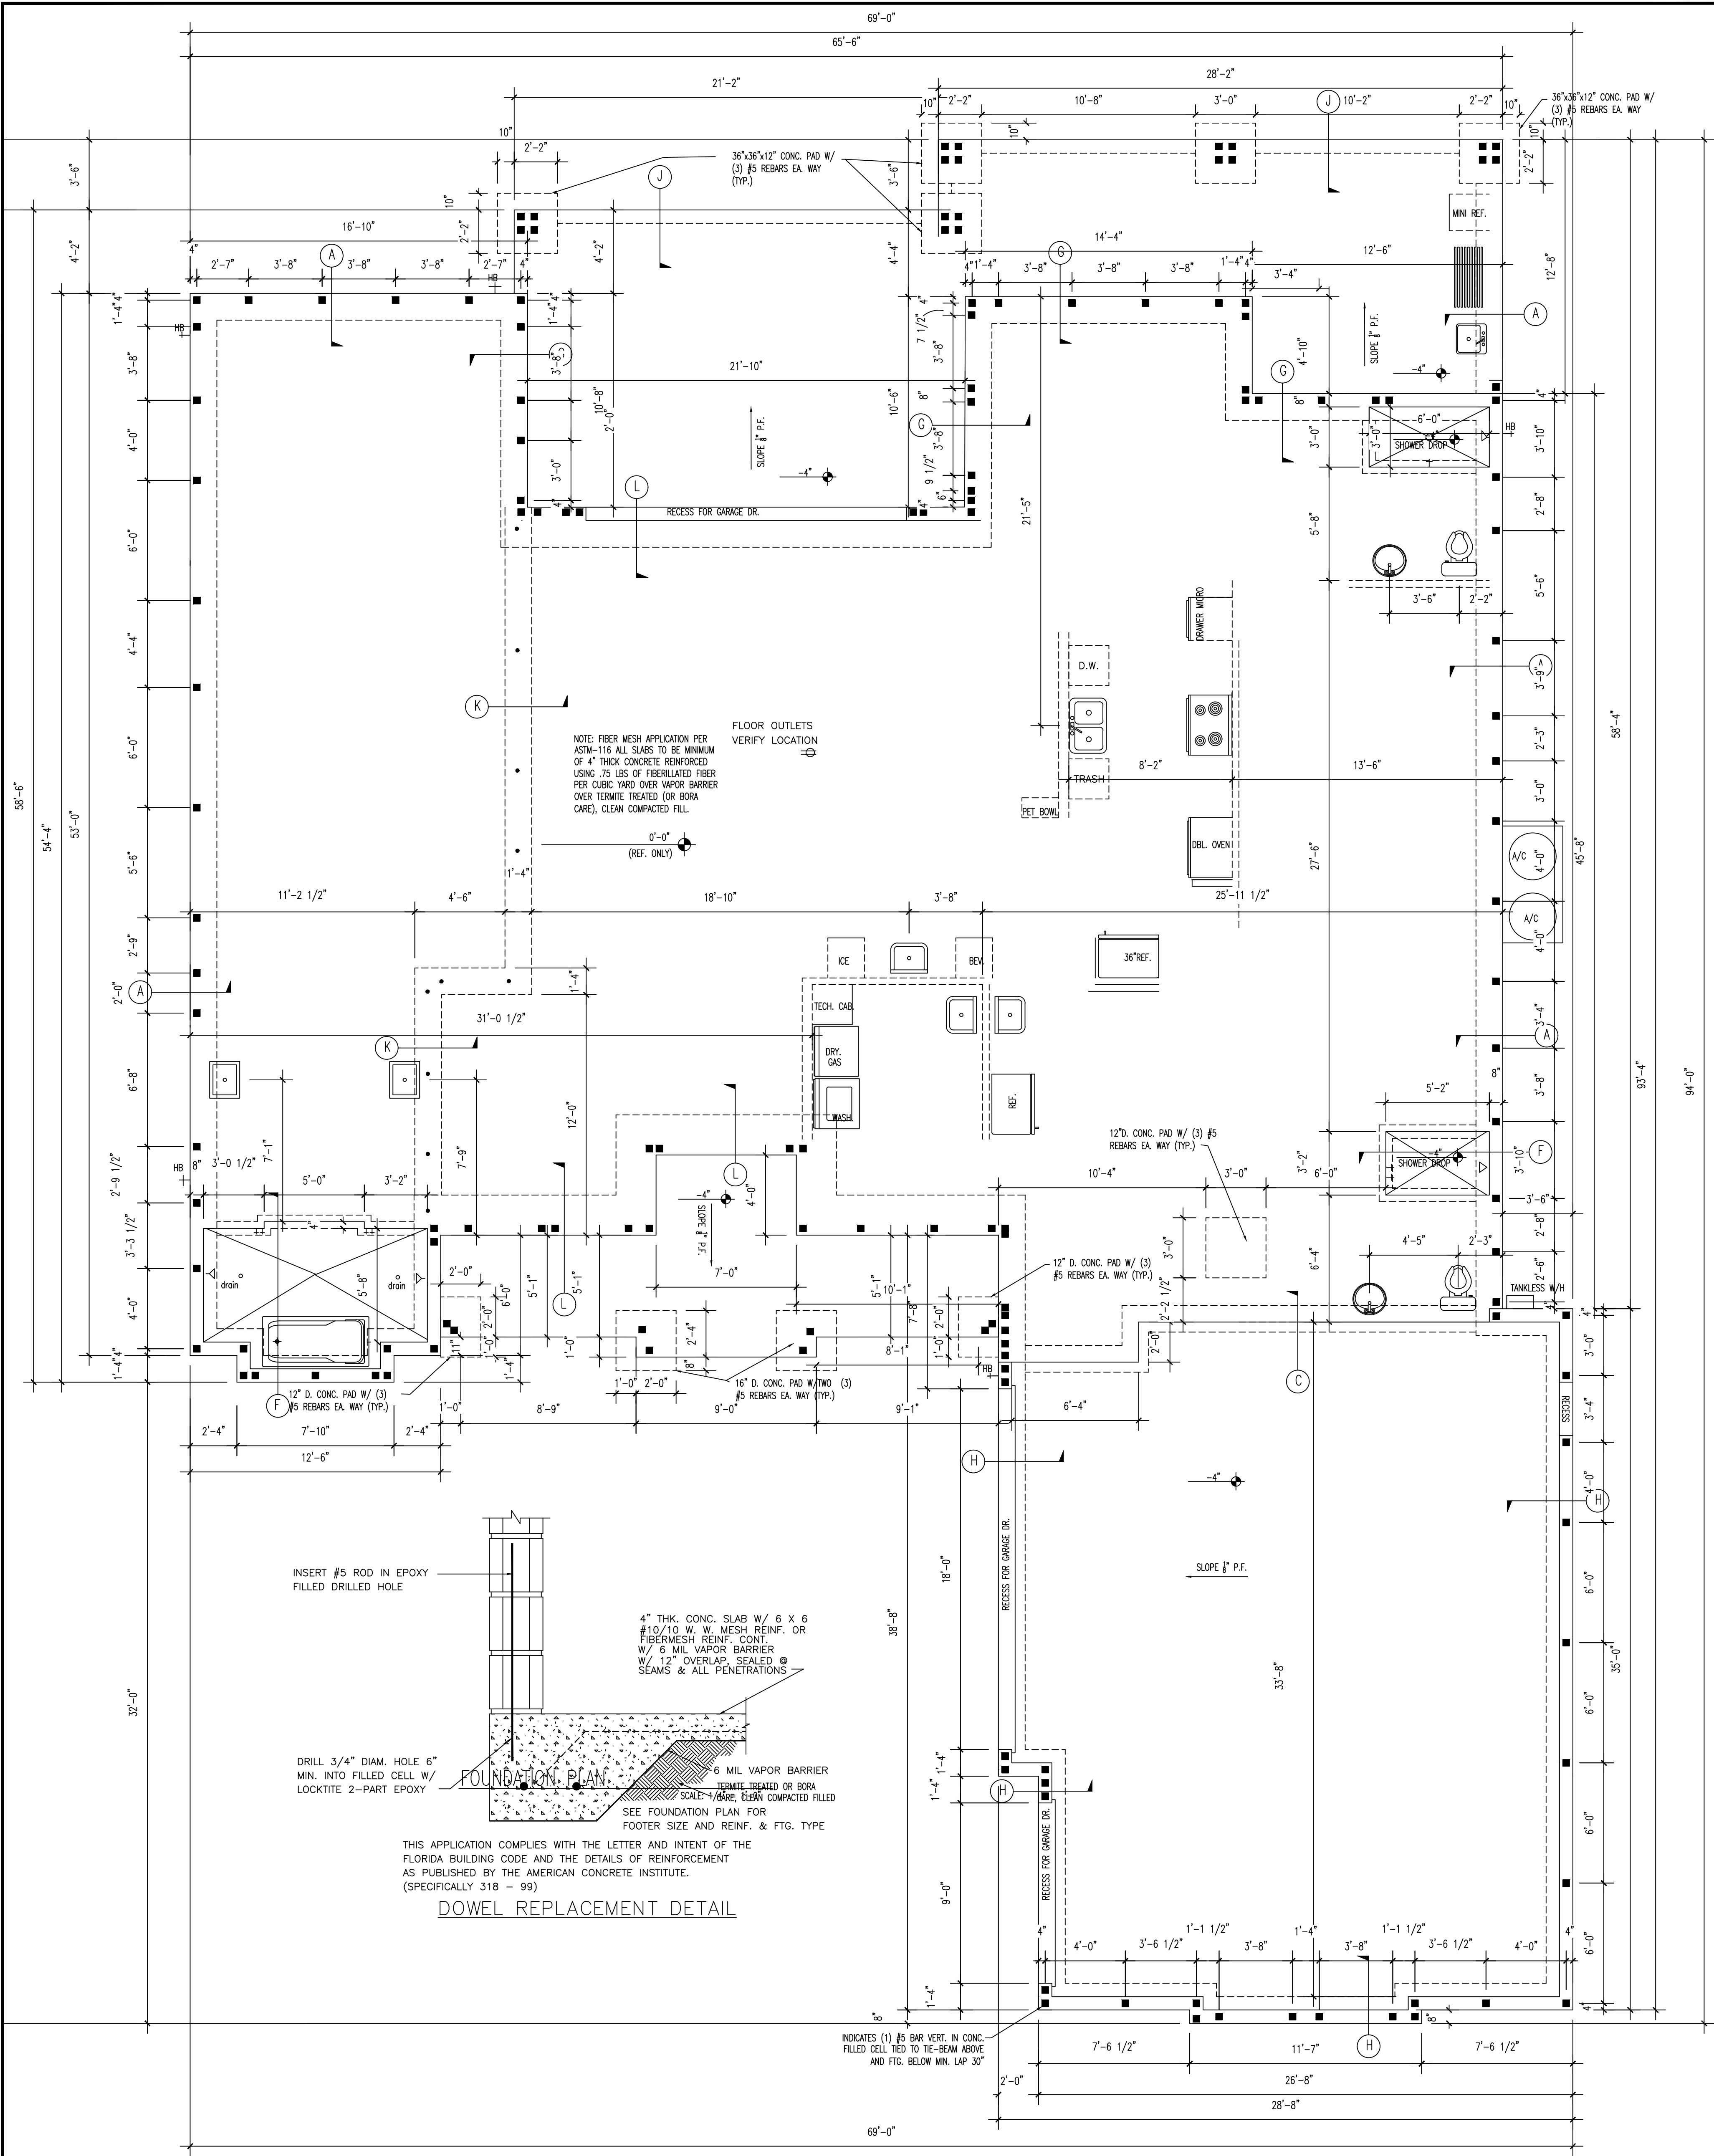

INSERT #5 ROD IN EPOXY
FILLED DRILLED HOLE

DRILL 3/4" DIAM. HOLE 6"
MIN. INTO FILLED CELL W/
LOCKTITE 2-PART EPOXY


4" THK. CONC. SLAB W/ 6 X 6
#10/10 W. W. MESH REINF. OR
FIBERMESH REINF. CONT.
W/ 6 MIL VAPOR BARRIER
W/ 12" OVERLAP, SEALED @
SEAMS & ALL PENETRATIONS

6 MIL VAPOR BARRIER
TERMITE TREATED OR BORA
SCALE: 1/4" = 1'-0"
SEE FOUNDATION PLAN FOR
FOOTER SIZE AND REINF. & FTG. TYPE

THIS APPLICATION COMPLIES WITH THE LETTER AND INTENT OF
THE FLORIDA BUILDING CODE AND THE DETAILS OF REINFORCEMENT
AS PUBLISHED BY THE AMERICAN CONCRETE INSTITUTE.
(SPECIFICALLY 318 - 99)

DOWEL REPLACEMENT DETAIL

INDICATES (1) #5 BAR VERT. IN CONC.
FILLED CELL TIED TO THE BEAM ABOVE
AND FTG. BELOW MIN. LAP 30"

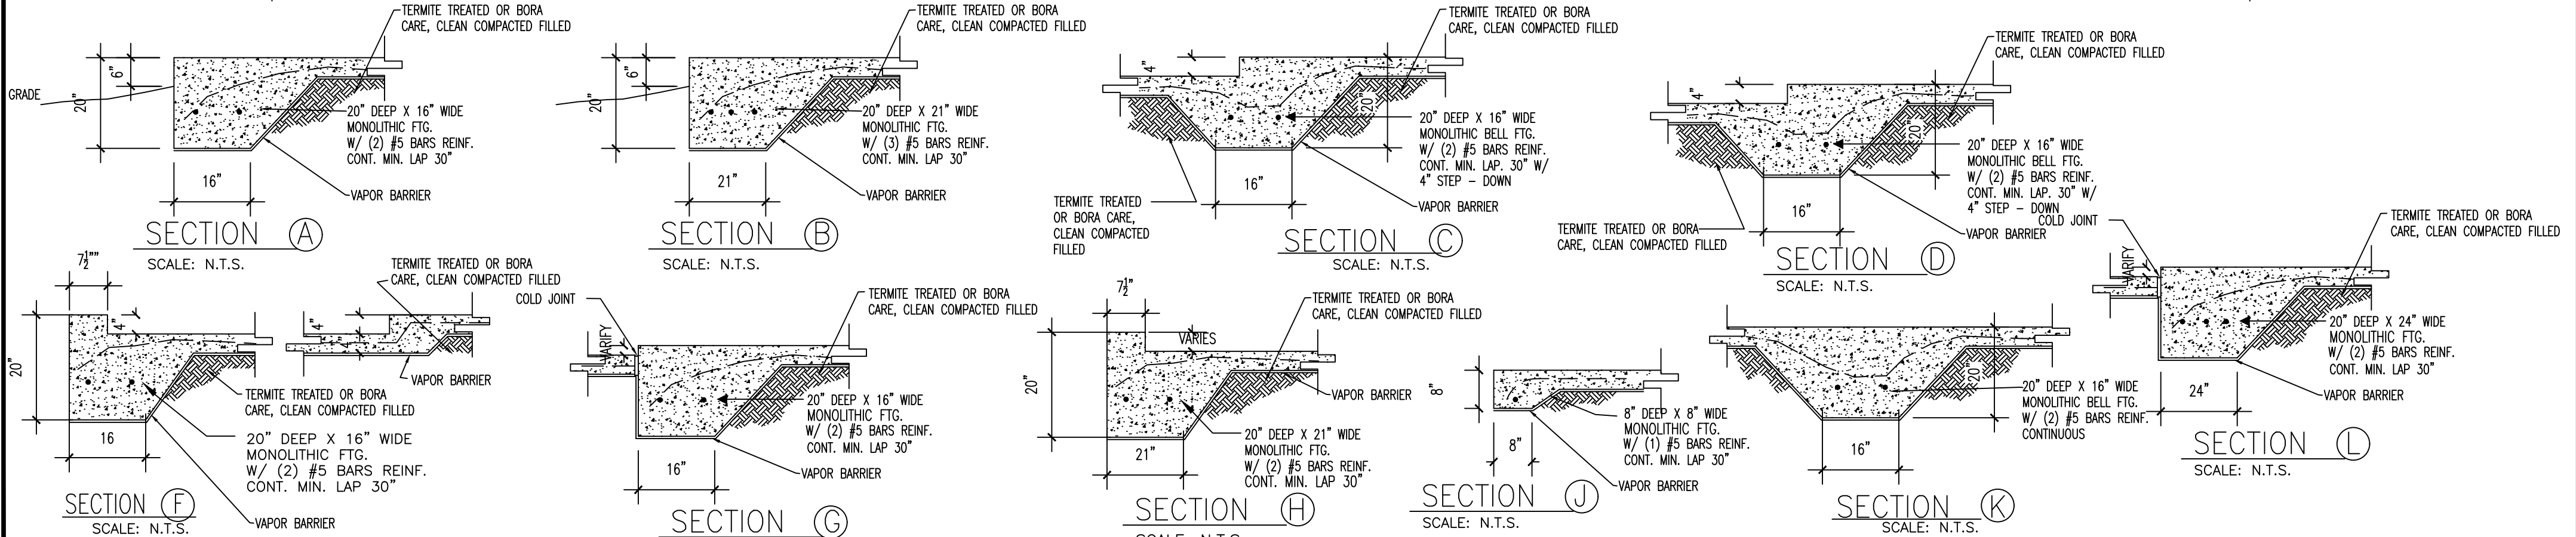

4 OF 8

CHECKED BY: E.O.

DATE: 11/20/25

DESIGN AND PLANS
ARE COPYRIGHTED BY
OLSEN CUSTOM HOMES
© 2003

Daniel Johns, P.E. #54037

3869 S. NOVA ROAD SUITE #4
Port Orange, FL 32127
756-8582

REVISIONS	
DATE:	DESCRIPTION


CUSTOM MODEL:
OLSEN MODEL

183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA


OLSEN

ERIC C. OLSEN - CGC 1508852
"BUILDING INTEGRITY WITH EVERY HOME"

3450 SOUTH RIDGEWOOD AVE
PORT ORANGE, FL 32129
OFFICE: (386) 947-4481
FAX: (386) 947-4484
WWW.OLSENCUSTOMHOMES.COM

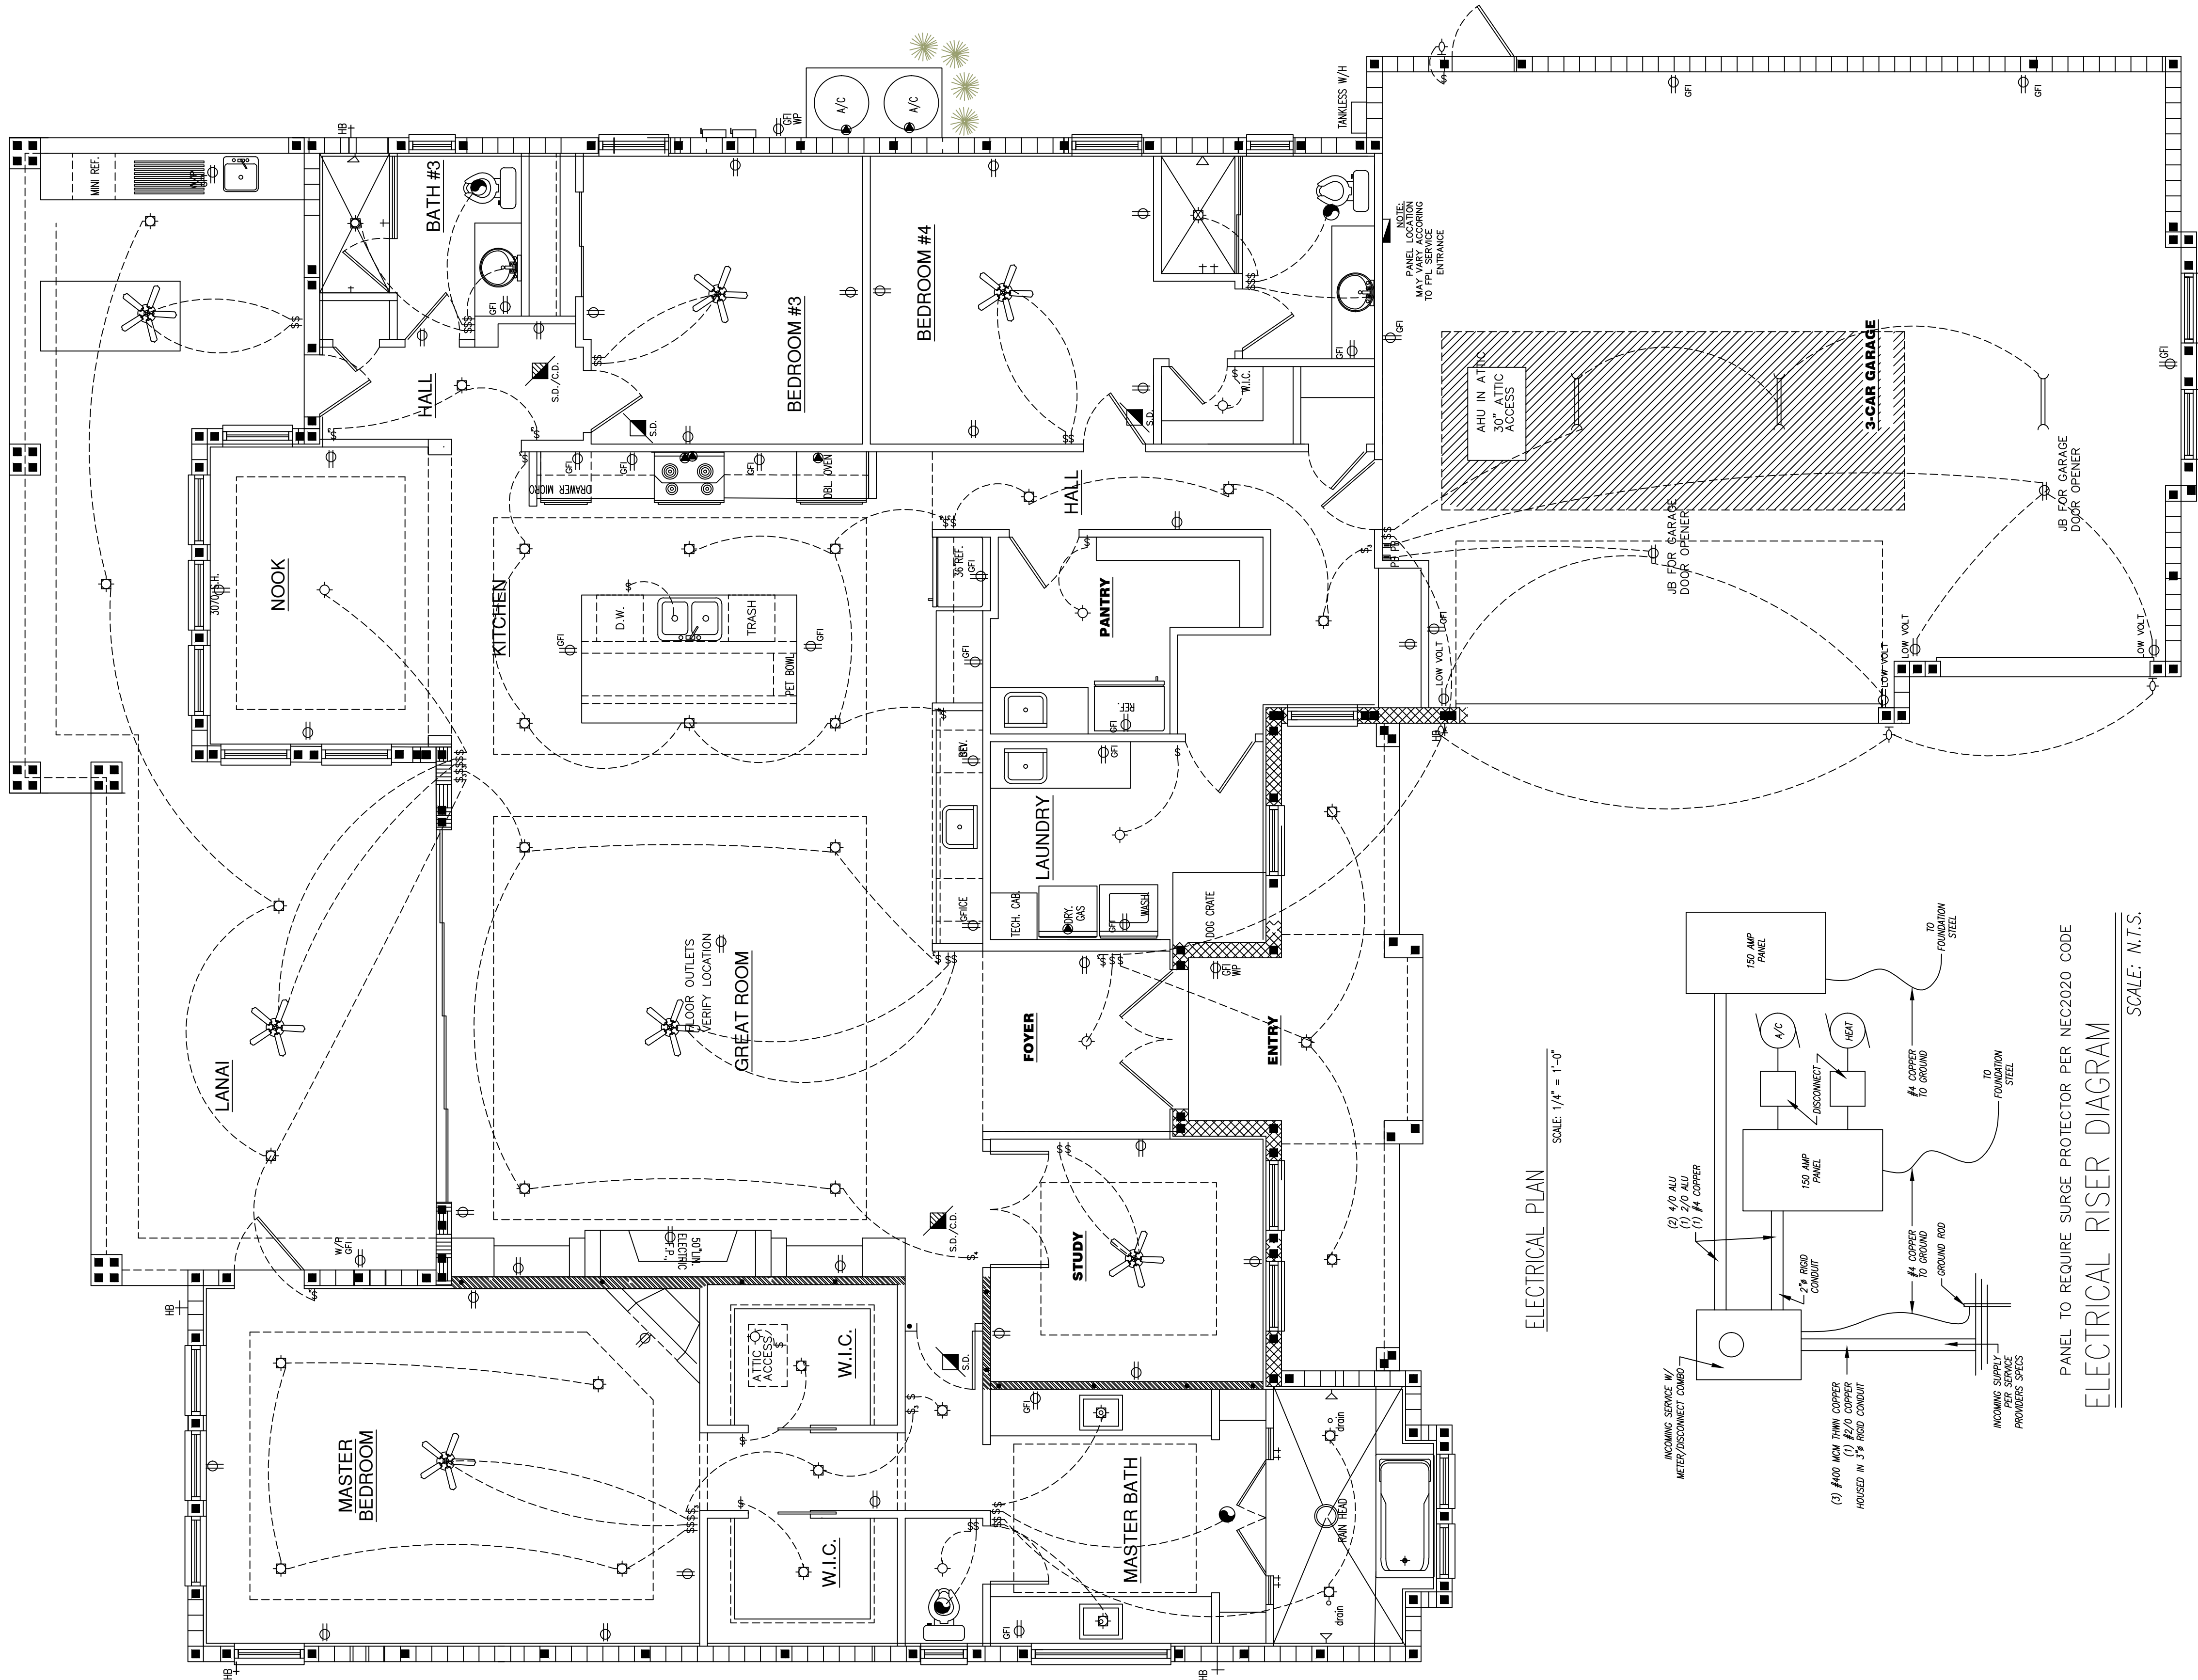

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

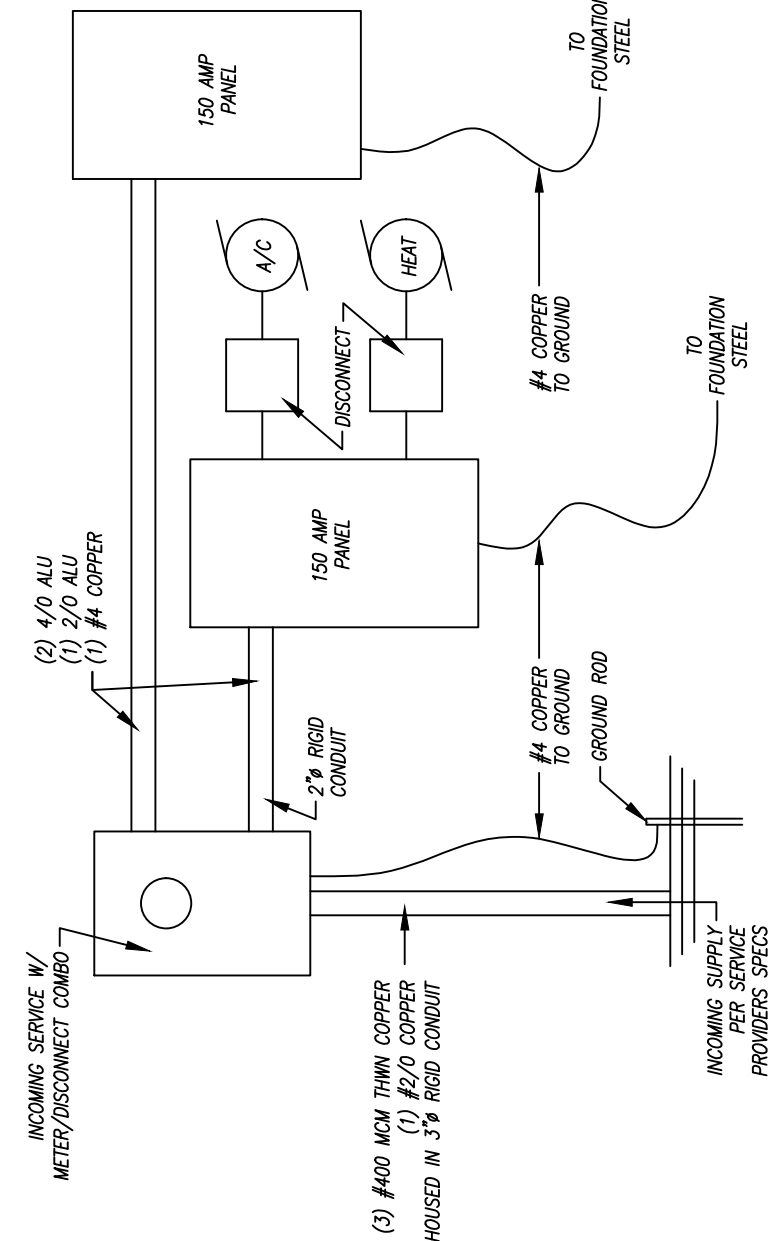

PANEL TO REQUIRE SURGE PROTECTOR PER NEC2020 CODE
ELECTRICAL RISER DIAGRAM
SCALE: N.T.S.

ELECTRIC KEY	
	= BATHROOM FAN
	= OVERHEAD LIGHT
	= EXTERIOR WALL MOUNT LIGHT
	= CANLIGHT
	= PENDANT LIGHT
	= VANITY LIGHT
	= FAN LIGHT KIT
	= LIGHT SWITCH
	= 3-WAY LIGHT SWITCH
	= 4-WAY LIGHT SWITCH
	= PUSH BUTTON
	= ELECT. OUTLET
	= GROUND FAULT
	= WATER PROOF
	= 220 V OUTLET
	= PHONE JACK
	= DOUBLE FLOOD
	= CABLE OUTLET
	= SMOKE DETECTOR
	= COMBO SMOKE CARBON MONOXIDE DETECTOR
	= FLUORESCENT
	= A/C DISCONNECT
	= ELECTRICAL PANEL
NOTES:	
- TV AND PHONE LOCATIONS TO BE VERIFIED WITH OWNER	
- ELECTRIC OUTLET PLACEMENT MAY VARY DEPENDING ON LOCAL CODES	
- ALL ELECTRICAL WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) 2020	
- APPROPRIATE OUTLETS SHALL BE TAMPER RESISTANT PER SECTION 406.11	
- ALL WET/DAMP LIGHTING SHALL BE UL APPROVED	

OLSEN
CUSTOM HOMES

ERIC C. OLSEN — CCC 1508852
"BUILDING INTEGRITY WITH EVERY HOME"
1455 S. GULF BLVD., PORT ORANGE, FL 32129
OFFICE: (386) 947-4481
FAX: (386) 947-4484
WWW.OLSENCUSTOMHOMES.COM

CUSTOM MODEL:
OLSEN MODEL
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA


DATE:	NO.:	DESCRIPTION

Daniel Johns, P.E. #54037


3869 S. NOVA ROAD SUITE #4
Port Orange, FL 32127
756-8582

DESIGN AND PLANS
ARE COPYRIGHTED BY
OLSEN CUSTOM HOMES
© 2003


DATE: 11/20/25
CHECKED BY: E.O.
SHEET #
5 OF 8

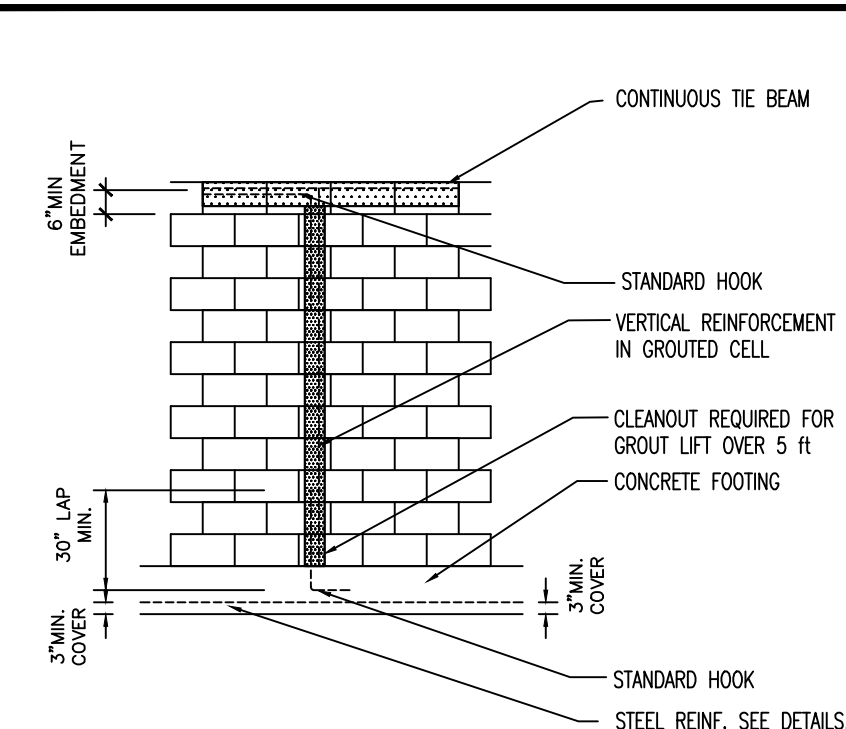

POURED CELL DETAIL
N.T.S.

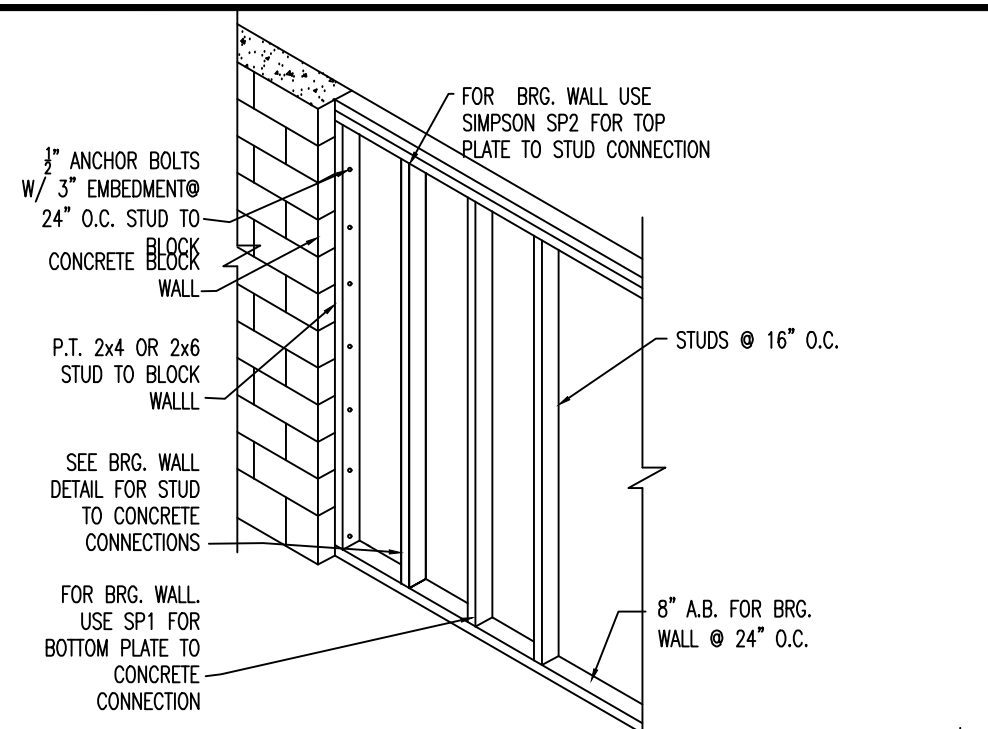


FRAME WALL TO BLOCK WALL CONNECTION
SCALE: N.T.S.

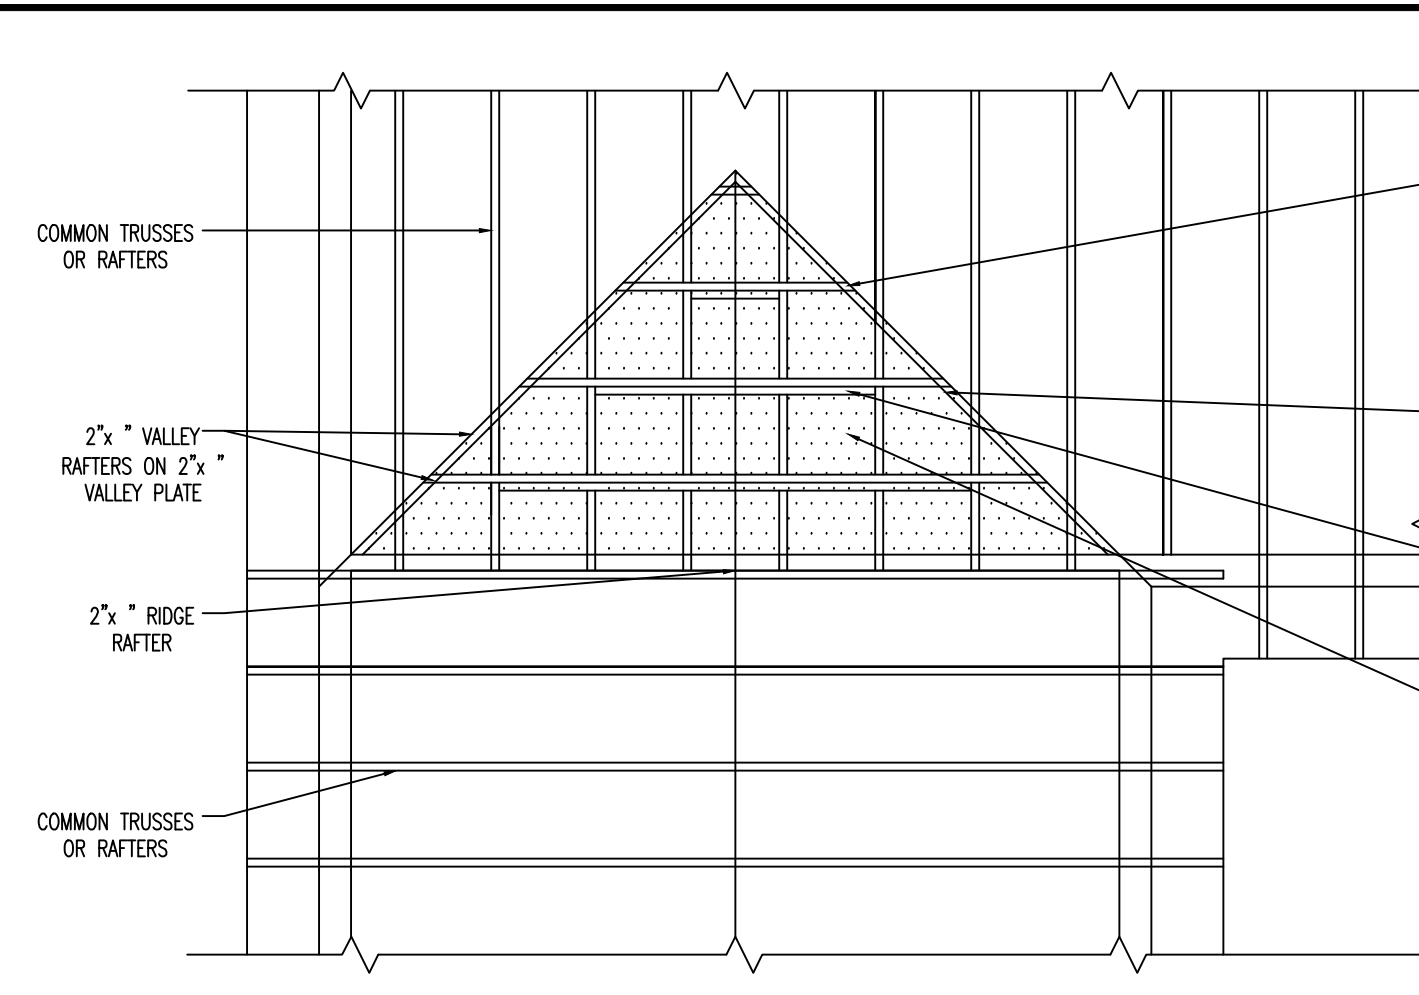


SPAN	SIZE	SPACING	RIDGE BEAM/VALLEY PLT.
TO 9'-6" MAX.	2"x6"	24" O.C.	2"x8"
TO 11'-8" MAX.	2"x6"	16" O.C.	2"x8"
9'-6" TO 12'-1" MAX.	2"x8"	24" O.C.	2"x10"
11'-8" TO 14'-9" MAX.	2"x8"	16" O.C.	2"x10"
12'-1" TO 14'-4" MAX.	2"x10"	24" O.C.	2"x12"
14'-9" TO 17'-6" MAX.	2"x10"	16" O.C.	2"x12"

NOTE: ALL FRAMING TO BE #2 S.Y.P. OR BETTER


VALLEY FRAMING DETAIL
N.T.S.

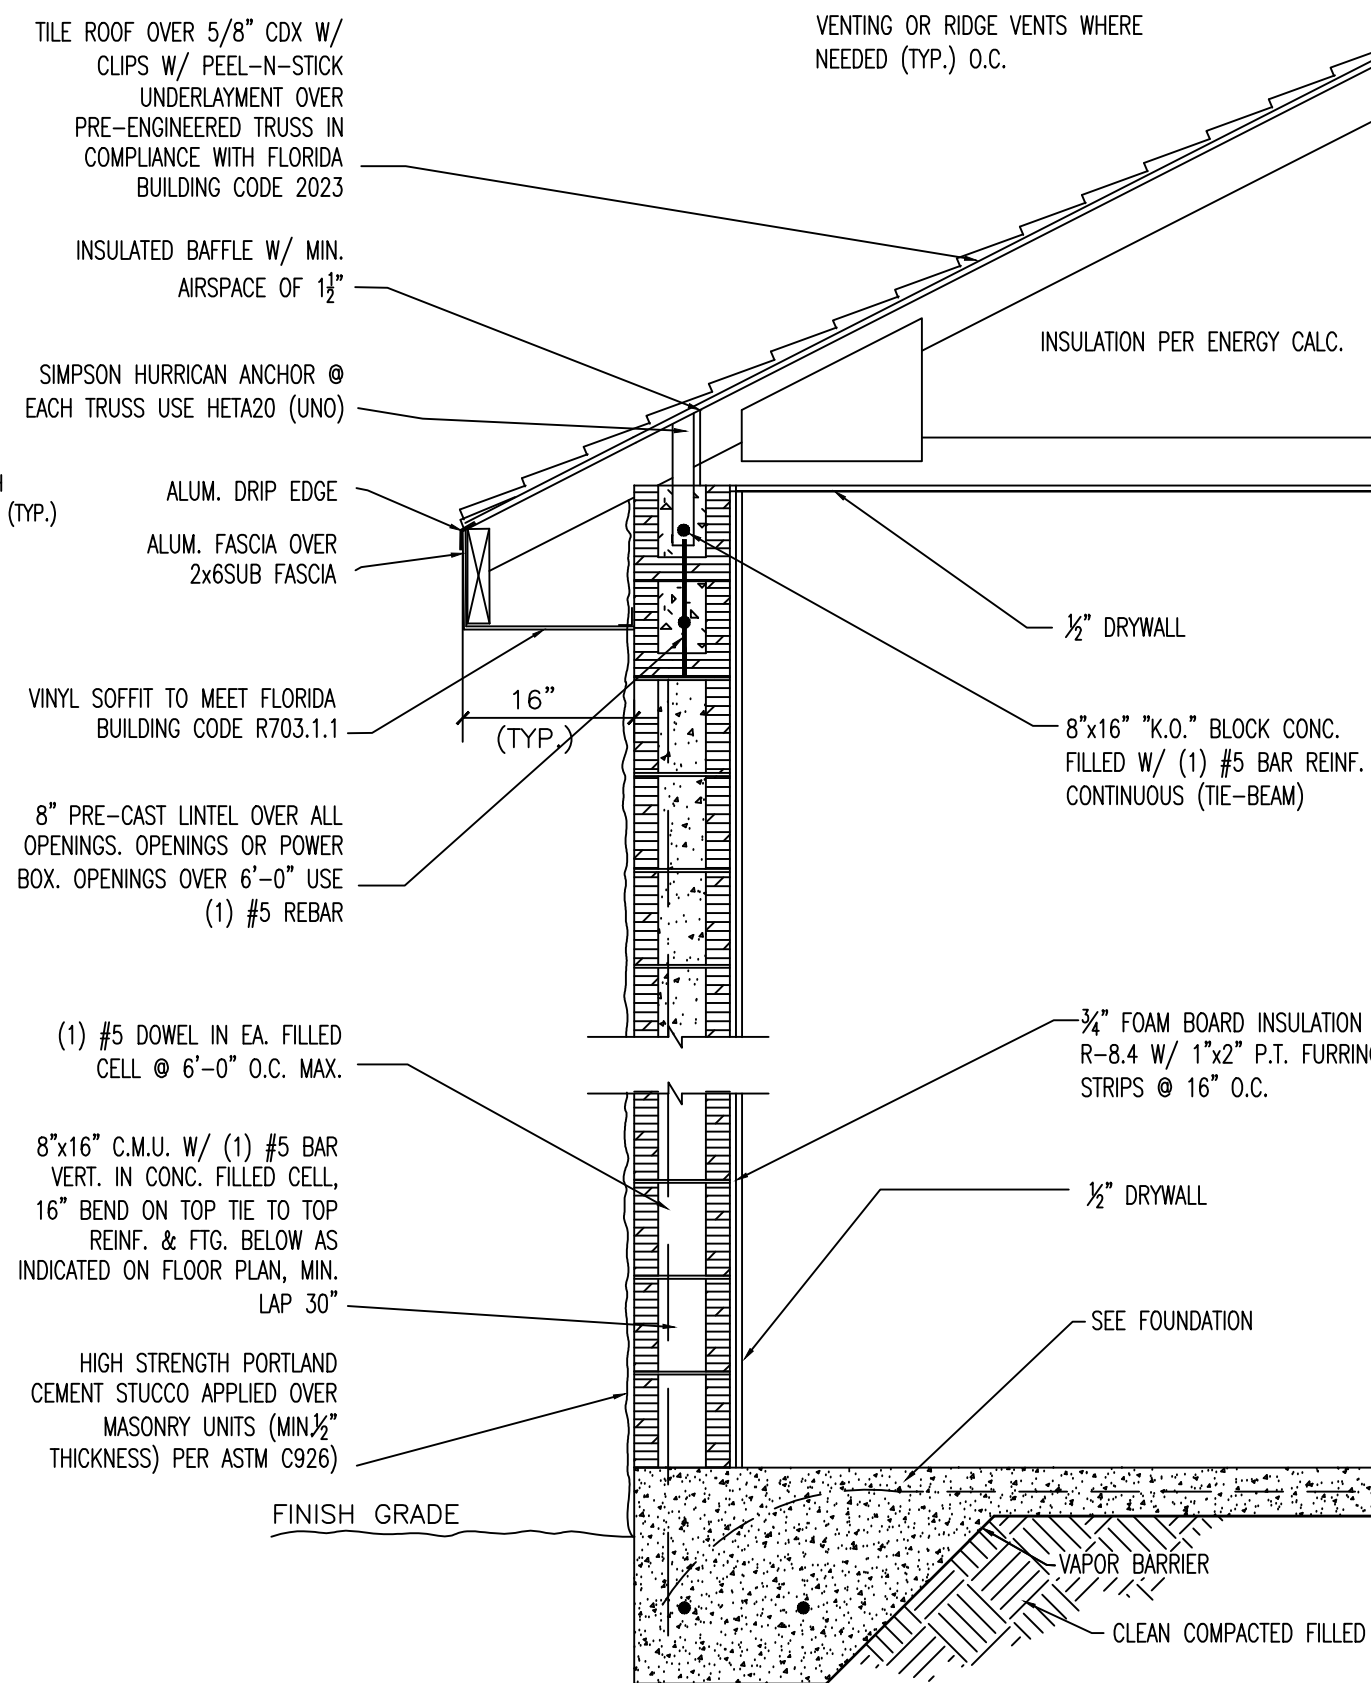


TYPICAL ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

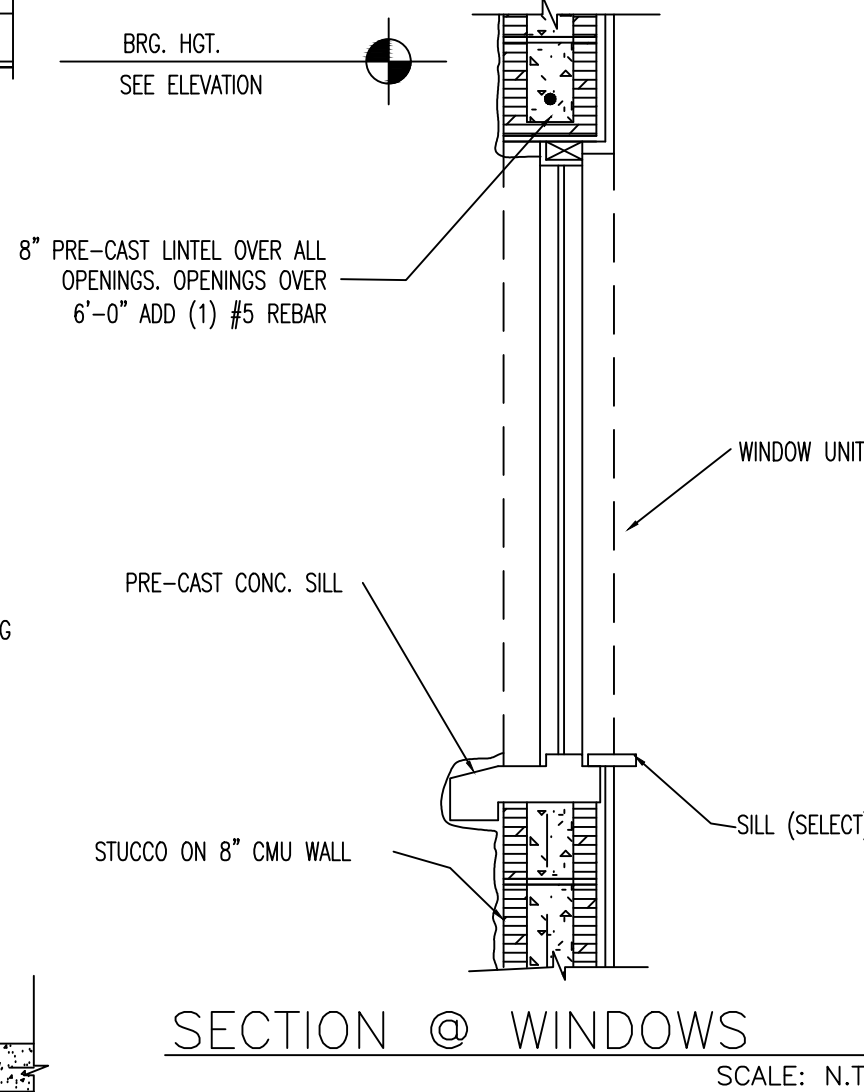


SECTION @ WINDOWS
SCALE: N.T.S.

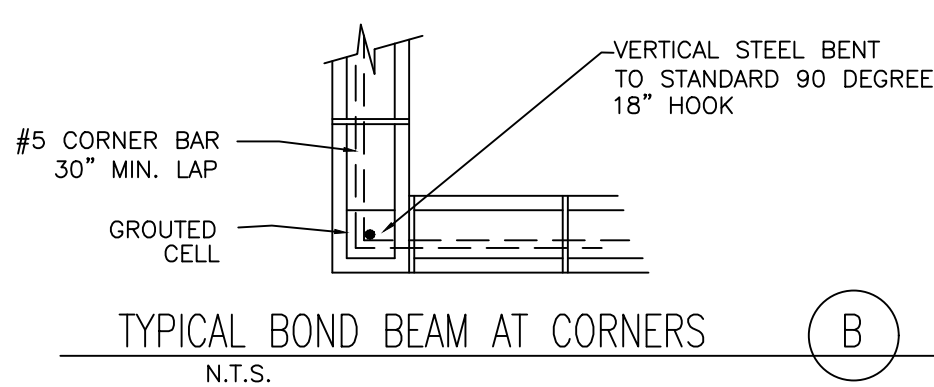


TYPICAL BOND BEAM AT CORNERS
N.T.S.

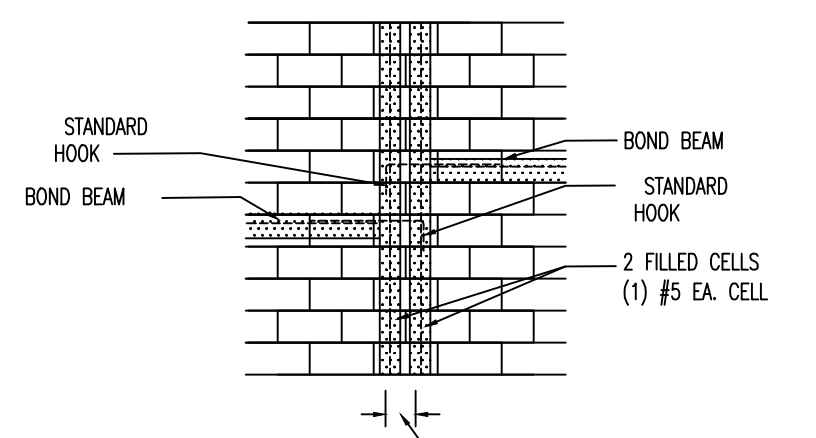


CHANGES IN BOND BEAM HGT.
N.T.S.

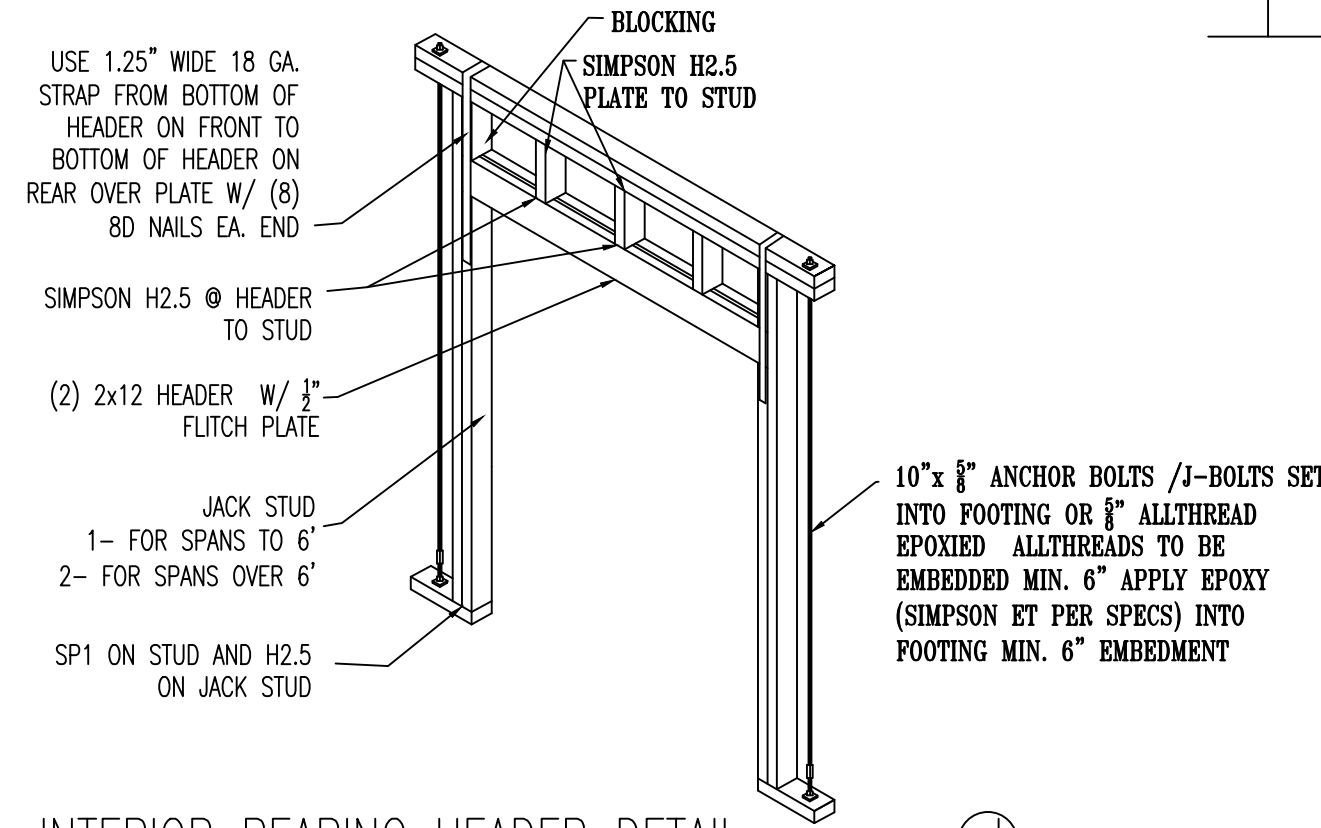


INTERIOR BEARING HEADER DETAIL
SCALE: N.T.S.

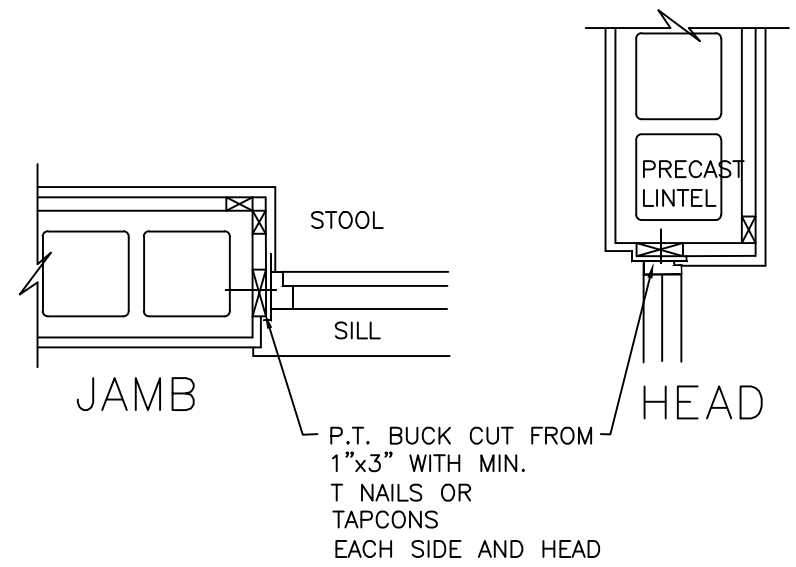


JAMB
N.T.S.

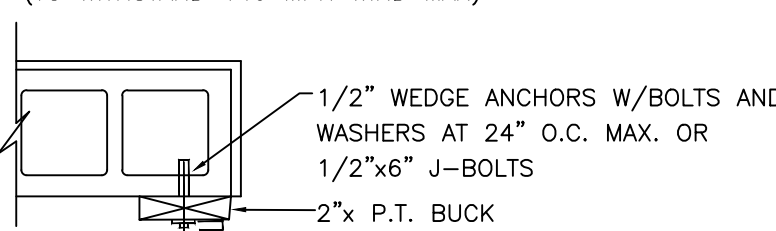


JAMB
N.T.S.

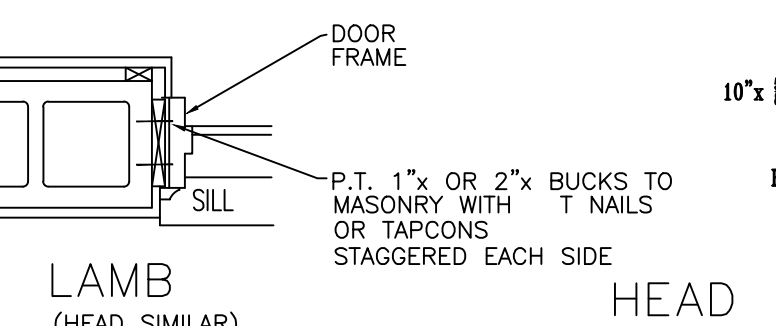


LAMB
N.T.S.

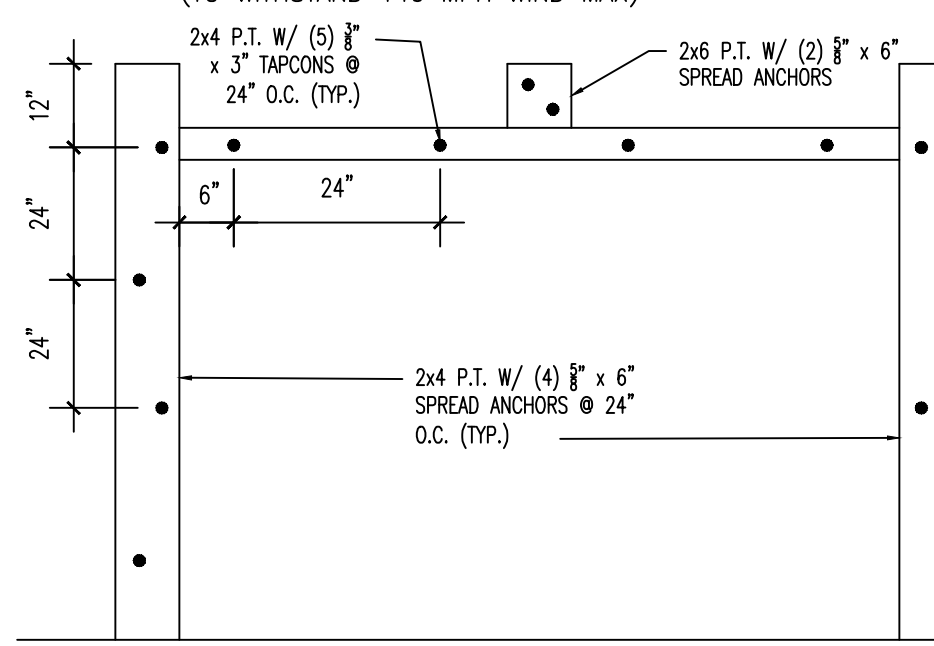


GARAGE DOOR BUCK DETAIL
N.T.S.

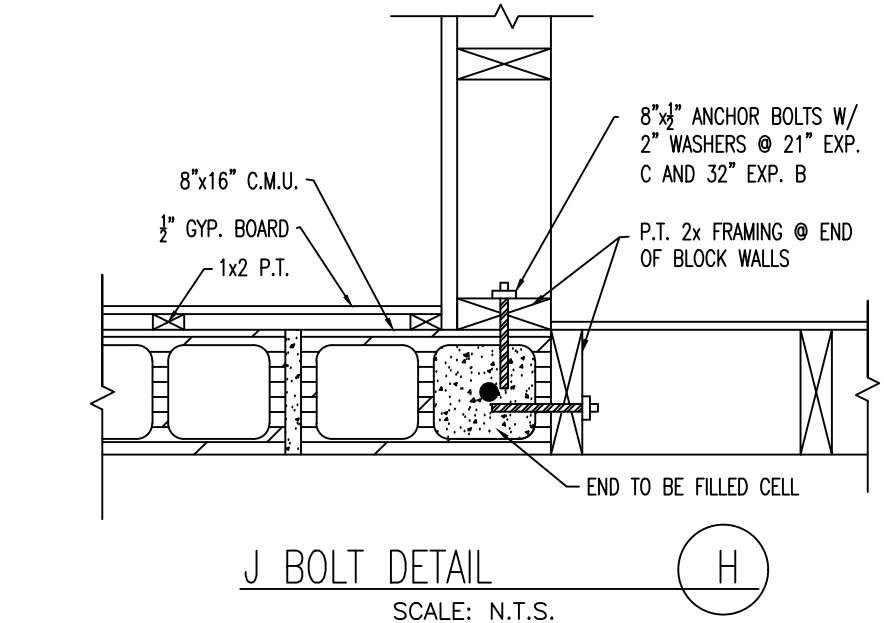


J BOLT DETAIL
SCALE: N.T.S.

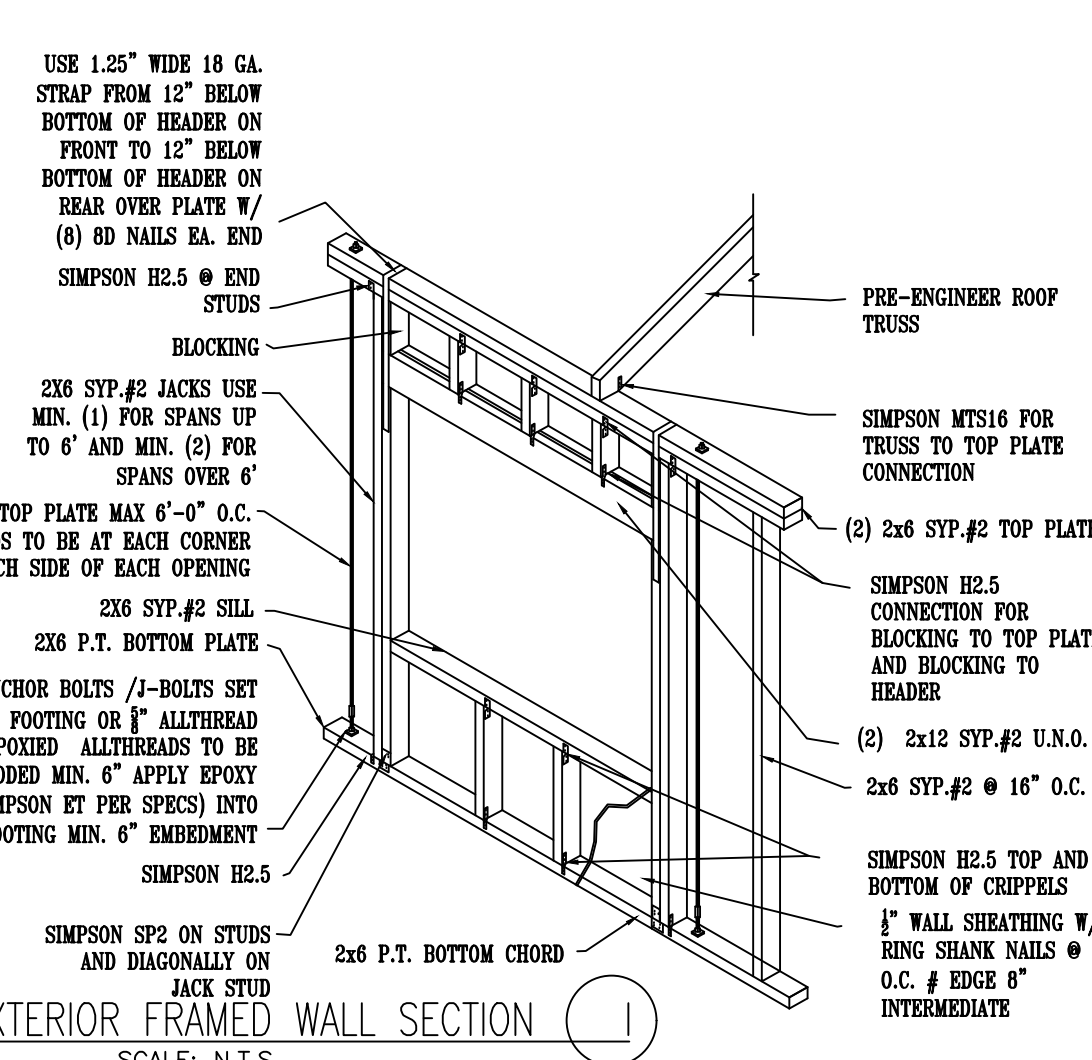


EXTERIOR FRAMED WALL SECTION
SCALE: N.T.S.

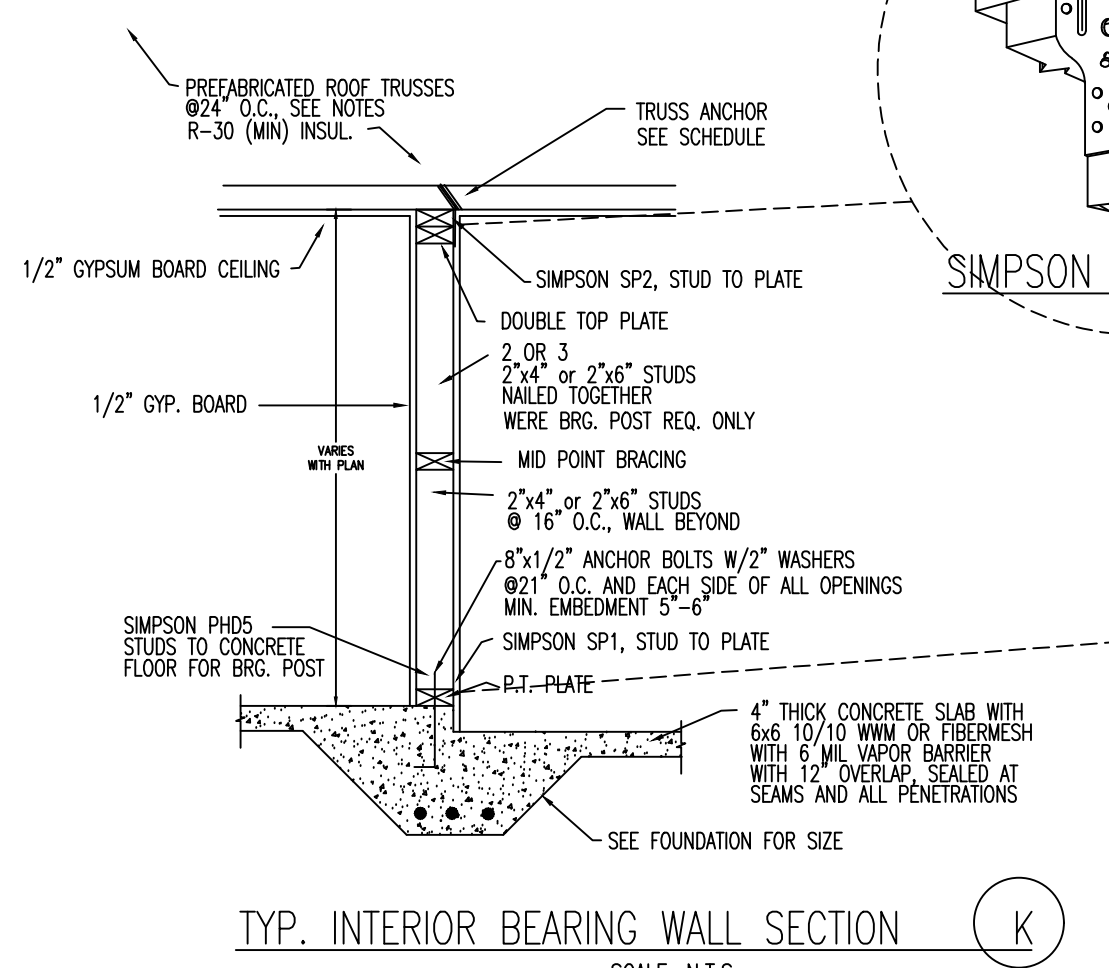


TYP. INTERIOR BEARING WALL SECTION
SCALE: N.T.S.

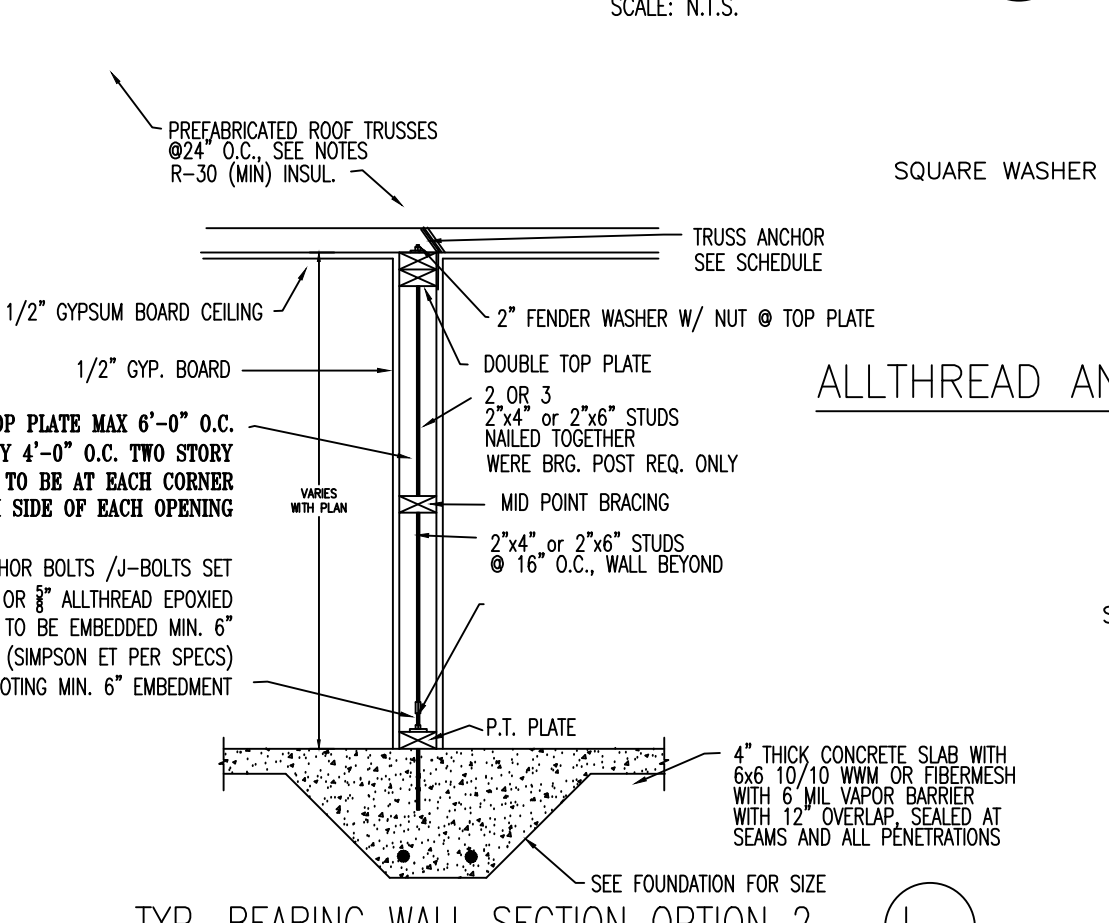


TYP. BEARING WALL SECTION OPTION 2
SCALE: N.T.S.

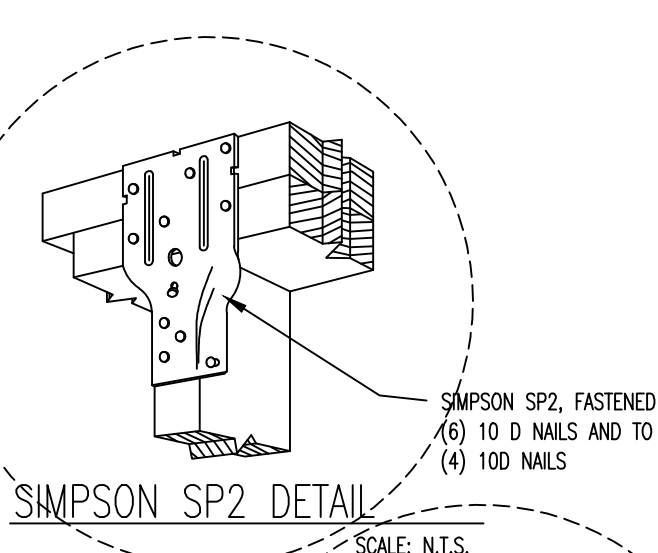


SIMPSON SP2 DETAIL
SCALE: N.T.S.

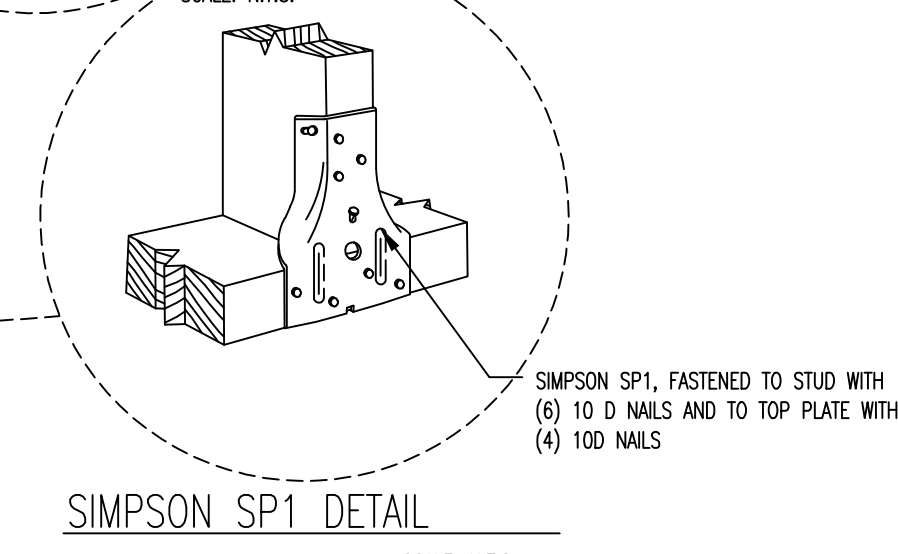


SIMPSON SP1 DETAIL
SCALE: N.T.S.

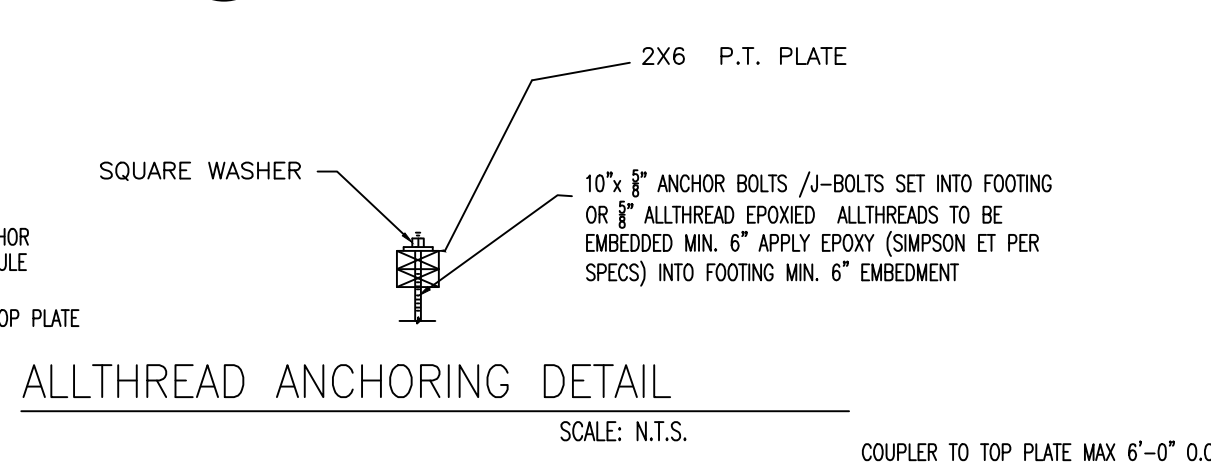

ALLTHREAD ANCHORING DETAIL
SCALE: N.T.S.

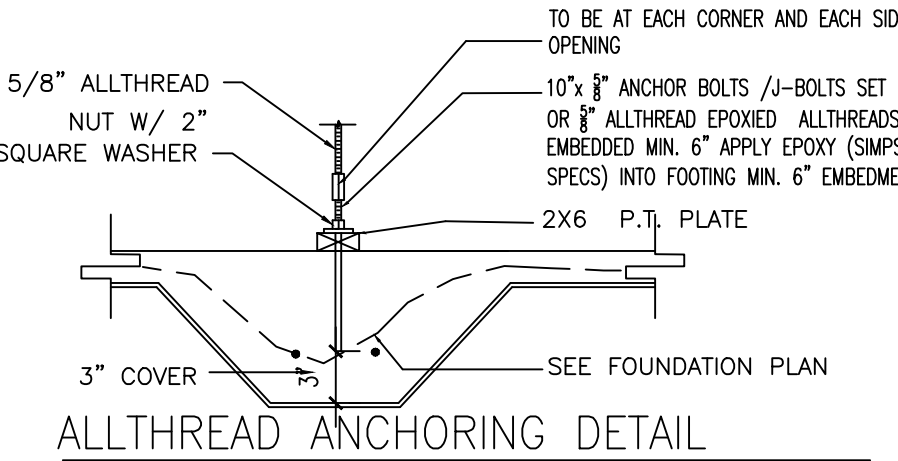

ALLTHREAD ANCHORING DETAIL
SCALE: N.T.S.

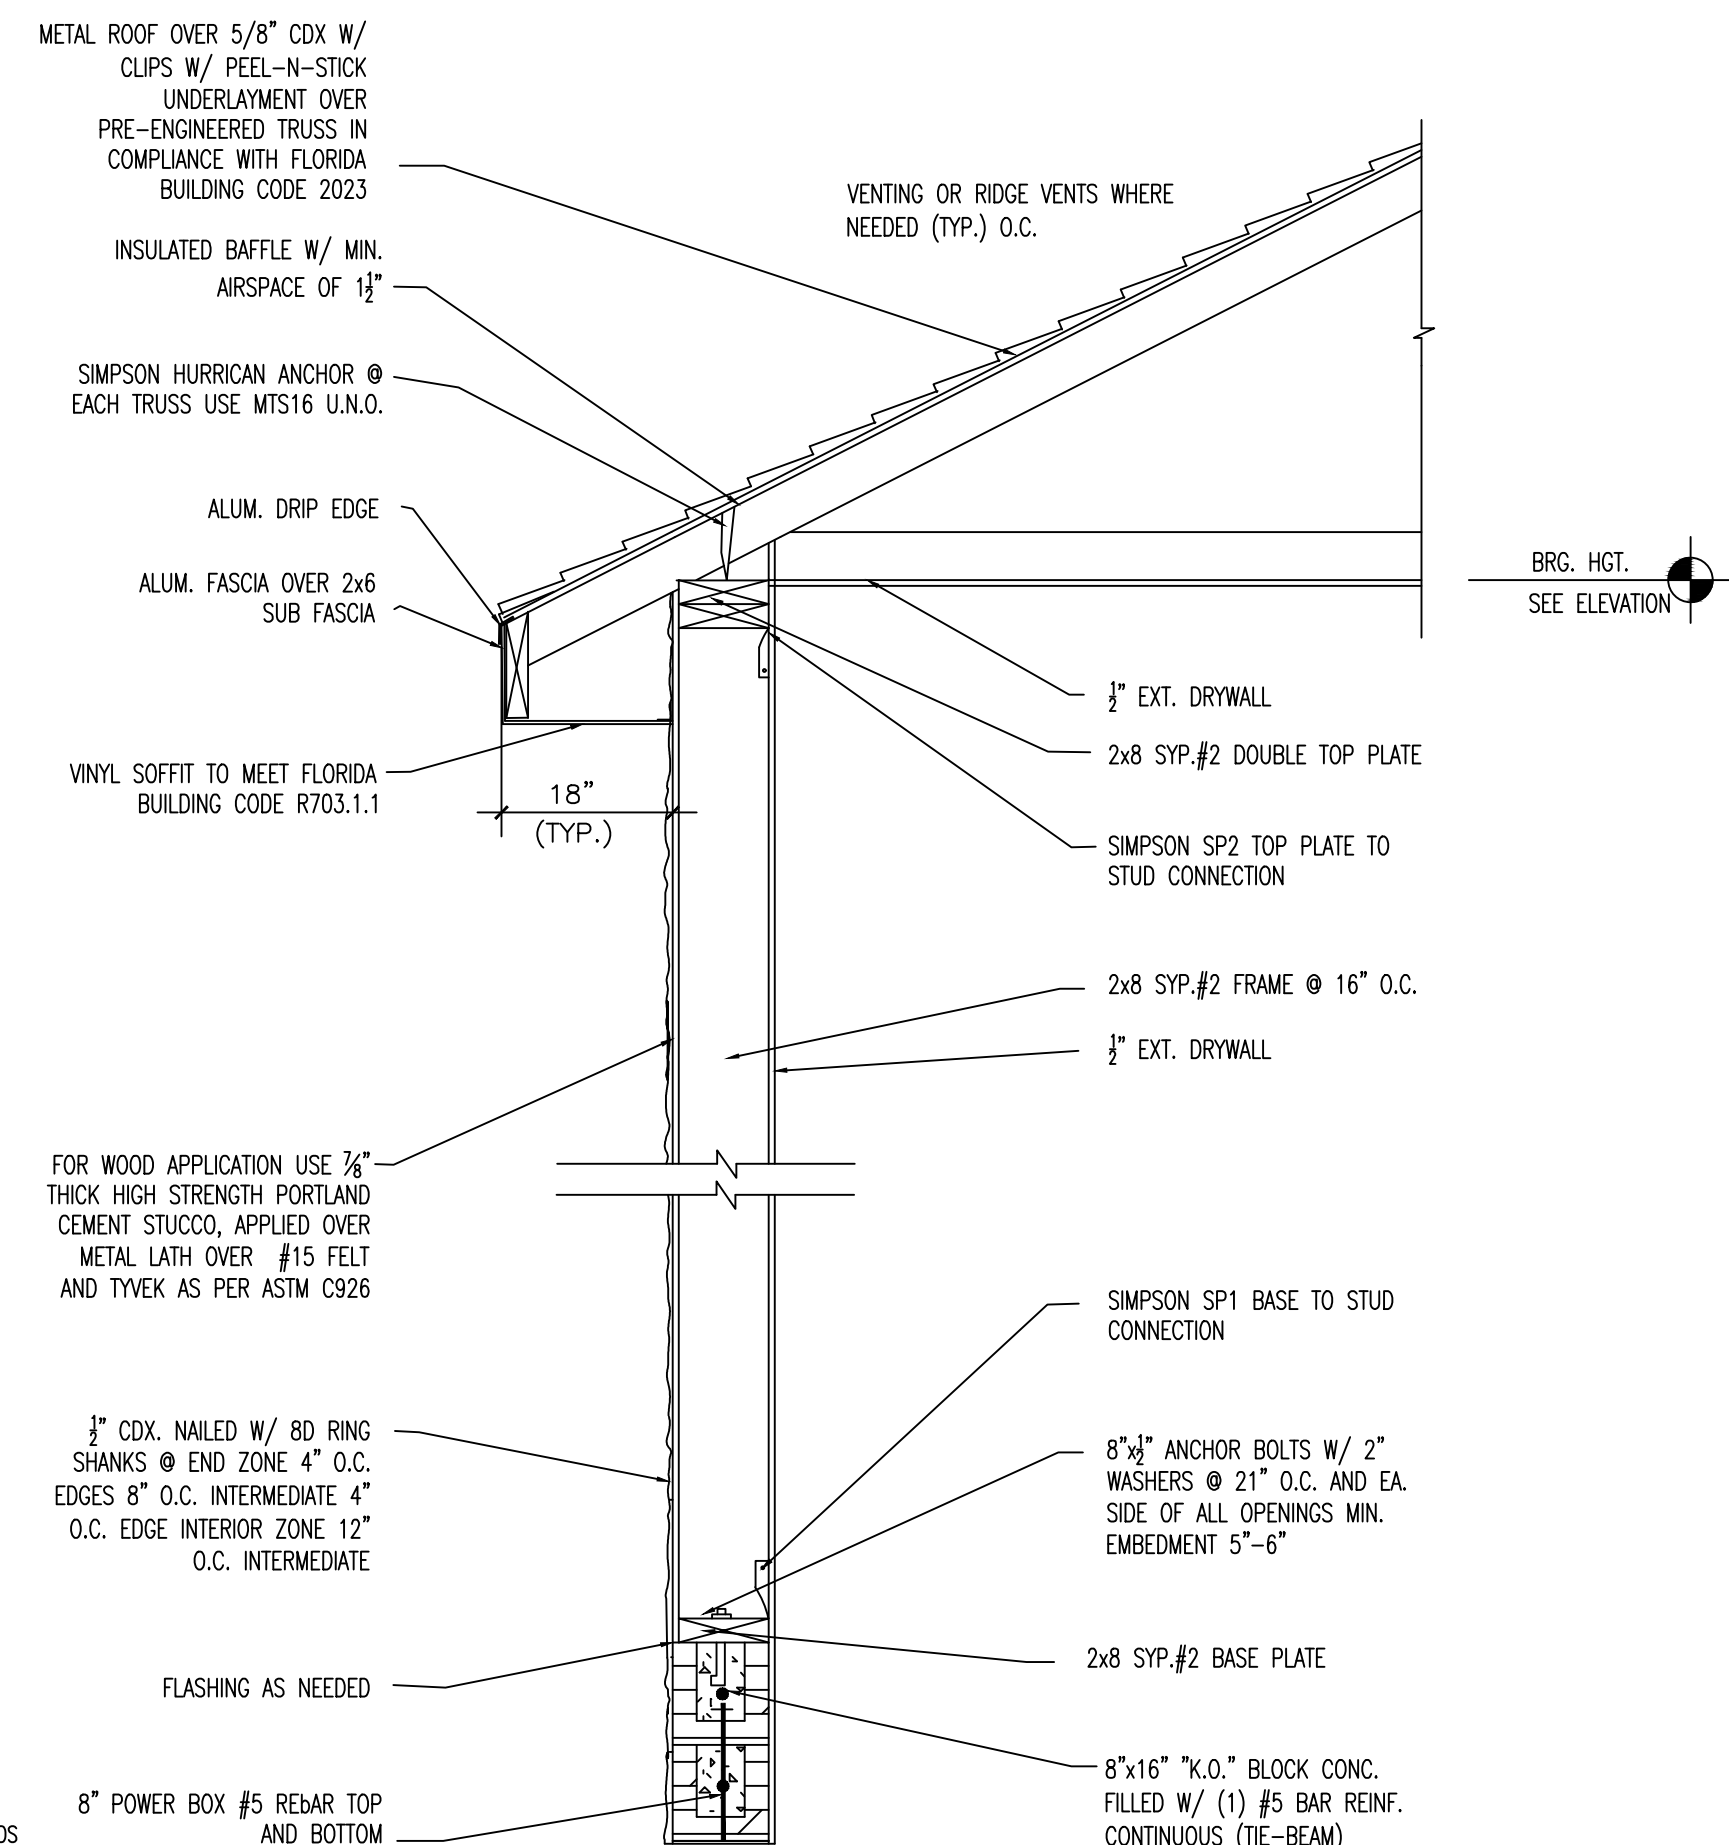

ENTRY DETAIL
SCALE: N.T.S.

OLSEN
ERIC C. OLSEN — CCC 1508852
"BUILDING INTEGRITY WITH EVERY HOME"
1450 S. US HWY. 1, SUITE 100, AVE
PORT ORANGE, FL 32129
OFFICE: (386) 947-4481
FAX: (386) 947-4482
WWW.OLSENCUSTOMHOMES.COM

CUSTOM MODEL:
OLSEN MODEL
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA

DATE:	NO.:	DESCRIPTION

Daniel Johns, P.E. #54037
3889 S. NOVA ROAD SUITE #4
Port Orange, FL 32127
756-8582

DESIGN AND PLANS
ARE COPYRIGHTED BY
OLSEN CUSTOM HOMES
© 2003
DATE: 11/20/25
CHECKED BY: E.O.
SHEET #
6 OF 8

WOOD SPECIES: ALL STRUCTURAL COMPONENTS SYP.#2
P.T. WHEN IN CONTACT W/ CONCRETE

A. WALL SHEATHING (WOOD OR PARTICLE BOARD)		
THICKNESS	FASTENER	NUMBER AND SPACING
1/2" OR LESS	6d DEFORMED	END ZONE 4" O.C. EDGES 8" O.C. INTERMEDIATE 6" O.C. EDGES INTERIOR ZONE 12" O.C. INTERMEDIATE
19/32" OR GREATER	8d DEFORMED	(SAME AS ABOVE)
B. FIBERBOARD SHEATHING		
THICKNESS	FASTENER	NUMBER AND SPACING
1/2" REGULAR	6d DEFORMED OR 11ga GALV. ROOFING NAIL 1 1/2" LONG W/ 7/16" HEAD	(SAME)
1/2" STRUCTURAL	8d DEFORMED OR 11ga GALV. ROOFING NAIL 1 1/2" LONG W/ 7/16" HEAD	ALL ZONES 3" O.C. EDGES 6" O.C. @ OTHER BEARING POINTS
25/32" STRUCTURAL	8d DEFORMED OR 11ga GALV. ROOFING NAIL 1 1/2" LONG W/ 7/16" HEAD	ALL ZONES 3" O.C. EDGES 6" O.C. @ OTHER BEARING POINTS

TILE ROOF OVER 5/8" CDX W/
CLIPS W/ PEEL-N-STICK
UNDERLAYMENT OVER
PRE-ENGINEERED TRUSS IN
COMPLIANCE WITH FLORIDA
BUILDING CODE 2023

HURRICANE ANCHOR @ EACH
TRUSS USE HETA20 (U.N.O.)

CANT. TRUSS
ALUM. FASCIA OVER 2x6 SUB
FASCIA ANGLE FASTENED @ 12"
O.C.


ALUMINUM DRIP
EDGE

VINYL SOFFIT


8x16 CMU COL. (4) #5 BARS
CONT. POURED SOLID

FRAMED AS NEEDED

8" PRE-CAST LINTEL OR POWER
BOX OVER ALL OPENINGS. SEE
PLANS FOR SIZE.

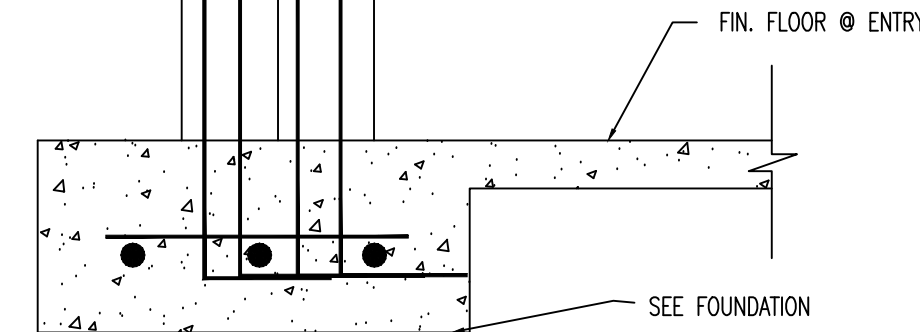

LANAI COL. DETAIL
SCALE: N.T.S.

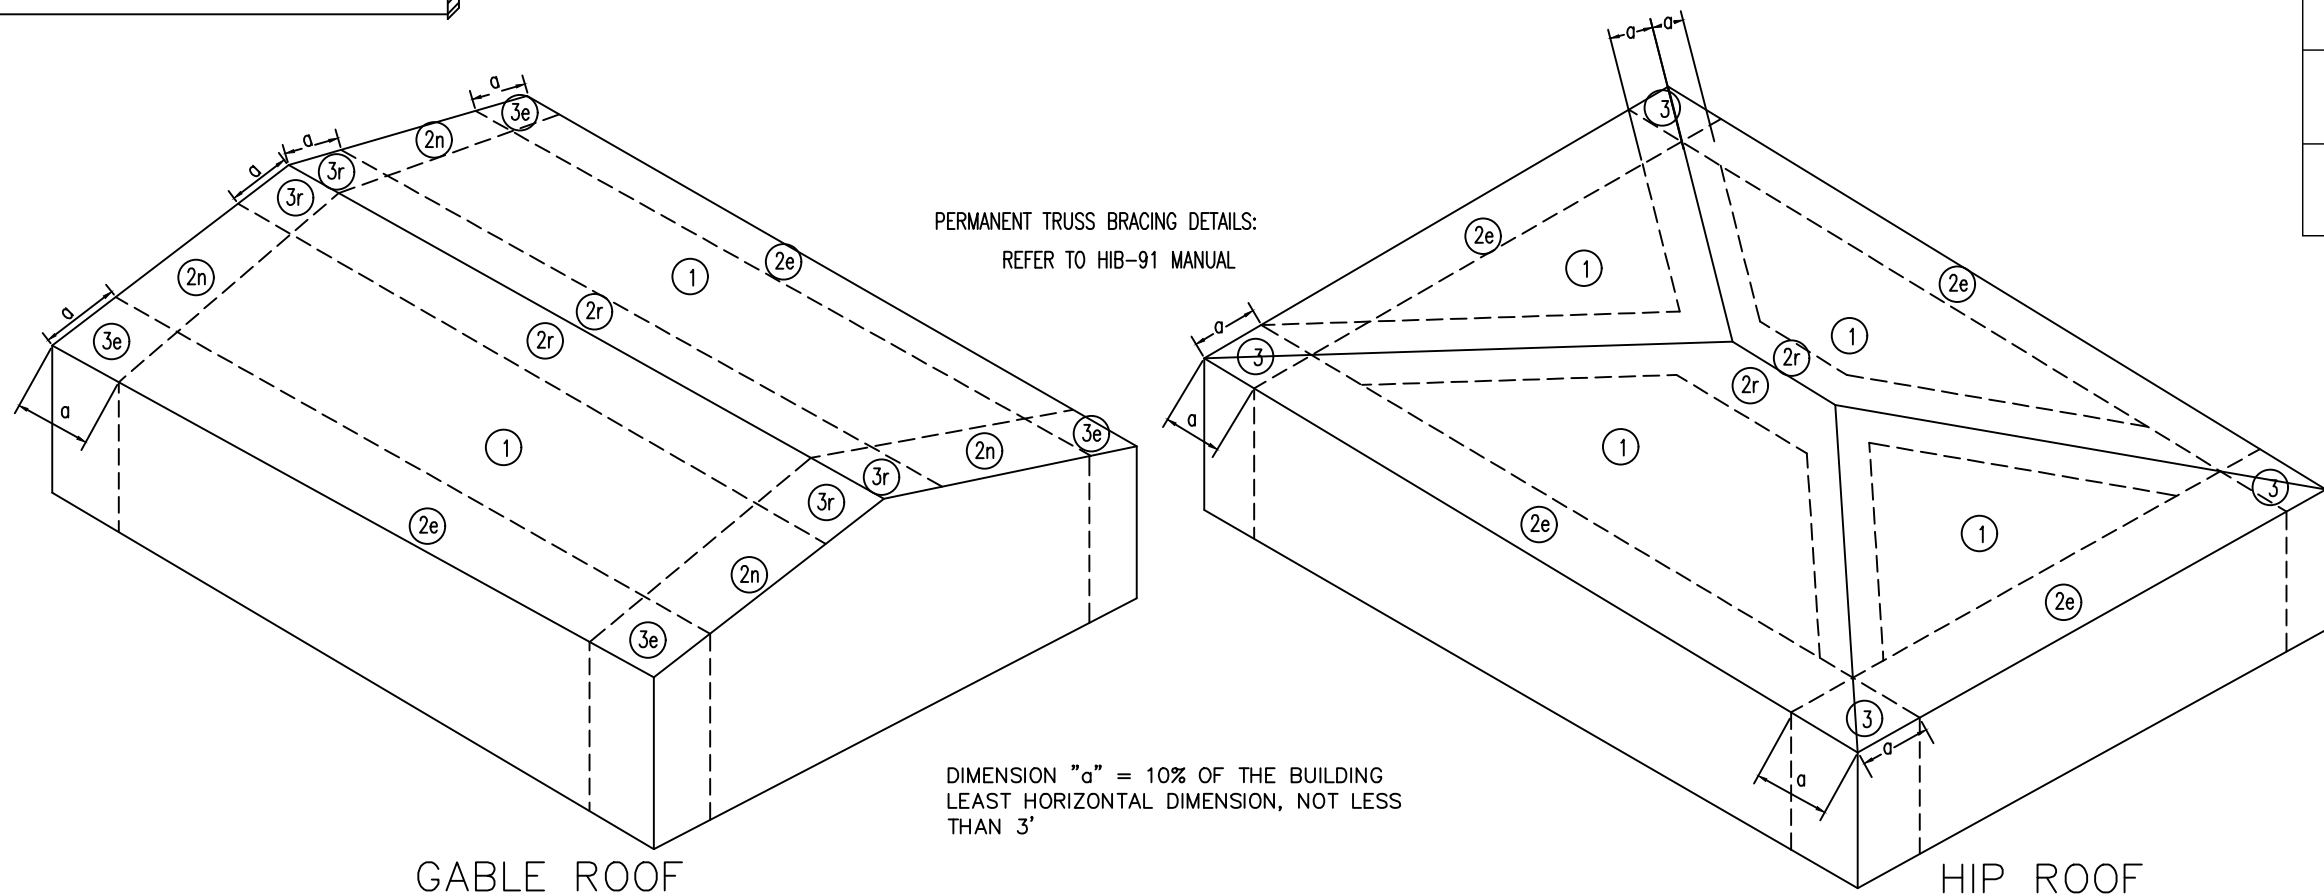

PERMANENT TRUSS BRACING DETAILS:
REFER TO HB-91 MANUAL

DIMENSION "a" = 10% OF THE BUILDING
LEAST HORIZONTAL DIMENSION, NOT LESS
THAN 3'

1. ROOF SHEATHING SHALL BE 5/8" EXPOSURE 1 C-D SHEATHING GRADE PLYWOOD OR OSB (WOOD STRUCTURAL
PANELS) OR BETTER. LONG DIMENSION SHALL BE
PERPENDICULAR TO FRAMING AND END JOINTS SHALL BE STAGGERED

2. SHEATHING SHALL BE FASTENED TO FRAMING AS PER CHART BELOW
FASTENERS WITHIN OVERHANG SHALL BE 6" O.C.

SHEATHING NAILING INDEX				
FLORIDA BUILDING CODE 2023				
LOCATION (ZONE)	EXP.	NAIL	O.C. EDGE	O.C. FIELD
ROOF - EDGE / INTERIOR	B	8d	4"	6"
ROOF - GABLE EDGE	B	8d	4"	6"
ROOF - EDGE / INTERIOR	C	8d	4"	6"
ROOF - GABLE EDGE	C	8d	4"	6"
WALL - EDGE / CORNER	B/C	8d	4"	8"
WALL - INTERIOR	B/C	8d	6"	12"
NOTES: 1. RING SHANK NAILS ARE TO BE USED FOR ALL ZONES. 2. PATTERNS SHOWN ARE FOR 140 MPH EXPOSURE "B" & "C". 3. PATTERNS SHOWN ARE FOR STRUCTURES TO 30' MAX. MEAN ROOF HEIGHT. 4. EDGE / CORNER TO BE FIRST FULL SHEET (4') FROM FROM ANY EDGE / CORNER, (E.G., FROM FASCIA HIP, OR RIDGE).				

PowerBOX8 Lintels

8" inch block width


LINTEL LOAD TABLE (IN POUNDS PER LINEAL FOOT)

Latent Load Table 3000 psi grout

(20ga. < 16'-0" span)
(16ga. >= 16'-0" span)


ALL LOADS ARE SUPERIMPOSED

SPAN (ft)	P3box8-8" #5 top	P3box8-8" #5 top	P3box8-12" #5 top	P3box8-12" #5 top	P3box8-14" #5 top	P3box8-14" #5 top	P3box8-16" #5 top	P3box8-16" #5 top	P3box8-18" #5 top	P3box8-18" #5 top	P3box8-20" #5 top	P3box8-20" #5 top	P3box8-22" #5 top	P3box8-22" #5 top	P3box8-24" #5 top	P3box8-24" #5 top	P3box8-26" #5 top	P3box8-26" #5 top	P3box8-28" #5 top	P3box8-28" #5 top	P3box8-30" #5 top	P3box8-30" #5 top	P3box8-32" #5 top	P3box8-32" #5 top	P3box8-34" #5 top	P3box8-34" #5 top	P3box8-36" #5 top	P3box8-36" #5 top	P3box8-38" #5 top	P3box8-38" #5 top	P3box8-40" #5 top	P3box8-40" #5 top	SPAN (ft)	
1'-0"	3256	3256	4097	4097	4726	4726	5296	4960	5496	5836	5836	6372	6732	6732	7267	7267	7816	8086	8546	8546	9100	9100	9654	9654	10218	10218	10792	10792	11366	11366	11960	11960	1'-6"	
2'-2"	2254	2254	2836	2836	3126	3126	3434	3434	3654	4043	4043	4391	4691	4691	4937	4937	5247	5517	5817	5817	6170	6170	6524	6524	6878	6878	7232	7232	7586	7586	7940	7940	2'-2"	
3'-0"	1832	1832	2304	2304	2584	2584	2792	2792	3205	3205	3381	3717	3717	3853	4189	4189	4459	4689	4959	4959	5230	5230	5500	5500	5770	5770	6040	6040	6310	6310	6580	6580	3'-0"	
3'-2"	1540	1540	1941	1841	2144	2144	2340	2340	2796	2796	2958	3168	3168	3258	3568	3568	3808	4038	4268	4268	4508	4508	4748	4748	4988	4988	5228	5228	5468	5468	5708	5708	3'-2"	
4'-0"	1221	1221	1536	1536	1697	1697	1860	1860	2100	2100	2190	2424	2424	2424	2658	2658	2898	3028	3208	3208	3388	3388	3568	3568	3748	3748	3928	3928	4108	4108	4288	4288	4'-0"	
4'-6"	1085	1085	1388	1388	1509	1509	1653	1653	1848	1848	1948	2184	2184	2184	2418	2418	2648	2788	2948	2948	3108	3108	3268	3268	3428	3428	3588	3588	3748	3748	3908	3908	4'-6"	
5'-2"	945	945	1189	1189	1314	1314	1440	1440	1695	1695	1954	1954	1954	2184	2184	2481	2681	2881	2961	3061	3161	3261	3361	3461	3561	3661	3761	3861	3961	4061	4161	4261	5'-2"	
6'-2"	792	792	996	996	1101	1101	1206	1206	1448	1448	1620	1620	1620	1837	1837	1987	2167	2267	2367	2367	2467	2467	2567	2567	2667	2667	2767	2767	2867	2867	2967	2967	6'-2"	
7'-0"	686	686	876	876	976	976	1076	1076	1263	1263	1416	1416	1416	1603	1603	1753	1863	1963	1963	2063	2063	2163	2163	2263	2263	2363	2363	2463	2463	2563	2563	2663	2663	7'-0"
8'-0"	611	611	736	749	781	781	824	822	938	901	922	974	1000	1000	1086	1145	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	1231	8'-0"
9'-2"	462	462	562	570	596	596	636	636	738	686	702	742	762	762	844	872	937	937	937	937	937	937	937	937	937	937	937	937	937	937	937	937	937	9'-2"
10'-0"	411	411	472	472	479	500	508	526	536	576	590	626	632	640	708	713	738	738	738	738	738	738	738	738	738	738	738	738	738	738	738	738	738	10'-0"
11'-2"	331	334	378	384	401	408	422	430	482	473	490	500	513	513	566	588	632	632	632	632	632	632	632	632	632	632	632	632	632	632	632	632	632	11'-2"
12'-0"	287	288	324	329	333	347	353	366	373	400	410	413	443	443	494	508	548	548	548	548	548	548	548	548	548	548	548	548	548	548	548	548	548	12'-0"
12'-8"	267	260	294	299	312	317	328	334	359	368	388	389	398	422	457	491	509	529	529	529	529	529	529	529	529	529	529	529	529	529	529	529	529	12'-8"
13'-4"	222	234	268	270	281	286	296	302	324	332	351	360	366	396	412	443	480	480	480	480	480	480	480	480	480	480	480	480	480	480	480	480	480	13'-4"
14'-0"	211	215	241	244	255	259	269	274	294	301	319	326	363	374	402	417	444	444	444	444	444	444	444	444	444	444	444	444	444	444	444	444	444	14'-0"
15'-0"	196	202	226	228	238	242	252	256	276	283	301	308	346	358	386	401	428	428	428	428	428	428	428	428	428	428	428	428	428	428	428	428	428	15'-0"
20'-8"	214	215	234	235	243	245	262	264	289	292	307	308	336	338	366	369	395	395	395	395	395	395	395	395	395	395	395	395	395	395	395	395	395	20'-8"
20'-8"	169	200	205	218	228	229	230	235	259	260	275	276	283	284	308	310	334	334	334	334	334	334	334	334	334	334	334	334	334	334	334	334	334	20'-8"
20'-8"	162	183	177	178	185	186	186	191	193	204	206	219	219	219	239	243	260	260	260	260	260	260	260	260	260	260	260	260	260	260	260	260	260	20'-8"
22'-8"	135	135	148	148	163	163	154	158	167	170	172	180	182	182	196	202	216	220	220	220	220	220	220	220	220	220	220	220	220	220	220	220	220	22'-8"
24'-0"								143	145	153	155	163	166	166	186	190	206	210	210	210	210	210	210	210	210	210	210	210	210	210	210	210	210	24'-0"
26'-0"								122	123	130	132	138	141	141	154	157	167	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172	26'-0"
26'-0"								105	106	112	114	119	121	122	132	136	144	146	146	146	146	146	146	146	146	146	146	146	146	146	146	146	146	26'-0"
30'-0"								92	93	96	96	96	104	106	115	116	124	126	126	126	126	126	126	126	126	126	126	126	126	126	126	126	126	30'-0"
34'-0"																	90	92	98	101	104	104	104	104	104	104	104	104	104	104	104	104	34'-0"	
36'-0"																		82	87	90	94	94	94	94	94	94	94	94	94	94	94	94	36'-0"	
38'-0"																																		38'-0"
40'-0"																																		40'-0"

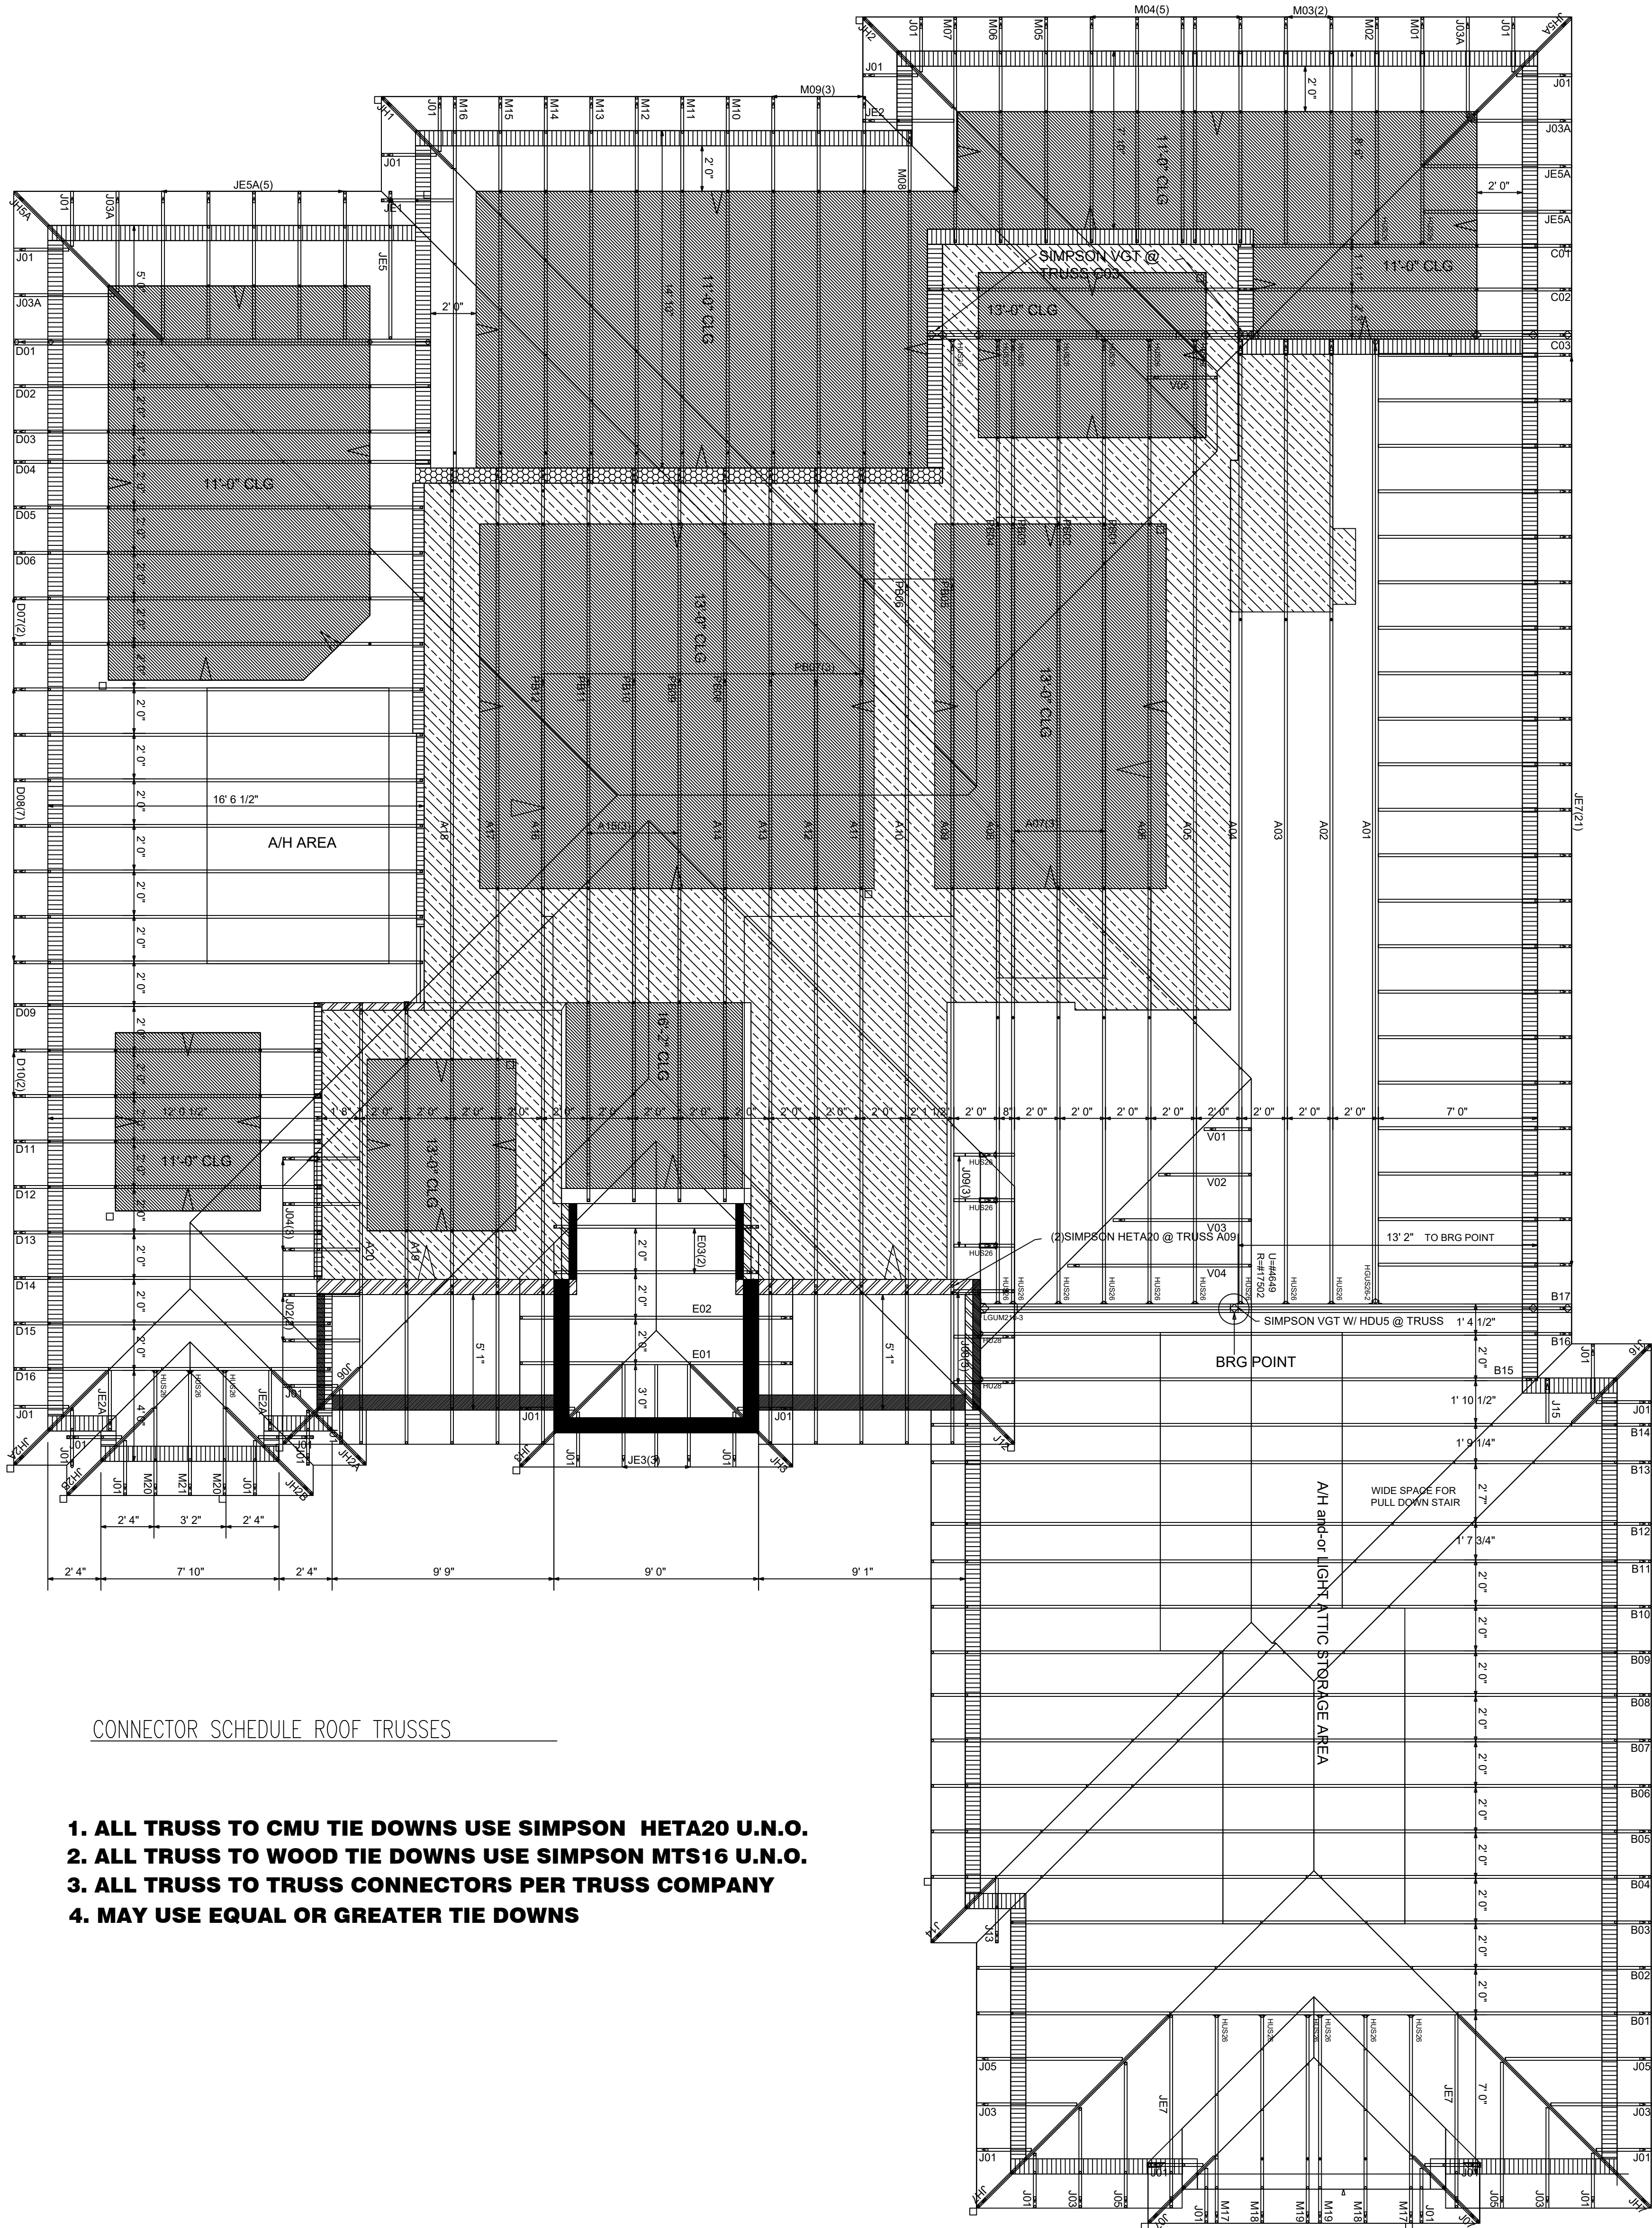

CONNECTOR SCHEDULE ROOF TRUSSES


1. ALL TRUSS TO CMU TIE DOWNS USE SIMPSON HETA20 U.N.O.
2. ALL TRUSS TO WOOD TIE DOWNS USE SIMPSON MTS16 U.N.O.
3. ALL TRUSS TO TRUSS CONNECTORS PER TRUSS COMPANY
4. MAY USE EQUAL OR GREATER TIE DOWNS

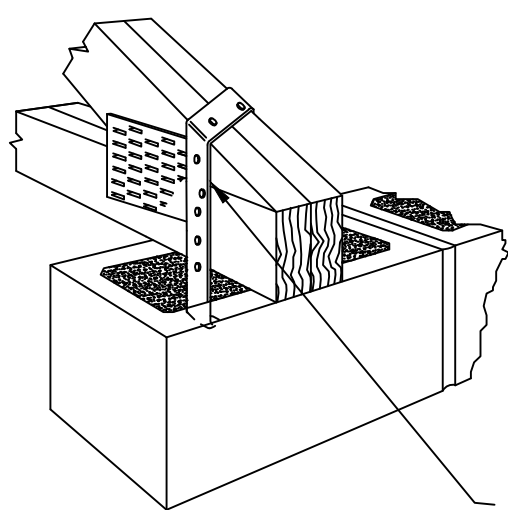

SIMPSON HETA20 DETAIL

SIMPSON HETA20 FASTENED TO TRUSS W/ (12) 10d x 1 1/2" NAILS FOR SINGLE PLY DOUBLE PLY TRUSS USE (14) 10d NAILS

SCALE: N.T.S.

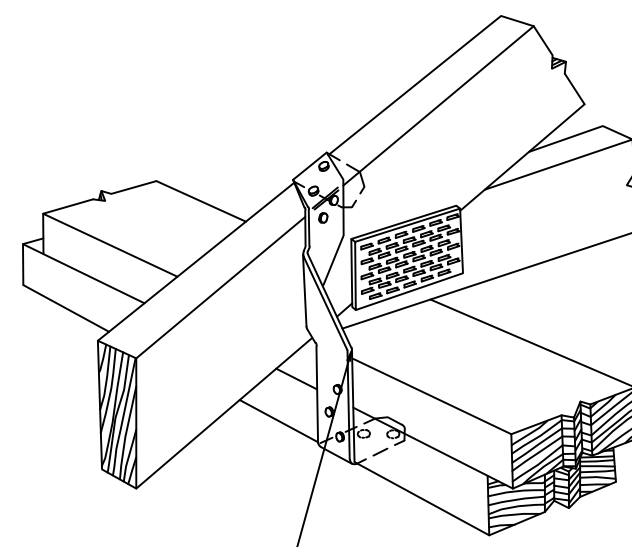

SIMPSON MTS16 DETAIL

SIMPSON MTS16 FASTENED TO TRUSS W/ (14) 10d NAILS

SCALE: N.T.S.

8 OF 8

SHEET #

CHECKED BY: E.O.

DATE: 11/20/25

DESIGN AND PLANS ARE COPYRIGHTED BY OLSEN CUSTOM HOMES © 2003

Daniel Johns, P.E. #54037

3869 S. NOVA ROAD SUITE #4
Port Orange, FL 32127
756-8582

REVISIONS

DATE: NO.: DESCRIPTION

CUSTOM MODEL:

OLSEN MODEL
183 STILLWATER DRIVE
VERANDA BAY LOT 181
FLAGLER BEACH, FLORIDA

OLSEN
CUSTOM HOMES

ERIC C. OLSEN - CGC 1508852
"BUILDING INTEGRITY WITH EVERY HOME"
3450 SOUTH RIDGEWOOD AVE
PORT ORANGE, FL 32129
OFFICE: (386) 947-4481
FAX: (386) 947-4484
WWW.OLSENCUSTOMHOMES.COM